

September 3, 2010

VIA HAND DELIVERY & ELECTRONIC MAIL

Luly E. Massaro, Commission Clerk
Rhode Island Public Utilities Commission
89 Jefferson Boulevard
Warwick, RI 02888

**RE: The Narragansett Electric Company d/b/a National Grid, Filing to Amend
Terms and Conditions for Distribution Service
Docket No. 4200**

Dear Ms. Massaro:

Enclosed pursuant to Commission Rule 1.9(d) are ten (10) copies of National Grid's¹ filing to request approval of the enclosed Terms and Conditions for Distribution Service, R.I.P.U.C. No. 2040, effective October 15, 2010. These terms and conditions would supersede the Company's Terms and Conditions for Distribution Service, R.I.P.U.C. No. 2022-A. The Terms and Conditions tariff, marked to show changes from the tariff currently in effect, is contained in this filing as Attachment 1. A clean copy of the amended document is attached as Attachment 2. In addition to the tariff and supporting explanatory information, the Company is enclosing a draft notice that will be published in *The Providence Journal* to notify the public of the filing in accordance with Commission Rule 1.9(d)(2). This draft public notice of the filing is attached as Attachment 3. The Company will publish this notice after receiving a docket number for this filing from the Commission.

Specifically, National Grid seeks to amend Section 1, Service Connection, to clarify who can make the final connection between the customer's facilities and the Company's facilities as part of the operation of the National Grid Connects Program ("NG Connects"). There will be no impact on rates as a result of the tariff amendments requested with this filing.

NG Connects is a new program the Company has implemented in Rhode Island for the convenience and benefit of its residential customers. NG Connects allows a licensed electrician who is registered with the Company to make the permanent overhead connection between the Company's service drop cable and the customer's service entrance cable. The current version of Section 1 states that the Company will connect its facilities, but does not specify as to how the Company can most efficiently and effectively perform this function for customers. The amended Section 1 is intended to provide clarity to customers and their representatives that either National Grid can make the service connection or the Company can fulfill its obligation pursuant to this

¹ The Narragansett Electric Company d/b/a National Grid (hereinafter referred to as "National Grid" or the "Company")

tariff provision through another means, such as through NG Connects. NG Connects is a voluntary program and National Grid's customers will not incur any additional cost from the Company as a result of his/her electrician's participation in NG Connects.

NG Connects simplifies the process by allowing a licensed electrician hired by a customer to make the permanent connection provided the following conditions are met:

- The work must involve an existing overhead residential service;
- The residential overhead service must be single phase, three wire, and 200 amps or less;
- There must be no change in the Company's service point of attachment;
- The service wire must be available and in good condition;
- The electrician must be licensed and in good standing with the authority having jurisdiction and must sign up with the Company to participate in NG Connects; and
- The electrician must use connectors that will be supplied by National Grid at no cost.

Licensed electricians will be able to sign up for NG Connects by going to the Company's website at www.nationalgridus.com/connects or by filling out a mailer and returning it to the Company. A copy of the registration material for electricians is attached to this filing as Attachment 4. The qualifications for participation in NG Connects will be listed on the website and in the mailer. Licensing of electricians in Rhode Island is determined by the Department of Labor and Training in accordance with applicable law.

For customers whose electricians have not signed up for NG Connects, the Company will continue to make the permanent connection at no additional cost to the electrician or the customer.

The Company does not anticipate any change to its existing service quality as a result of NG Connects. NG Connects simply enables the Company to improve the efficiency and flexibility of its workforce by eliminating the need to make multiple trips to the same residence, which also benefits customers in several ways. It will allow the customer's licensed electrician more control over the timing of the work. A licensed electrician participating in NG Connects will no longer have to schedule an appointment with the Company to install the permanent connection. This will shorten the length of time the electrician will be at the customer's home and the length of the outage the customer experiences. Further, NG Connects should expedite the customer's service, since the electrician will now be able to complete the service upgrade in one setting.

In terms of safety, the licensed electrician is exposed to no additional electric risk when making the permanent connection, as the voltage at the connection point is the same as at other locations on the customer's service equipment. Further, once the electrician completes his/her work, it must be inspected by an electrical inspector in accordance with Rhode Island law. This is the same inspection process as when the Company makes the final connection, except that under NG Connects, the licensed electrician makes the final connection. When the Company receives the inspection notification, a meter services representative will visually inspect the connection and seal the meter. The Company's general inspection protocol is further described in § 1.9 of the Company's Specifications for Electrical Installations booklet, which is also available on the Company's website at (https://www.nationalgridus.com/non_html/shared_constr_esb750.pdf). A copy of this booklet is also being provided as Attachment 5.

The Company will inform licensed electricians of the qualifications necessary to participate in NG Connects via the website and mailers discussed above. In addition, NG Connects is described in § 4.2.6 of the Company's Specifications for Electrical Installations booklet provided in Attachment 5. Currently, NG Connects is limited to residential services, though the Company may decide, in the future, to expand the program to cover non-residential services. In such event, the Company will update its Electrical Installations booklet and notify the Commission accordingly.

Thank you for your attention to this transmittal. If you have any questions, please feel free to contact me at (781) 907-2121.

Very truly yours,

A handwritten signature in dark ink, appearing to read "Jennifer Brooks Hutchinson", with a stylized flourish at the end.

Jennifer Brooks Hutchinson

Enclosures

cc: Leo Wold, Esq.
Steve Scialabba, Division

National Grid

The Narragansett Electric Company

National Grid Connects Program

September 2010

Submitted to:
Rhode Island Public Utilities Commission
R.I.P.U.C. Docket No. 4200

Submitted by:

nationalgrid

Attachments

Attachment 1	Terms and Conditions for Distribution Service – Marked to Show Changes
Attachment 2	Terms and Conditions for Distribution Service – Clean
Attachment 3	Draft Public Notice
Attachment 4	National Grid Connects Registration for Licensed Electricians
Attachment 5	Specifications for Electrical Installations Booklet, ESB 750

Attachment 1

Terms and Conditions for Distribution Service – Marked to Show Changes

R.I.P.U.C. No. ~~2022~~-A2040

Sheet 1

Canceling R.I.P.U.C. No. ~~4497~~2022-A

THE NARRAGANSETT ELECTRIC COMPANY

TERMS AND CONDITIONS FOR DISTRIBUTION SERVICE

The following Terms and Conditions where not inconsistent with the rates are a part of all rates. The provisions of these Terms and Conditions apply to all persons, partnerships, corporations or others (the Customer) who obtain local distribution service from The Narragansett Electric Company (the Company) and to companies that are nonregulated power producers, as defined in Rhode Island General Laws. All policies, standards, specifications, and documents referred to herein have been filed with the Rhode Island Public Utilities Commission (Commission) and Division, and such documents and any revisions have been filed at least 30 days before becoming effective. Compliance by the Customer and nonregulated power producer is a condition precedent to the initial and continuing delivery of electricity by the Company.

Service Connection

1. The Company shall furnish on request detailed information on the method and manner of making service connections. Such detailed information may include a copy of the Company's Specifications for Electrical Installations booklet, as may be amended from time to time, a description of the service available, connections necessary between the Company's facilities and the Customer's premises, location and access of service connection facilities and metering equipment, and Customer and Company responsibilities for installation of facilities.

The Customer shall wire to the point designated by the Company, at which point the Company will connect its facilities. In addition, the Customer's facilities shall comply with any reasonable construction and equipment standards required by the Company for safe, reliable, and cost efficient service. For a service meeting Company requirements (which requirements are set forth on the Company's website at www.nationalgridus.connects), the Company may also permit this connection to be made by a licensed electrician in good standing with the authority having jurisdiction, as required by applicable law, and who is registered with the Company, provided, however, that the Company gives no warranty to the Customer, express or implied, as to the knowledge, training, reliability, honesty, fitness, or performance of any electrician registered with the Company for this purpose, and the Company shall not be liable for any damages or injuries caused by any electrician who may be used for such purpose.

Application for Service

2. Application for new service or alteration to an existing service should be made as far in advance as possible to assure time for engineering, ordering of material, and construction. Upon the Company's reasonable request, the Customer shall provide to the Company all data and plans reasonably needed to process this application.

R.I.P.U.C. No. 2022-A2040

Sheet 2

Canceling R.I.P.U.C. No. 44972022-A

Line Extensions [Overhead (OH) & Underground (UG)]

3. The Company shall construct or install overhead or underground distribution facilities or other equipment determined by the Company to be appropriate under the following policies: Line Extension Policy for Residential Developments, Line Extension Policy for Individual Residential Customers, and Line Extension and Construction Advance Policy for Commercial, Industrial and Existing Residential Customers. Whenever it is necessary to provide service and a Customer requests the Company to extend or install poles, distribution lines or other service equipment to the Customer's home, premises or facility in order to supply service, the Company will furnish the necessary poles, wires, or equipment in accordance with the Company's "Line Extension and Construction Advance Policies" on file with the Commission. Except as provided in the "Policies", all such equipment, poles, and wires shall remain the property of the Company and be maintained by it in accordance with the "Policies". To the extent that any Company property needs to be located on private property, the Company will require the Customer to furnish a permanent easement.

Attachments

4. Any individual or organization who requests an attachment to distribution facilities, utility poles, or along any span between such poles, shall comply with the Company's specifications and policies governing the type of construction, metering, attachment fees, easements, permissions and electrical inspections required.

Outside Basic Local Distribution Services

5. Customers requesting the Company to arrange for Customer facility outages or additional maintenance or construction not normally part of basic local distribution service will be notified in a reasonable timely manner by the Company that the customer shall be required to pay these the Company's costs of reasonably meeting the request.

Acquisition of Necessary Permits

6. The Company shall make, or cause to be made, application for any necessary street permits, and shall not be required to supply service until a reasonable time after such permits are granted. The Customer shall obtain or cause to be obtained all permits or certificates, except street permits, necessary to give the Company or its agents' access to the Customer's equipment and to enable its conductors to be connected with the Customer's equipment.

Service to "Out-Building"

7. The Company shall not be required to install service or meter for a garage, barn or other out-building, so located that it may be supplied with electricity through a service and meter in the main building.

R.I.P.U.C. No. ~~2022-A~~2040

Sheet 3

Canceling R.I.P.U.C. No. ~~4497~~2022-A

Customer Furnished Equipment

8. The Customer shall furnish and install upon its premises such service conductors, service equipment, including circuit breaker if used, and meter mounting device as shall conform with specifications issued from time to time by the Company, and the Company will seal such service equipment and meter mounting device, and adjust, set and seal such circuit breaker, and such seals shall not be broken and such adjustments or settings shall not be changed or in any way interfered with by the Customer.

The Customer shall furnish and maintain, at no cost to the Company, the necessary space, housing, fencing, and foundations for all equipment that is installed on its premises in order to supply the Customer with local distribution service, whether such equipment is furnished by the Customer or the Company. Such space, housing, fencing, and foundations shall be in conformity with the Company's specifications and subject to its approval.

Up-Keep of Customer Equipment

9. The Customer's wiring, piping, apparatus and equipment shall, at all times, conform to the requirements of any legally constituted authorities and to those of the Company, and the Customer shall keep such wiring, piping, apparatus and equipment in proper repair.

Installation of Meters

10. Meters of either the indoor or outdoor type shall be installed by the Company at locations to be designated by the Company. The Company may at any time change any meter installed by it. The Company may also change the location of any meter or change from an indoor type to an outdoor type, provided that the cost of the change shall be borne by the Company except when such change is pursuant to the provisions of Paragraph 11. Upon the reading of the Company's meter all bills shall be computed. If more than one meter is installed, unless it is installed at the Company's option, the monthly charge for local distribution service delivered through each meter shall be computed separately under the applicable rates.

Unauthorized and Unmetered Use

11. Whenever the Company determines that an unauthorized and unmetered use of electricity is being made on the premises of a Customer and is causing a loss of revenue to the Company, the Company may, at the Customer's expense, make such changes in the location of its meters, appliance and equipment on said premises as will, in the opinion of the Company, prevent such unauthorized and unmetered use from being made.

Definition of Month

12. Whenever reference is made to "month" in connection with electricity delivered or payments to be made, it shall mean the period between two successive regular monthly meter readings or

R.I.P.U.C. No. ~~2022-A~~2040

Sheet 4

Canceling R.I.P.U.C. No. ~~4197~~2022-A

estimated meter readings, the second of which occurs in the month to which reference is made. If the Company is unable to read the meter when scheduled, the necessary billing determinants may be estimated. Bills may be rendered on such estimated basis and will be payable as so rendered.

Payment Due Date -- Interest Charge

13. All bills shall be due and payable upon receipt. Bills rendered to customers, other than individually metered residential customers, on which payment has not been received by the "Avoid Interest Date" as shown on the bill, shall bear interest, at the rate of 1¼% per month on any unpaid balance, including any outstanding interest charges, from the date of receipt until the date of payment. The "Avoid Interest Date" corresponds to the next normal bill preparation date. Bills disputed in good faith by a Customer will not be subject to the late payment charge until after the dispute is resolved.

Customer payment responsibilities with their nonregulated power producer will be governed by the particular Customer/nonregulated power producer contract. Payments made through the Company for electricity purchased from a nonregulated power supplier will be applied first to any Narragansett charges or arrearages.

Returned Check Fee

14. A \$15.00 Fee shall be charged to the Customer for each check presented to the Company that is not honored by the financial institution. This fee shall be applicable only where the check has been dishonored after being deposited for a second time.

Seasonal Customers

15. Seasonal Customers are those using local distribution services between June 1st and September 30th only, or those using local distribution services principally between June 1st and September 30th and incidentally or intermittently during the rest of the year.

Deposit and Security

16. The Company may require a cash deposit or other collateral satisfactory to it as security for prompt payment of the Customer's indebtedness to the Company. The rate of interest shall be adjusted on March 1st annually. The interest rate in effect in any year shall be based on the average rate over the prior calendar year for 10-year constant maturity Treasury Bonds as reported by the Federal Reserve Board.

Payments for Line Extensions

17. The Company may require a Customer to pay for all or a portion of the cost of extending or installing poles, distribution lines, or equipment to the Customer's home, premises or facility, consistent with the terms of the Company's "Line Extension and Construction Advance Policies"

R.I.P.U.C. No. ~~2022-A~~2040
Sheet 5
Canceling R.I.P.U.C. No. ~~4497~~2022-A

on file with the Commission.

Lighting Service Charge

18. The Company may assess a Lighting Service Charge of \$130.00 for Company services rendered in response to a Customer request in support of Customer equipment where the condition, service or connection is unrelated to the performance of facilities owned by the Company. A Lighting Service Charge per each occurrence will be assessed to the Customer on their subsequent bill.

Determining Customer's Demand

19. The demand is the maximum rate of taking electricity. Under ordinary load conditions it will be based upon one or more fifteen-minute peaks as herein defined. A fifteen-minute peak is the average rate of delivery of electricity during any fifteen-minute period as determined by any suitable instrument chosen by the Company. In the case of extremely fluctuating load, however, where the demand based on the average over fifteen minutes does not fairly represent the maximum demand imposed by the Customer, the demand will be based upon the instantaneous peak or the peak for a shorter period than fifteen minutes. Such measurements will be made by any suitable instrument chosen by the Company. The demand which is billed to the Customer is determined according to the terms of the appropriate tariffs approved by the PUC from time to time.

Customer Changing Rates

20. The Customer may change from the rate under which he is purchasing electricity to any other rate applicable to a class of service which he is receiving. Any change, however, shall not be retroactive, nor reduce, eliminate or modify any contract period, provision or guarantee made in respect to any line extension or other special condition. Nor shall such change cause such service to be billed at any rate for a period less than that specified in such rate except during the first year of electric service to any Customer. A Customer having changed from one rate to another may not again change within twelve months or within any longer contract period specified in the rate under which he is receiving electric service.

Discontinuance of Service

21. Subject to the Rules and Regulations of the Commission, the Company shall have the right to discontinue its service upon due notice and to remove its property from the premises in case the Customer fails to pay any bill due the Company for such service, or fails to perform any of its obligations to the Company. For restoration of service after such discontinuance, a reconnection charge of \$38.00 will be made.

Right of Access

22. The Company shall have the right of access to the Customer's premises at all reasonable

R.I.P.U.C. No. ~~2022-A~~2040

Sheet 6

Canceling R.I.P.U.C. No. ~~4497~~2022-A

times for the purpose of examining or removing the Company's meters, and other appliances and equipment. During emergency conditions, the Company shall have the right of access to the Customer's premises at all hours of the day to make conditions safe and/or to restore service.

Safeguarding Company Equipment

23. The Customer shall not permit access for any purpose whatsoever, except by authorized employees of the Company, to the meter or other appliances and equipment of the Company, or interfere with the same, and shall provide for their safe keeping. In case of loss or damage of the Company's property, the Customer shall pay to the Company the value of such property or the cost of making good the same.

Temporary Service

24. A temporary connection is local distribution service which does not continue for a sufficient period to yield the Company adequate revenue at its regular local distribution service rates to justify the expenditures necessary to provide such a connection. The Company may require a Customer requesting a temporary connection to pay the full amount of the estimated cost of installing and removing the requested connection, less estimated salvage value, in advance of the installation of the connection by the Company. In addition, the customer shall pay the applicable regular local distribution service and, if applicable, basic or standard offer service rates.

Limitation of Liability for Service Problems

25. The Company shall not be liable for any damage to equipment or facilities using electricity which damage is a result of Service Problems, or any economic losses which are a consequence of Service Problems. For purposes of this paragraph, the term "Service Problems" means any service interruption, power outage, voltage or amperage, fluctuations, discontinuance of service, reversal of its service, or irregular service caused by accident, labor difficulties, condition of fuel supply or equipment, federal or state agency order, failure to receive any electricity for which the Company has contracted, or any other causes beyond the Company's immediate control.

However, if the Company is unable for any reason to supply electricity for a continuous period of two days or more, then upon the request of the Customer, the Demand Charge, if any, shall be suspended for the duration of such inability.

The Company shall not be liable for damage to the person or property of the Customer or any other persons resulting from the use of electricity or the presence of the Company's appliances and equipment on the Customer's premises.

Limitation on Use of Electricity - Auxiliary & Temporary Local Distribution Service

26. Local distribution service supplied by the Company shall not be used to supplement or relay, or as standby or back up to any other electrical source or service except under the provisions of the Back-Up Service Rate, unless the Customer shall makes such guarantees with respect to the

R.I.P.U.C. No. ~~2022-A~~2040

Sheet 7

Canceling R.I.P.U.C. No. ~~4497~~2022-A

payment for such local distribution service as shall be just and reasonable in each case. Where such local distribution service is supplied, the Customer shall not operate its generation in parallel with the Company's system without the consent of the Company, and then only under such conditions as the Company may specify from time to time.

Company Right to Place Facilities on Customer Property

27. The Company has the right to place on a Customer's property facilities to provide and meter electric service to the Customer.

Company Right to Request a Guarantee

28. Whenever the estimated expenditures for the services or equipment necessary to deliver electricity to a Customer's premises shall be of such an amount that the income to be derived therefrom at the applicable rates will, in the opinion of the Company, be insufficient to warrant such expenditures, the Company may require a Customer to guarantee a minimum annual payment or commitment for a term of years, or to pay the whole or a part of the cost of such equipment.

Fluctuating Load & Harmonic Distortion

29. In certain instances, extreme fluctuating loads or harmonic distortions which are created by a Customer's machinery or equipment may impair service to other Customers. If the fluctuating load or harmonic distortion causes a deterioration of the Company's service to other customers, the Company shall specify a service arrangement that avoids the deterioration and the Customer owning or operating the equipment that causes the fluctuation or distortion shall pay the cost to implement the new service arrangement together with applicable taxes.

Customer Tax Liability

30. The Company shall collect taxes imposed by governmental authorities on services provided or products sold by the Company. It shall be the Customer's responsibility to identify and request any exemption from the collection of the tax by filing appropriate documentation with the Company.

Customer/Supplier Relationship

31. For electricity supplied by nonregulated power producers, the Company is a local distribution service provider of electricity supplied by others. When such electricity is supplied and delivered to the Company's local distribution supply point, the Company then performs a delivery service for the electricity. Ownership of such electricity lies with either the non-regulated power producer or Customer, as per the specific agreement between the Customer and the nonregulated power producer. In no case shall the Company be liable for loss of electricity.

R.I.P.U.C. No. 2022-A2040

Sheet 8

Canceling R.I.P.U.C. No. 41972022-A

Customer Notice and Right to Appeal

32. Where practicable, the Company will give the Customer reasonable notice of actions taken pursuant to these Terms & Conditions. The Customer shall have the right to appeal, pursuant to the Division's Rules of Practice and Procedure, all action taken by the Company hereunder.

Effective: October 15, 2010 ~~March 1, 2010~~

Attachment 2

Terms and Conditions for Distribution Service – Clean

R.I.P.U.C. No. 2040
Sheet 1
Canceling R.I.P.U.C. No. 2022-A

THE NARRAGANSETT ELECTRIC COMPANY

TERMS AND CONDITIONS FOR DISTRIBUTION SERVICE

The following Terms and Conditions where not inconsistent with the rates are a part of all rates. The provisions of these Terms and Conditions apply to all persons, partnerships, corporations or others (the Customer) who obtain local distribution service from The Narragansett Electric Company (the Company) and to companies that are nonregulated power producers, as defined in Rhode Island General Laws. All policies, standards, specifications, and documents referred to herein have been filed with the Rhode Island Public Utilities Commission (Commission) and Division, and such documents and any revisions have been filed at least 30 days before becoming effective. Compliance by the Customer and nonregulated power producer is a condition precedent to the initial and continuing delivery of electricity by the Company.

Service Connection

1. The Company shall furnish on request detailed information on the method and manner of making service connections. Such detailed information may include a copy of the Company's Specifications for Electrical Installations booklet, as may be amended from time to time, a description of the service available, connections necessary between the Company's facilities and the Customer's premises, location and access of service connection facilities and metering equipment, and Customer and Company responsibilities for installation of facilities.

The Customer shall wire to the point designated by the Company, at which point the Company will connect its facilities. In addition, the Customer's facilities shall comply with any reasonable construction and equipment standards required by the Company for safe, reliable, and cost efficient service. For a service meeting Company requirements (which requirements are set forth on the Company's website at www.nationalgridus.connects), the Company may also permit this connection to be made by a licensed electrician in good standing with the authority having jurisdiction, as required by applicable law, and who is registered with the Company, provided, however, that the Company gives no warranty to the Customer, express or implied, as to the knowledge, training, reliability, honesty, fitness, or performance of any electrician registered with the Company for this purpose, and the Company shall not be liable for any damages or injuries caused by any electrician who may be used for such purpose.

Application for Service

2. Application for new service or alteration to an existing service should be made as far in advance as possible to assure time for engineering, ordering of material, and construction. Upon the Company's reasonable request, the Customer shall provide to the Company all data and plans reasonably needed to process this application.

R.I.P.U.C. No. 2040
Sheet 2
Canceling R.I.P.U.C. No. 2022-A

Line Extensions [Overhead (OH) & Underground (UG)]

3. The Company shall construct or install overhead or underground distribution facilities or other equipment determined by the Company to be appropriate under the following policies: Line Extension Policy for Residential Developments, Line Extension Policy for Individual Residential Customers, and Line Extension and Construction Advance Policy for Commercial, Industrial and Existing Residential Customers. Whenever it is necessary to provide service and a Customer requests the Company to extend or install poles, distribution lines or other service equipment to the Customer's home, premises or facility in order to supply service, the Company will furnish the necessary poles, wires, or equipment in accordance with the Company's "Line Extension and Construction Advance Policies" on file with the Commission. Except as provided in the "Policies", all such equipment, poles, and wires shall remain the property of the Company and be maintained by it in accordance with the "Policies". To the extent that any Company property needs to be located on private property, the Company will require the Customer to furnish a permanent easement.

Attachments

4. Any individual or organization who requests an attachment to distribution facilities, utility poles, or along any span between such poles, shall comply with the Company's specifications and policies governing the type of construction, metering, attachment fees, easements, permissions and electrical inspections required.

Outside Basic Local Distribution Services

5. Customers requesting the Company to arrange for Customer facility outages or additional maintenance or construction not normally part of basic local distribution service will be notified in a reasonable timely manner by the Company that the customer shall be required to pay these the Company's costs of reasonably meeting the request.

Acquisition of Necessary Permits

6. The Company shall make, or cause to be made, application for any necessary street permits, and shall not be required to supply service until a reasonable time after such permits are granted. The Customer shall obtain or cause to be obtained all permits or certificates, except street permits, necessary to give the Company or its agents' access to the Customer's equipment and to enable its conductors to be connected with the Customer's equipment.

Service to "Out-Building"

7. The Company shall not be required to install service or meter for a garage, barn or other out-building, so located that it may be supplied with electricity through a service and meter in the main building.

R.I.P.U.C. No. 2040
Sheet 3
Canceling R.I.P.U.C. No. 2022-A

Customer Furnished Equipment

8. The Customer shall furnish and install upon its premises such service conductors, service equipment, including circuit breaker if used, and meter mounting device as shall conform with specifications issued from time to time by the Company, and the Company will seal such service equipment and meter mounting device, and adjust, set and seal such circuit breaker, and such seals shall not be broken and such adjustments or settings shall not be changed or in any way interfered with by the Customer.

The Customer shall furnish and maintain, at no cost to the Company, the necessary space, housing, fencing, and foundations for all equipment that is installed on its premises in order to supply the Customer with local distribution service, whether such equipment is furnished by the Customer or the Company. Such space, housing, fencing, and foundations shall be in conformity with the Company's specifications and subject to its approval.

Up-Keep of Customer Equipment

9. The Customer's wiring, piping, apparatus and equipment shall, at all times, conform to the requirements of any legally constituted authorities and to those of the Company, and the Customer shall keep such wiring, piping, apparatus and equipment in proper repair.

Installation of Meters

10. Meters of either the indoor or outdoor type shall be installed by the Company at locations to be designated by the Company. The Company may at any time change any meter installed by it. The Company may also change the location of any meter or change from an indoor type to an outdoor type, provided that the cost of the change shall be borne by the Company except when such change is pursuant to the provisions of Paragraph 11. Upon the reading of the Company's meter all bills shall be computed. If more than one meter is installed, unless it is installed at the Company's option, the monthly charge for local distribution service delivered through each meter shall be computed separately under the applicable rates.

Unauthorized and Unmetered Use

11. Whenever the Company determines that an unauthorized and unmetered use of electricity is being made on the premises of a Customer and is causing a loss of revenue to the Company, the Company may, at the Customer's expense, make such changes in the location of its meters, appliance and equipment on said premises as will, in the opinion of the Company, prevent such unauthorized and unmetered use from being made.

Definition of Month

12. Whenever reference is made to "month" in connection with electricity delivered or payments to be made, it shall mean the period between two successive regular monthly meter readings or estimated meter readings, the second of which occurs in the month to which reference is made.

R.I.P.U.C. No. 2040
Sheet 4
Canceling R.I.P.U.C. No. 2022-A

If the Company is unable to read the meter when scheduled, the necessary billing determinants may be estimated. Bills may be rendered on such estimated basis and will be payable as so rendered.

Payment Due Date -- Interest Charge

13. All bills shall be due and payable upon receipt. Bills rendered to customers, other than individually metered residential customers, on which payment has not been received by the "Avoid Interest Date" as shown on the bill, shall bear interest, at the rate of 1¼% per month on any unpaid balance, including any outstanding interest charges, from the date of receipt until the date of payment. The "Avoid Interest Date" corresponds to the next normal bill preparation date. Bills disputed in good faith by a Customer will not be subject to the late payment charge until after the dispute is resolved.

Customer payment responsibilities with their nonregulated power producer will be governed by the particular Customer/nonregulated power producer contract. Payments made through the Company for electricity purchased from a nonregulated power supplier will be applied first to any Narragansett charges or arrearages.

Returned Check Fee

14. A \$15.00 Fee shall be charged to the Customer for each check presented to the Company that is not honored by the financial institution. This fee shall be applicable only where the check has been dishonored after being deposited for a second time.

Seasonal Customers

15. Seasonal Customers are those using local distribution services between June 1st and September 30th only, or those using local distribution services principally between June 1st and September 30th and incidentally or intermittently during the rest of the year.

Deposit and Security

16. The Company may require a cash deposit or other collateral satisfactory to it as security for prompt payment of the Customer's indebtedness to the Company. The rate of interest shall be adjusted on March 1st annually. The interest rate in effect in any year shall be based on the average rate over the prior calendar year for 10-year constant maturity Treasury Bonds as reported by the Federal Reserve Board.

Payments for Line Extensions

17. The Company may require a Customer to pay for all or a portion of the cost of extending or installing poles, distribution lines, or equipment to the Customer's home, premises or facility, consistent with the terms of the Company's "Line Extension and Construction Advance Policies" on file with the Commission.

R.I.P.U.C. No. 2040
Sheet 5
Canceling R.I.P.U.C. No. 2022-A

Lighting Service Charge

18. The Company may assess a Lighting Service Charge of \$130.00 for Company services rendered in response to a Customer request in support of Customer equipment where the condition, service or connection is unrelated to the performance of facilities owned by the Company. A Lighting Service Charge per each occurrence will be assessed to the Customer on their subsequent bill.

Determining Customer's Demand

19. The demand is the maximum rate of taking electricity. Under ordinary load conditions it will be based upon one or more fifteen-minute peaks as herein defined. A fifteen-minute peak is the average rate of delivery of electricity during any fifteen-minute period as determined by any suitable instrument chosen by the Company. In the case of extremely fluctuating load, however, where the demand based on the average over fifteen minutes does not fairly represent the maximum demand imposed by the Customer, the demand will be based upon the instantaneous peak or the peak for a shorter period than fifteen minutes. Such measurements will be made by any suitable instrument chosen by the Company. The demand which is billed to the Customer is determined according to the terms of the appropriate tariffs approved by the PUC from time to time.

Customer Changing Rates

20. The Customer may change from the rate under which he is purchasing electricity to any other rate applicable to a class of service which he is receiving. Any change, however, shall not be retroactive, nor reduce, eliminate or modify any contract period, provision or guarantee made in respect to any line extension or other special condition. Nor shall such change cause such service to be billed at any rate for a period less than that specified in such rate except during the first year of electric service to any Customer. A Customer having changed from one rate to another may not again change within twelve months or within any longer contract period specified in the rate under which he is receiving electric service.

Discontinuance of Service

21. Subject to the Rules and Regulations of the Commission, the Company shall have the right to discontinue its service upon due notice and to remove its property from the premises in case the Customer fails to pay any bill due the Company for such service, or fails to perform any of its obligations to the Company. For restoration of service after such discontinuance, a reconnection charge of \$38.00 will be made.

Right of Access

22. The Company shall have the right of access to the Customer's premises at all reasonable times for the purpose of examining or removing the Company's meters, and other appliances and equipment. During emergency conditions, the Company shall have the right of access to the

R.I.P.U.C. No. 2040
Sheet 6
Canceling R.I.P.U.C. No. 2022-A

Customer's premises at all hours of the day to make conditions safe and/or to restore service.

Safeguarding Company Equipment

23. The Customer shall not permit access for any purpose whatsoever, except by authorized employees of the Company, to the meter or other appliances and equipment of the Company, or interfere with the same, and shall provide for their safe keeping. In case of loss or damage of the Company's property, the Customer shall pay to the Company the value of such property or the cost of making good the same.

Temporary Service

24. A temporary connection is local distribution service which does not continue for a sufficient period to yield the Company adequate revenue at its regular local distribution service rates to justify the expenditures necessary to provide such a connection. The Company may require a Customer requesting a temporary connection to pay the full amount of the estimated cost of installing and removing the requested connection, less estimated salvage value, in advance of the installation of the connection by the Company. In addition, the customer shall pay the applicable regular local distribution service and, if applicable, basic or standard offer service rates.

Limitation of Liability for Service Problems

25. The Company shall not be liable for any damage to equipment or facilities using electricity which damage is a result of Service Problems, or any economic losses which are a consequence of Service Problems. For purposes of this paragraph, the term "Service Problems" means any service interruption, power outage, voltage or amperage, fluctuations, discontinuance of service, reversal of its service, or irregular service caused by accident, labor difficulties, condition of fuel supply or equipment, federal or state agency order, failure to receive any electricity for which the Company has contracted, or any other causes beyond the Company's immediate control.

However, if the Company is unable for any reason to supply electricity for a continuous period of two days or more, then upon the request of the Customer, the Demand Charge, if any, shall be suspended for the duration of such inability.

The Company shall not be liable for damage to the person or property of the Customer or any other persons resulting from the use of electricity or the presence of the Company's appliances and equipment on the Customer's premises.

Limitation on Use of Electricity - Auxiliary & Temporary Local Distribution Service

26. Local distribution service supplied by the Company shall not be used to supplement or relay, or as standby or back up to any other electrical source or service except under the provisions of the Back-Up Service Rate, unless the Customer shall makes such guarantees with respect to the payment for such local distribution service as shall be just and reasonable in each case. Where such local distribution service is supplied, the Customer shall not operate its generation in

R.I.P.U.C. No. 2040
Sheet 7
Canceling R.I.P.U.C. No. 2022-A

parallel with the Company's system without the consent of the Company, and then only under such conditions as the Company may specify from time to time.

Company Right to Place Facilities on Customer Property

27. The Company has the right to place on a Customer's property facilities to provide and meter electric service to the Customer.

Company Right to Request a Guarantee

28. Whenever the estimated expenditures for the services or equipment necessary to deliver electricity to a Customer's premises shall be of such an amount that the income to be derived therefrom at the applicable rates will, in the opinion of the Company, be insufficient to warrant such expenditures, the Company may require a Customer to guarantee a minimum annual payment or commitment for a term of years, or to pay the whole or a part of the cost of such equipment.

Fluctuating Load & Harmonic Distortion

29. In certain instances, extreme fluctuating loads or harmonic distortions which are created by a Customer's machinery or equipment may impair service to other Customers. If the fluctuating load or harmonic distortion causes a deterioration of the Company's service to other customers, the Company shall specify a service arrangement that avoids the deterioration and the Customer owning or operating the equipment that causes the fluctuation or distortion shall pay the cost to implement the new service arrangement together with applicable taxes.

Customer Tax Liability

30. The Company shall collect taxes imposed by governmental authorities on services provided or products sold by the Company. It shall be the Customer's responsibility to identify and request any exemption from the collection of the tax by filing appropriate documentation with the Company.

Customer/Supplier Relationship

31. For electricity supplied by nonregulated power producers, the Company is a local distribution service provider of electricity supplied by others. When such electricity is supplied and delivered to the Company's local distribution supply point, the Company then performs a delivery service for the electricity. Ownership of such electricity lies with either the non-regulated power producer or Customer, as per the specific agreement between the Customer and the nonregulated power producer. In no case shall the Company be liable for loss of electricity.

Customer Notice and Right to Appeal

32. Where practicable, the Company will give the Customer reasonable notice of actions taken

R.I.P.U.C. No. 2040
Sheet 8
Canceling R.I.P.U.C. No. 2022-A

pursuant to these Terms & Conditions. The Customer shall have the right to appeal, pursuant to the Division's Rules of Practice and Procedure, all action taken by the Company hereunder.

Effective: October 15, 2010

Attachment 3

Draft Public Notice

DRAFT

Pursuant to Rhode Island General Laws §39-3-11 and Rule 1.9(c) of the Rules of Practice and Procedure of the Rhode Island Public Utilities Commission (“Commission”), The Narragansett Electric Company, d/b/a National Grid (“Company”), hereby gives notice that on September __, 2010, the Company filed by Tariff Advice a request to approve the Company’s electric tariff entitled Terms and Conditions for Distribution Service, R.I.P.U.C. No. 2040 to become effective October 15, 2010. This tariff would supersede the Company’s Terms and Conditions for Distribution Service, R.I.P.U.C. No.2022-A.

Specifically, the Company is proposing to amend Section 1, Service Connection, to clarify who can make the final connection between the customer’s facilities and the Company’s facilities as part of the operation of the National Grid Connects Program (“NG Connects”). NG Connects is a new program the Company has implemented in Rhode Island for the convenience and benefit of its residential customers. NG Connects allows a licensed electrician who is registered with the Company to make the permanent overhead connection between the Company’s service drop cable and the customer’s service entrance cable. Customers will not incur any additional cost from the Company as a result of his/her electrician’s participation in NG Connects.

A detailed description of NG Connects, the proposed tariff changes and supporting documentation are included in the Company’s application, which is on file for examination at the offices of the Public Utilities Commission, 89 Jefferson Boulevard, Warwick, Rhode Island. The Commission is accessible to the handicapped. Individuals requesting interpreter services for the hearing impaired must contact the Clerk of the Commission seventy-two hours in advance of the hearing.

National Grid

Attachment 4

National Grid Connects Registration for Licensed Electricians

National Grid Connects - Registration



Rhode Island-Electric

[Home](#)

[Outage Central](#)

[About Us](#)

[Safety](#)

[Your Account](#)

[For Your Home](#)



National Grid Connects - Registration

(● = required information)

Company Information

● Company Name:

Company Address:

● Address1:

Address2:

● City:

● State: [Choose a State](#)

● Zip:

Shipping Address: ☐ Same as Company Address

● Address1:

Address2:

● City:

● State: [Choose a State](#)

● Zip:

Email:

Web Site:

National Grid Connects - Registration

Hours of Business (hh:mm): AM PM

Electrician Information

Prefix: **Select**

• First Name:

• Last Name:

Suffix: **Select**

Email:

Phone Number: All Phone numbers should be in xxx-xxx-xxxx format

Cell:

Home:

Home Fax:

Office:

Office Fax:

	License State/City	License Number
1	<input type="text"/>	<input type="text"/>
2	<input type="text"/>	<input type="text"/>
3	<input type="text"/>	<input type="text"/>
4	<input type="text"/>	<input type="text"/>
5	<input type="text"/>	<input type="text"/>

Add Additional License

Cancel

Submit


Submit & Add Additional Electricians

Attachment 5

Specifications for Electrical Installations Booklet, ESB 750

Specifications for Electrical Installations 2010

Covering National Grid's Service Areas in
MA, NH, NY, and RI

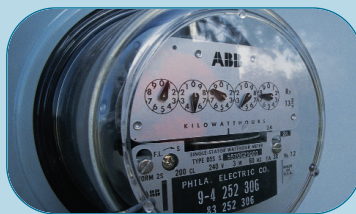

nationalgrid

The power of action.™

Our assistance is just a phone call away.

Help is as close as your phone. Call our local National Grid office for useful information and assistance whenever you have questions on information in this booklet.

While you're planning electrical and mechanical systems for your next project, our representatives will work closely with you and your clients.

We'll provide detailed analysis or supplemental data on all types of electrical installations.

We'll give you valuable aid before final plans are made on heating, cooling, wiring and lighting. And most important, we will suggest ways to conserve energy.

A call to National Grid will help you help yourself. Call today.

Available 24 hours a day, every day

	New York	Massachusetts	New Hampshire	Rhode Island
Customer Service Center	1-800-642-4272 24 hours/7 days	1-800-322-3223 Mon-Fri 7:00a.m. - 7:00p.m. Saturday 7:00a.m. - 5:00p.m.		
Fax	1-315-460-9270 (for new service applications only)	1-508-357-4730		
Mail Address	National Grid Customer Service Center 300 Erie Boulevard W. Syracuse, NY 13202-4250	National Grid Customer Service Center PO Box 960 Northborough, MA 01532-0960		
Non-English Speaking Customers Para clientes que hablan Espanol	1-800-561-6672	1-800-322-3223		
Hearing/Speech-Impaired Customers	711			
Specialized Commercial & Industrial Business Group	1-800-664-6729 Mon-Fri 8:00a.m.-5:00p.m.	Not Applicable		
Emergency Numbers - does not replace 911 emergency medical services				
Life-Threatening Electric Emergency	1-800-892-2345	1-800-465-1212		
Life-Threatening Gas Emergency		1-800-233-5325	1-800-640-1595	
Power Outages	1-800-867-5222 Automated OnCall SM	1-800-465-1212		
New Construction & Service Upgrades To initiate a request for new or upgraded electric service				
By Phone	1-800-642-4272 24 hours/7 days	1-800-375-7405 Mon-Fri 8:00a.m.-4:30p.m.		
Contractor Service	1-800-664-6729 Mon-Fri 8:00a.m.-5:00p.m.	Not Applicable		
By Fax	1-800-882-0322 Using Electric Service Request Form	1-888-266-8094		
Online by Internet	www.nationalgridus.com Then, select the appropriate state. Go to the section "For Technical and Construction Professionals"			
For assistance with pending electric service requests, contact Customer Order Fullfillment	1-800-260-0054			
For electric inspectors, to release a municipal wiring inspection	1-888-932-0301 24 hr.automated system only for single meter service requests	1-800-375-7405 Mon-Fri 8:00a.m.-4:30p.m. (24 hr. automated system forthcoming in mid-2010 only for single meter service requests)		
New Residential or Commercial Developments - To e-mail AutoCAD or MicroStation drawings	OrderFulfillment@us.ngrid.com			
Dig Safe Requests	1-800-962-7962 Dig Safely NY	1-888-DIGSAFE (1-888-344-7233) Dig Safe System Inc.		
	811 is the nation wide number; see http://www.call811.com/state-specific.aspx			
Hazard Identification Hotline When working near power lines or high voltage lines	1-800-642-4272	1-888-625-3723		

Also, check the following Web site for this and other National Grid information: <https://www.nationalgridus.com>

Specifications for Electrical Installations

2010

Covering National Grid's Service Areas in
MA, NH, NY, and RI



PREFACE

This April 2010 edition of the Specifications for Electrical Installations is effective as of June 2010. These specifications consolidate and replace both the “Electric System Bulletin No. 750” and “Information and Requirements for Electric Service—Green Book” and are in effect for the following National Grid companies:

Granite State Electric Company

Massachusetts Electric Company

Nantucket Electric Company

The Narragansett Electric Company

Niagara Mohawk Power Corporation

These specifications, which protect the mutual interests of the Customer and Company, may be revised or amended from time to time in keeping with developments and progress of the industry. For the latest official version of this document please visit the Company’s web site address at: **<http://www.nationalgridus.com/electricalspecifications>**. Printed copies of these specifications are not document controlled and may be obtained from the Company by contacting the applicable Customer Service Center in Massachusetts for New England or Upstate New York. Therefore, the on-line version will always prevail over any uncontrolled printed documents.

Where referenced in tariffs by the National Grid companies, this new edition is synonymous with the designations as “ESB 750 Book” or “Information and Requirements Book” and meets the same requirements.

TABLE OF CONTENTS

PREFACE	1
TABLE OF CONTENTS	2
PROCESS AND INFORMATION	9
<i>Obtaining Electric Service</i>	9
<i>Electric Service Areas</i>	11
National Grid in Massachusetts:	11
National Grid in New Hampshire:	13
National Grid in Upstate New York:	14
National Grid in Rhode Island:	20
<i>Safety Information</i>	22
<i>Contacting the Company</i>	22
PART A – “GENERAL INFORMATION”	23
1.0 INTRODUCTION	23
1.1 PURPOSE	23
1.2 SCOPE	23
1.3 RATE SCHEDULE	23
1.4 COOPERATION AND TIME REQUIREMENTS	23
1.5 CODES, STANDARDS, AND REFERENCES	23
<i>Figure 1.5-1 – Illustration Utility Electric Supply and Premises Wiring</i>	24
1.5.1 References	25
1.5.2 Supplemental Company Specifications	25
1.6 REQUESTS FOR INFORMATION	26
1.7 CUSTOMER’S RESPONSIBILITY	26
1.7.1 All Customers	26
1.7.2 Customers served at voltages above 600 volts	26
1.8 COMPANY’S RESPONSIBILITIES	26
1.9 INSPECTION, WIRING ADEQUACY, AND ENFORCEMENT	27
1.10 DISCLAIMER	27
1.10.1 Company Approval	27
1.10.2 Use of Electricity	27
1.10.3 Condition of Service	27
1.10.4 Company Warranty Statement	28
1.11 ENFORCEMENT OF COMPANY REQUIREMENTS	28
1.11.1 Enforcement Criteria	28
1.11.2 Diversion of Electrical Energy	28
2.0 DEFINITIONS	29
<i>Figure 2-1: Typical Service Installation Diagram Below 600 volts – Excluding Network</i>	29
3.0 GENERAL SERVICE CONNECTION REQUIREMENTS	35
3.1 APPLICATION FOR SERVICE	35
3.1.1 Application	35
3.1.2 Public grants and special permits	35
3.1.3 Easements	35
3.2 NUMBER OF SERVICES	35
3.2.1 With Respect to Building and Premise	35
3.2.2 Electricity Delivered Through More Than One Meter	35
3.2.3 Multiple Service Requests	35
3.3 TEMPORARY SERVICE	36

3.3.1	Company Facilities	36
3.3.2	Location	36
3.3.3	Equipment	36
3.3.4	Duration	36
3.3.5	Cost	37
3.4	ACCESS	37
3.5	IDENTIFICATION OF EMPLOYEES	37
3.6	CHARACTER OF SERVICE	37
3.7	VOLTAGES AVAILABLE	37
3.7.1	Available Services	37
	<i>Table 3.7.1-1 - Available Services Below 600 volts</i>	37
3.7.2	New Customers (Applicants)	38
3.7.3	Existing Customers	38
3.7.3.1	Customer Expansion	38
3.7.3.2	Voltage Migration at Customer's Request	39
3.7.3.3	Voltage Migration at Company's Request	39
3.8	SERVICES NO LONGER STANDARD	39
3.9	LOAD BALANCE	39
3.10	INCREASE IN SERVICE	39
3.11	UNAUTHORIZED ATTACHMENTS	39
3.12	DISCONTINUANCE OF SERVICE	40
PART B – "ELECTRIC SERVICE REQUIREMENTS"		41
4.0	SERVICE CONNECTIONS.....	41
4.1	GENERAL	41
4.1.1	Rights-of-Way, Easements	41
4.1.2	Number, Routing and Location of Service Laterals or Service Lines.....	41
4.1.3	Relocation of Service Laterals	42
4.1.4	Allowable Voltage Drop	42
4.1.5	Minimum Size-Single Phase Service Connections	42
4.1.6	Service Conductor Splicing	42
4.1.7	Routing of Metered and Unmetered Conductors	42
4.1.8	Inhibiting Grease	43
4.1.9	Electric and Gas Meter Clearances	43
	<i>Figure 4.1.9-1 Electric Meter to Gas Meter Clearances</i>	43
4.1.10	Temporary Service.....	43
	<i>Figure 4.1.10-1 Typical Overhead Service Pole for Permanent or Temporary Service Below 600V</i>	44
	<i>Figure 4.1.10-2 Temporary Overhead Service Below 600 volts</i>	45
	<i>Figure 4.1.10-3 Temporary Underground Service Below 600 volts</i>	46
4.1.11	Fire Alarm and Emergency Systems	46
4.1.11.1	Fire Alarms	46
4.1.11.2	Emergency Systems	46
4.1.12	Service to Manufactured and Mobile Homes, Mobile Home Parks, and Recreational Vehicle Parks.....	47
4.1.12.1	Service to Manufactured and Mobile Homes and Mobile Home Parks	47
4.1.12.2	Service to Recreational Vehicle Parks.....	48
4.2	OVERHEAD SECONDARY VOLTAGE SERVICE CONNECTION (UNDER 600V).....	48
4.2.1	General	48
	<i>Figure 4.2.1-1 Typical Overhead Service Installation under 600V</i>	48
4.2.2	Service Attachment, Location	49
	<i>Figure 4.2.2-1 Typical Residential Overhead Service under 300 volts and 400 amperes</i>	49
4.2.3	Customer-owned Service Pole	50

4.2.4	Overhead Service Line Clearances	50
4.2.4.1	General Overhead Service Line Clearances	50
4.2.4.2	Clearances to Swimming Pools	51
4.2.4.3	Service to Low Buildings	51
	<i>Table 4.2.4.3-1 - Galvanized Riser Mast Bracing Requirements</i>	<i>52</i>
	<i>Figure 4.2.4.3-1 Overhead Service Attachment and Riser Mast Requirements</i>	<i>53</i>
4.2.5	Service Drop and Connection to Service Conductors	54
4.2.6	Residential Overhead Service Upgrade	54
4.3	OVERHEAD PRIMARY VOLTAGE SERVICE CONNECTION (2.4KV TO 46KV INCLUSIVE)	54
4.4	OVERHEAD TRANSMISSION VOLTAGE SERVICE CONNECTION	55
4.5	UNDERGROUND SECONDARY SERVICE VOLTAGE CONNECTION (UNDER 600V)	55
4.5.1	General	55
	<i>Figure 4.5.1-1 Typical Underground Service Installation under 600V</i> <i>(Excluding Network Services)</i>	<i>55</i>
4.5.2	Facilities in Shared Trench	56
4.5.3	Conduit System	56
4.5.4	Underground Secondary Service Connection from the Company's Overhead Distribution Supply	56
4.5.4.1	Customer-owned Underground Secondary Service Conductors	56
4.5.4.2	Company Riser Pole Attachments	57
	<i>Figure 4.5.4.2-1 Underground Secondary Service Riser Pole Detail</i>	<i>57</i>
4.5.5	Underground Secondary Service Connection from the Company's Underground Supply Lines	57
4.5.5.1	General	57
4.5.5.2	Radial fed underground secondary services	58
4.5.5.3	Network Areas and Underground Lines	58
4.5.6	Underground Residential Distribution (URD) Areas	59
	<i>Figure 4.5.6-1 Underground Residential Distribution (URD)</i>	<i>59</i>
	<i>Figure 4.5.6-2 Underground Secondary Service Residential Meter Connection –</i> <i>Conduit or Direct Buried</i>	<i>61</i>
4.5.7	Underground Secondary Service Connection	61
4.5.7.1	From a Company-owned Primary Underground Service Lateral	61
4.5.7.2	From an Outdoor Single Phase Pad Mounted Transformer	61
4.5.7.3	From an Outdoor Three Phase Pad Mounted Transformer	61
4.5.7.4	Service to Multiple Occupancy Buildings	61
	<i>Figure 4.5.7.4-1 Typical Service to Multiple Occupancy Building</i>	<i>62</i>
4.6	UNDERGROUND PRIMARY VOLTAGE SERVICE CONNECTION (FROM 2.4KV TO 35KV INCLUSIVE)	62
4.7	UNDERGROUND TRANSMISSION VOLTAGE SERVICE CONNECTION (ABOVE 15KV)	62
5.0	SERVICE EQUIPMENT	63
5.1	GENERAL	63
5.1.1	Service Equipment Required	63
5.1.2	Service Equipment Minimum Continuous Current Rating	63
5.1.3	Service Equipment Minimum Short Circuit Withstand Capability	63
5.1.4	Routing of Metered and Unmetered Conductors	63
5.1.5	Taps Ahead of Main Service Equipment	63
5.1.6	When Service Equipment Ahead of Metering is Required	63
5.1.7	Service Equipment on Service Poles, Pedestals, or Posts	64
5.1.8	Grouped Metered Services to Separate Buildings on One Premise	64
5.1.9	Service Equipment Arrangement	64
5.1.10	Service Equipment Minimum Attributes	65
5.1.10.1	Interrupting Rating	65

5.1.10.2	Inductive Heating	65
5.1.10.3	Metering Transformer Space	65
5.1.10.4	Bonding.....	65
5.1.10.5	Spare Fuses	65
5.1.10.6	Circuit Breaker	65
5.1.11	Instrumentation and Control Wiring	65
5.2	RESIDENTIAL	65
5.3	NETWORK SERVICE	65
5.3.1	General	65
5.4	RADIAL SERVICES	66
5.4.1	More than Six Service Disconnects	66
5.4.2	Radial Service, 300 amperes Continuous or Less Served at Less Than 600 volts	66
5.4.3	Radial Service, Above 300 amperes Continuous Served at Less Than 600 volts	66
5.5	INDIVIDUAL MULTIPLE OCCUPANCY BUILDING SERVICE.....	66
5.6	RADIAL LOADS SERVED ABOVE 600 VOLTS	67
6.0	GROUNDING.....	68
6.1	GENERAL	68
6.2	EQUIPMENT TO BE GROUNDED	68
6.3	GROUNDING METHODS.....	68
6.4	GROUNDING RESTRICTIONS.....	68
6.5	GROUND FAULT PROTECTION.....	68
7.0	METERING	69
7.1	GENERAL	69
7.1.1	Access	69
7.1.3	Working Clearances.....	69
7.1.3.1	Indoor Installations.....	69
7.1.3.2	Outdoor Installations	69
7.1.4	Physical Protection	69
7.1.5	Violations	70
7.1.6	Unmetered Wiring	70
7.1.7	Taps Ahead of Metering	70
7.1.8	Meter Relocation	70
7.1.9	Group Metering	70
7.1.10	Emergency System Metering	71
7.1.11	Shared Metering (for NY only)	71
7.2	METER APPLICATIONS AND REQUIREMENTS 600 VOLTS AND LESS	71
	<i>Table 7.2-1 Meter Socket and Transformer-rated Meter Applications</i>	<i>71</i>
	<i>Table 7.2-2 Self-contained Meter Socket Requirements.....</i>	<i>72</i>
	<i>Note: Meter Socket Minimum Short Circuit Withstand Capability</i>	<i>72</i>
	<i>Table 7.2-3 General Self-contained Meter Socket Installation</i>	
	<i>Responsibilities Checklist</i>	<i>73</i>
	<i>Table 7.2-4: 320A Meter Socket Applications</i>	<i>73</i>
7.3	SELF-CONTAINED METER SOCKET INSTALLATIONS	73
	<i>Figure 7.3-1 Typical Single Phase Residential or Commercial Meter Socket</i>	
	<i>Connections 120/240 Volt, 3 Wire, 200 Ampere Maximum Continuous Duty</i>	<i>74</i>
	<i>Figure 7.3-2 Typical Single Phase Residential URD Meter Socket Connection</i>	
	<i>120/240 Volt, 3 Wire, 200 Ampere Maximum Continuous Duty</i>	<i>75</i>
	<i>Figure 7.3-3 Typical Single Phase Residential or Commercial Meter Socket</i>	
	<i>Connections 120/240 Volt or 120/208 Volt or 277/480 Volt, 3 Wire, 320</i>	
	<i>Ampere Maximum Continuous Duty.....</i>	<i>76</i>
	<i>Figure 7.3-4 Typical Single Phase Residential or Commercial Meter Socket</i>	
	<i>Connections 120/208 Volt and 277/480 Volt, 3 Wire, 200 Ampere Maximum</i>	
	<i>Continuous Duty</i>	<i>77</i>

	Figure 7.3-5 Typical Three Phase Commercial Meter Socket Connections 208Y/120 Volt and 480Y/277 Volt, 4 Wire, 200 Ampere Maximum Continuous Duty	78
	Figure 7.3-6 Typical Three Phase Commercial Meter Socket Connections 208Y/120 Volt and 480Y/277 Volt, 4 Wire, 320 Ampere Maximum Continuous Duty	79
	Figure 7.3-7 Typical Single Phase Residential or Commercial 2-to-6 Ganged Meter Socket Connections 3 Wire, 120/240 Volt 150 Ampere and 120/208 Volt 100 Ampere, Maximum Continuous Duty per Position	80
	Figure 7.3-8 Typical Residential or Commercial Service Pedestal Single Phase Service 120/240 Volt 200 Amp and 120/208 Volt 100 Amp, 3 Wire	81
	Figure 7.3-9 Typical Residential or Commercial Meter Center (more than six meters) Single Phase and Three Phase Service 120/240 Volt 200 Amp and 120/208 Volt 100 Amp, 3 Wire and 208Y/120 Volt, 4 Wire	82
	Figure 7.3-10 Typical Mobile Home and Recreational Vehicle Park Meter Socket Applications	83
7.4	TRANSFORMER-RATED METERING 600 VOLTS AND LESS, 400 AMPS AND ABOVE	84
7.4.1	Instrument Transformers and Enclosures	84
	Figure 7.4.1-1 Typical Commercial CT Cabinet Secondary Metering Installation	85
	Figure 7.4.1-2 Typical Indoor Commercial Installation Two to Six Meter Service Entrance 800A Maximum From Overhead Line	86
	Figure 7.4.1-3 Typical Indoor Commercial Installation One Meter Service Entrance from Network or Radial Underground Line Three-Phase, 4 Wire, 208Y/120V, 400A..	87
	Figure 7.4.1-4 Typical Outdoor Service Pole Installation Single-Phase, 3 Wire, 120/240V for Loads 72 to 100kVA Demand or Three-Phase up to 800A From Overhead Line	88
7.4.2	Meter Sockets	89
7.4.3	Metering Sequence	89
7.4.4	Instrument Transformer Secondaries	89
7.4.5	Pad-mounted Transformer Service Metering	89
7.4.6	Metal-Enclosed Free-Standing Service Cubicles Rated 600 volts or Less (Secondary Voltage Installations)	89
7.4.6.1	General	89
7.4.6.2	Metering Sequence	89
	Figure 7.4.6.2-1: Instrument Transformer Metering Sequence - Service Cubicles Rated 600 volts	90
7.4.6.3	Unmetered Supply Conductors	90
7.4.6.4	Meter Location	90
7.4.6.5	Customer's Auxiliary Equipment	91
7.4.6.6	Metering Transformer Equipment Compartment	91
	Figure 7.4.6.6-1: Metering Instrument Transformer Compartment in Service Cubicles Rated 600V	92
7.4.6.7	Voltage Transformers	92
7.5	METERING ABOVE 600 VOLTS	93
7.6	METERING PULSE SIGNALS	93
7.7	METER BOARDS AND SUPPORTS	93
7.7.1	Meter Mounting	93
7.7.2	Approved Materials	93
8.0	MOTORS AND CONTROLLERS	94
8.1	GENERAL	94
8.2	SINGLE PHASE MOTORS	94
8.2.1	120 Volt Supply	94
8.2.2	208 or 240 Volt Supply	94
8.2.3	Maximum Locked-Rotor Currents	94

8.2.4	Single-Phase Motors on Three-Phase Service	94
8.3	THREE-PHASE MOTORS	95
8.3.1	Size of Motors	95
8.3.2	Maximum Locked-Rotor Currents	95
8.4	MOTOR PROTECTION	95
8.4.1	Overload Protection	95
8.4.2	Protection Against Single-Phase Operation	95
8.4.3	Reverse Phase Protection	95
8.4.4	Undervoltage Protection	95
8.5	MOTOR-STARTING REQUIREMENTS.....	95
8.5.1	Objectionable Voltage Variation	95
8.5.2	Current Inrush Limitation	96
8.5.3	Favorable Locations	96
8.5.4	Company Notification of 3 HP Single Phase and 10 HP Three Phase Applications ..	96
8.6	MAXIMUM PERMITTED STARTING CURRENT	96
	<i>Table 8.6-1 - Single Phase Motor Starting Current</i>	<i>97</i>
	<i>Table 8.6-2 - Three Phase Motor Starting Current</i>	<i>97</i>
9.0	TRANSFORMER INSTALLATIONS ON CUSTOMER PREMISES	98
9.1	GENERAL	98
9.2	INSTALLATIONS	98
9.2.1	Cluster Mounted Overhead Transformers	98
9.2.2	Outdoor Single Phase Pad Mounted Transformer	98
	<i>Table 9.2.2.2-1 Company and Customer Outdoor Single Phase Pad</i>	
	<i>Mounted Transformer Provisions</i>	<i>99</i>
9.2.3	Outdoor Three Phase Pad Mounted Transformer	99
9.2.4	Transformer Vault in Non-Network Area.....	99
9.3	AVAILABLE FAULT CURRENT	99
9.3.1	Network Services	100
9.3.2	Single Phase Transformers	100
	<i>Table 9.3.2-1 Single Phase Transformers Available Fault Current</i>	<i>100</i>
9.3.3	Three Phase Overhead Transformers.....	100
	<i>Table 9.3.3-1 Three Phase Overhead Transformer Available Fault Current</i>	<i>100</i>
9.3.4	Three Phase Pad Mounted Transformers.....	100
	<i>Table 9.3.4-1 Three Phase Pad Mounted Transformer Available Fault Current</i>	<i>100</i>
10.0	DISTURBANCES AND POWER QUALITY	101
10.1	GENERAL	101
10.2	MOTORS	101
10.3	DEVICES WITH INTERMITTENT HIGH CURRENT	101
10.4	AUTOMATIC RECLOSING.....	101
10.5	ELECTRICAL INTERFERENCE	101
	<i>Table 10.5-1 Harmonic Current Limits for Non-Linear Loads at the</i>	
	<i>Point-of-Common-Coupling (PCC) with Other Loads, at Voltages of 120V to 69kV ..</i>	<i>102</i>
	<i>Table 10.5-2 Harmonic voltage limits for power producers (Public Utilities or</i>	
	<i>Non-Utility Generators)</i>	<i>102</i>
10.6	POWER SUPPLY TO VOLTAGE SENSITIVE EQUIPMENT COMPUTERS	
	AND SENSITIVE EQUIPMENT	102
10.7	ISOLATION TRANSFORMER.....	102
	<i>Table 10.7-1 – Minimum Number of Single-phase Transformers to Serve</i>	
	<i>Reduced-voltage Load on a 3-phase, 3-wire Service</i>	<i>103</i>
11.0	CUSTOMER-OWNED ELECTRIC SOURCES – INCLUDING STANDBY GENERATORS.....	104
11.1	GENERAL	104

11.2	EMERGENCY AND STANDBY ELECTRIC SOURCES	104
11.2.1	Compliance Criteria.....	104
	<i>Figure 11.2.1-1 Standby Generator Non-parallel Operation with Company Connection Supplying Customer's Entire Load</i>	<i>105</i>
	<i>Figure 11.2.1-2 Connection of Standby Generator Supplying One 120 volt Branch Circuit</i>	<i>106</i>
	<i>Figure 11.2.1-3 Connection of Standby Generator Supplying One Building From Customer's Main Distribution Point.....</i>	<i>107</i>
11.2.2	Electric Source Type & Installation Method	108
11.2.2.1	AC or DC.....	108
11.2.2.2	Separately Derived Systems	108
11.2.2.3	Temporary Emergency Connections	108
11.2.3	Transfer Systems.....	108
11.2.3.1	Service Equipment Rated Transfer	108
11.2.3.2	Open-Transition Transfer	108
	<i>Figure 11.2.3.2-1 Double Throw Safety Transfer Switch</i>	<i>109</i>
11.2.3.3	Closed Transition & Auto Transfer	109
	<i>Table 11.2.3.3-1 Relay settings to parallel standby or emergency generators with the Company system</i>	<i>110</i>
11.2.4	Identification and Clearances.....	110
11.3	PARALLEL ELECTRIC POWER PRODUCTION	110
11.3.1	Inverters	111
12.0	UTILIZATION AND SPECIAL EQUIPMENT	112
12.1	ELECTRIC FENCES	112
12.2	SIGNS AND AUTOMATICALLY CONTROLLED LIGHTING.....	112
12.3	LIGHTNING AND SURGE PROTECTION.....	112
12.4	POWER FACTOR CORRECTION, CAPACITORS	112
12.4.1	Capacitor Installation.....	112
12.4.2	Static VAR Compensators (SVC)	112
12.5	RADIO AND TELEVISION	113
12.5.1	Transmitting Station, Repeater, or High Frequency Equipment.....	113
12.5.2	Antennas.....	113
12.5.3	Eliminator or Trap.....	113
12.6	CARRIER CURRENT SYSTEMS	113
13.0	REVISION HISTORY	114
PART C – “APPENDICES”	115	
APPENDIX 1 - OVERHEAD ATTACHMENT METHODS	115	
	<i>Table App1-1 – Company-accepted Attachment Materials</i>	<i>115</i>
	<i>Figure App1-1 – Illustrated Details of Overhead Service Attachment Methods: Details</i>	<i>117</i>
	<i>FIGURE APP1-2 – ILLUSTRATED DETAILS OF OVERHEAD SERVICE ATTACHMENT METHODS: ANCHORING</i>	<i>118</i>
APPENDIX 2 - TRAFFIC CONTROL METERED SERVICE REQUIREMENTS	119	
	<i>Notes for Figure App2-1</i>	<i>119</i>
	<i>Figure App2-1 – Typical Traffic Control Metered Service Installation.....</i>	<i>120</i>
CHANGE PROPOSAL FOR NATIONAL GRID “SPECIFICATIONS FOR ELECTRICAL INSTALLATIONS”	121	

PROCESS AND INFORMATION

Obtaining Electric Service


Please refer to the inside front cover of this book for Company contact information by phone, facsimile, mail, or internet.

How to Obtain Electric Service (less than 600 volts)	
(Applicants and Existing Customers)	
Pre-Plan Step 1	<ul style="list-style-type: none"> ✓ Review the Service Territory Map in the following pages of this book to determine the availability of electric service where application is made. ✓ Determine the amperage size and voltage of service needed; see the latest National Electrical Code. ✓ Determine the type of service desired as permitted. ✓ If heating with electricity, determine the total square footage of the area to be heated. ✓ Determine the desired date electric service is to be energized (provide for applicable planning, material order, and construction schedules). A Customer Order Fulfillment representative will make contact to confirm if the desired date can be met by the Company.
Request Step 2	<ul style="list-style-type: none"> ✓ For Applicants for a new electric service: <ul style="list-style-type: none"> ▪ The individual or entity who will be responsible for the electric bill must apply for service by contacting the Company's state-applicable Customer Service Center. ▪ Applicants may be required to submit written application and provide a security deposit according to the applicable Company tariff, which will be conveyed at the time the Applicant contacts the Company to request a new service in their name. ▪ The Applicant or their designated representative may initiate the service order by mail, facsimile, internet or telephone. When applying by <u>mail or facsimile</u>, an electric service request form is available from the Company's state-applicable Customer Service Center. Fill out the form providing the following information: <ul style="list-style-type: none"> ✓ Customer name, mailing address, phone number and daytime contact information ✓ The address where electric service is to be delivered and specific directions, including the nearest intersection ✓ The name, address and telephone number of the electrical contractor, if one will be used ✓ The specifics about type and size of service as defined above ✓ The proposed date for electric service (may require re-negotiation once Company work scope is defined) When applying by <u>internet</u>, navigate to the new service order form for Electricity by going to the website for the applicable state and selecting the topic "For Technical and Construction Professionals." Click on the link for "Electric Service" to open the online form. When applying by <u>telephone</u>, be prepared to provide the information provided on the electric service request form. ✓ To request an upgrade, relocation or rewire of an existing electric service, the Customer or their designated licensed electrical contractor may initiate the request by mail, facsimile, internet or telephone. Contact the Company's state-applicable Customer Service Center. For residential single-phase services, information which will assist in potentially expediting the request includes: the service location, service pole, and meter location if the service remains at the same location and if there are no clearance violations caused by pools, additions, garages, or decks. Where there is a clearance issue or if the attachment is inaccessible by ladder from the ground, the Company designates the service location. ✓ To request a temporary service, the request should be made by the individual or entity responsible for payment of charges associated with the temporary service. Payment is required in advance of scheduling the installation of a temporary service according to the applicable Company tariff. ✓ If an easement is required, the Applicant or Customer completes an Easement Application Form.

How to Obtain Electric Service (cont'd) (less than 600 volts)	
(Applicants and Existing Customers)	
Plan Step 3	<ul style="list-style-type: none"> ✓ Consult the Company regarding the type of service available and typical scheduling before plans are completed, the equipment is purchased, and construction is started. <ul style="list-style-type: none"> ▪ For <u>residential developments, commercial, and industrial applications</u>, an AutoCAD or Microstation (if available) electronic copy of the site plan, with grades and curb cuts may be e-mailed to the Company. ▪ For <u>400-ampere services and larger and distributed generation and standby generator proposed installations</u>, a one-line diagram must be submitted to the Company indicating service voltage; size of main switch or sub-mains if more than one; number, size, and type of conductors; number, size, and material of conduits, number of meters, their location and whether they are self-contained or transformer rated. The diagram must include information from the service attachment point to the main disconnect switch and overcurrent device (i.e. service equipment). ✓ Secure appropriate property rights (easements, licenses, permits, etc.) prior to the installation of any electrical service. ✓ Contribute to the cost of the service installation and connection to the Company's distribution system if the line on private property exceeds the allowance as provided in the Company's applicable tariff.
Installation Step 4	<ul style="list-style-type: none"> ✓ The Company's work can be scheduled only after the Company has received all documents and payment toward construction, if required. ✓ Complete the electrical wiring. ✓ Obtain any required electrical permits and arrange electrical inspection. ✓ Provide a completed "Certificate of Electrical Inspection" to the Company. ✓ Follow the Company's disconnect/reconnect policy for rewires/upgrades for less than 200-ampere single-phase overhead residential services only. <ul style="list-style-type: none"> Note: Licensed electricians or qualified electrical contractors have several options to perform this work, providing they are using the same Point of Attachment. Contact the Company's Customer Order Fulfillment for a representative to review the details for the available policy in your area. ✓ Provide a completed "Certificate of Compliance to Minimum Insulation Standards" to the Company if an <u>existing home is converted to electric heat</u>. ✓ Provide appropriate property rights for the Company's facilities, as required. ✓ Pay any charges that might be required by the Company according to its applicable tariff.

Electric Service Areas

National Grid in Massachusetts:

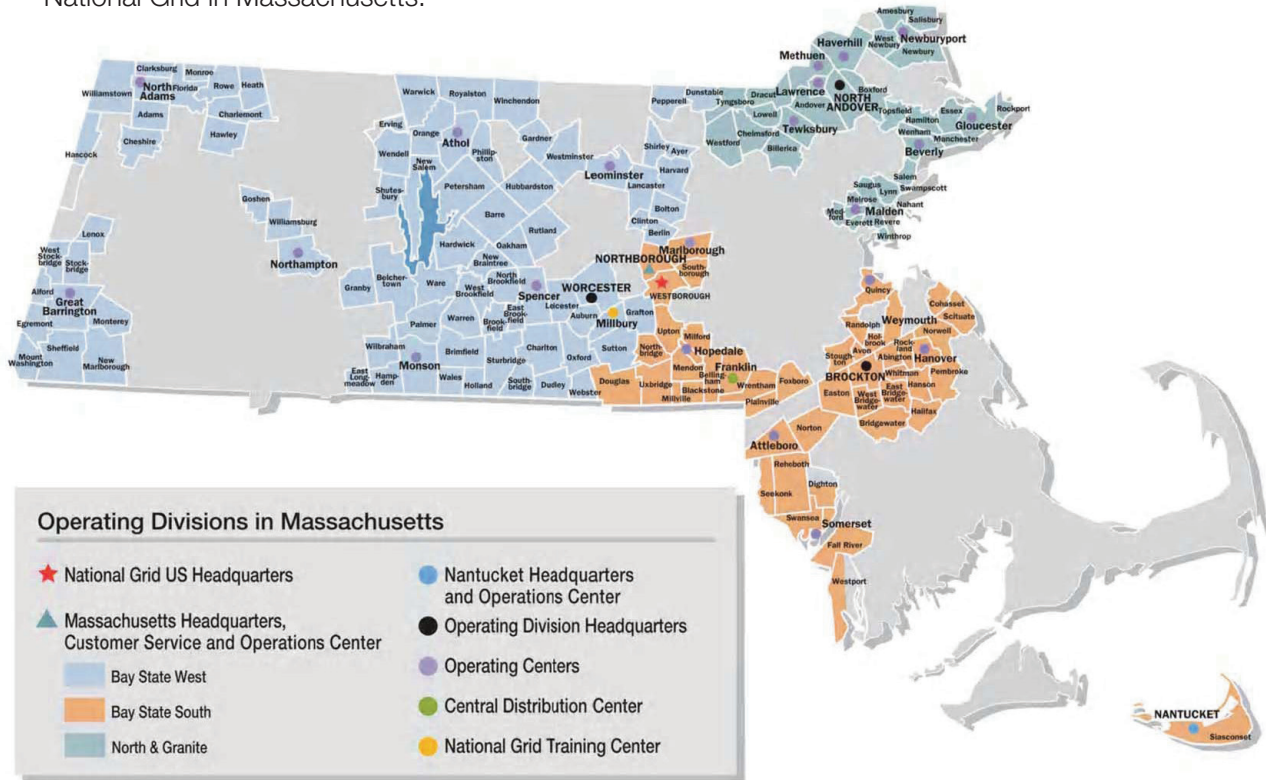


MA ST Map © 2005 National Grid

SERVING THESE COMMUNITIES:

Abington	Blackington	Clarksburg	Everett
Adams	Blackstone	Clayton	Fall River
Alford	Bolton	Clinton	Farley
Amesbury	Bondsville	Cohasset	Farnams
Andover	Boxford	Coldbrook Springs	Farnumsville
Annisquam	Bradford	Collinsville	Fayville
Asbury Grove	Bramanville	Cominsville	Fisherville
Ashley Falls	Bridgewater	Cordaville	Fiskdale
Athol	Briggsville	Dighton	Florence
Attleboro	Brimfield	Dodge	Florida
Auburn	Brockton	Douglas	Foxboro
Avon	Brookfield	Dracut	Franklin
Ayer	Byfield	Drury	Furnace
Ballard Hill	Carryville	Dudley	Gardner
Ballardvale	Charlemont	Dunstable	Gibbs Crossing
Barre	Charlton	East Bridgewater	Gilbertsville
Barrowsville	Chartley	East Brookfield	Glendale
Belchertown	Chaseville	East Longmeadow	Gloucester
*Bellingham	Chelmsford	Easton	Goshen
Berlin	Cherry Valley	Egremont	Grafton
Beverly	Cheshire	Erving	Granby
Beverly Farms	Chockalog	Essex	Great Barrington
Billerica			Greendale

Halifax	Monroe	Saugus	Westford
Hamilton	Monroe Bridge	Saundersville	Westminster
Hampden	Monson	Scituate	Westport
Hancock	Monterey	Seekonk	Westville
Hanover	Mt Washington	Shaker Village	Weymouth
Hanson	Nahant	Sharon	Wheelockville
Hardwick	New Braintree	Sheffield	Wheelwright
Hartsville	New Marlboro	Sheldonville	White City
Harvard	New Salem	Shirley	Whitinsville
Haverhill	Newbury	Shutesbury	Whitman
Hawley	Newburyport	Somerset	Whitmanville
Haydenville	North Adams	Southborough	Wilbraham
Heath	North Andover	Southbridge	Wilkinsonville
Hebronville	North Brookfield	South Easton	Williamsburg
Hillsville	Northampton	Southfield	Williamstown
Hingham	Northborough	Southville	Williamsville
Holbrook	Northbridge	Spencer	Winchendon
Holland	Norton	Spindleville	Winchendon Springs
Hopedale	Norwell	Still River	Winthrop
Hoosac Tunnel	Nuttings Lake	Stockbridge	Wollaston
Housatonic	Oakham	Stoneville	Worcester
Hubbardston	Old Furnace	Stoughton	Wrentham
Indian Orchard	Orange	Sturbridge	
Interlaken	Oxford	Sutton	Nantucket Area
Ironstone	Palmer	Swampscott	Communities:
Kittville	Pembroke	Swansea	Airport - Nantucket
Lake Buel	Pepperell	Tasseltop	Brant Point
Lancaster	Perryville	Tewksbury	Cisco
Lanesville	Petersham	Texas	Cliff
Leeds	Phillipston	Thorndike	Dionis
Lawrence	Pigeon Cove	Three Rivers	Hummock Pond
Leicester	Pinehurst	Topsfield	Madaket
Lenox	Pitcherville	Tully	Monomoy
Leominster	Plainville	Tyngsboro	Nantucket
Linwood	Podunk	Upton	Pocomo
Lowell	Prides Crossing	Unionville	Polpis
Lunenburg	Quincy	Uxbridge	Quaise
Lynn	Rakeville	Wadsworth	Quidnet
Magnolia	Randolph	Wales	Shimmo
Malden	Rehoboth	Ward Hill	Siaconset
Manchaug	Revere	Ware	Smiths Point
Manchester	Riverdale	Warren	Surfside
Marlborough	Rochdale - Leicester	Warwick	Tom Nevers
Medford	Rochdale - Oxford	Waterville	Town
Melrose	Rockdale	Webster	Wauwinet
Mendon	Rockland	Wendell	
Methuen	Rockport	Wendell Depot	
Midland	Rowe	Wenham	*Served in part
Milford	Royalston	Westborough	
Millbury	Rutland	West Bridgewater	
Mill River	Salem	West Brookfield	
Millers Falls	Salisbury	West Newbury	
Millville	Sandersdale	West Stockbridge	

National Grid in New Hampshire:

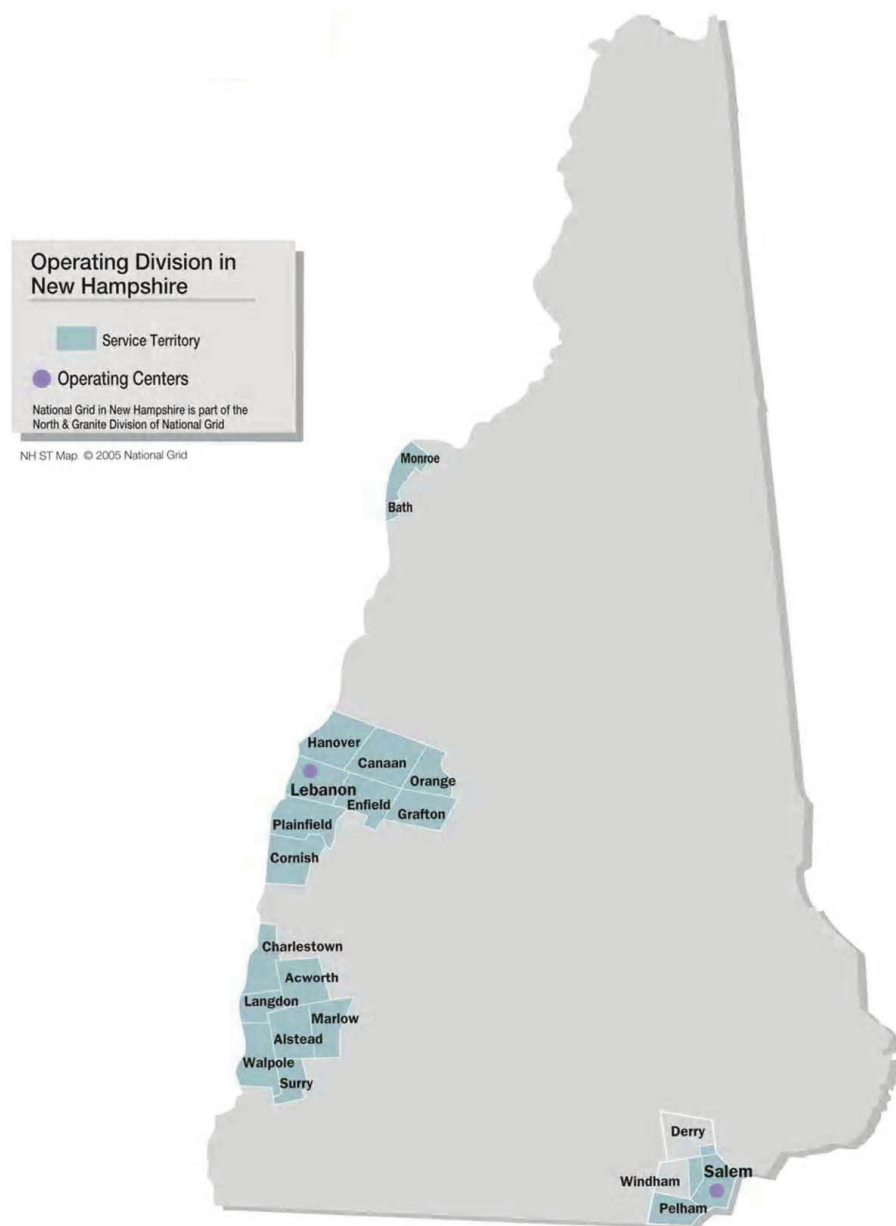


https://www.nationalgridus.com/non_html/shared_about_svcmap_gseco.pdf

SERVING THESE COMMUNITIES:

*Acworth	*Derry	*Marlow	*Surry
*Alstead	*Enfield	*Monroe	Walpole
*Bath	*Grafton	*Orange	*Windham
*Canaan	*Hanover	*Pelham	
*Charlestown	*Langdon	*Plainfield	*Served in part
*Cornish	*Lebanon	Salem	

National Grid in Upstate New York:

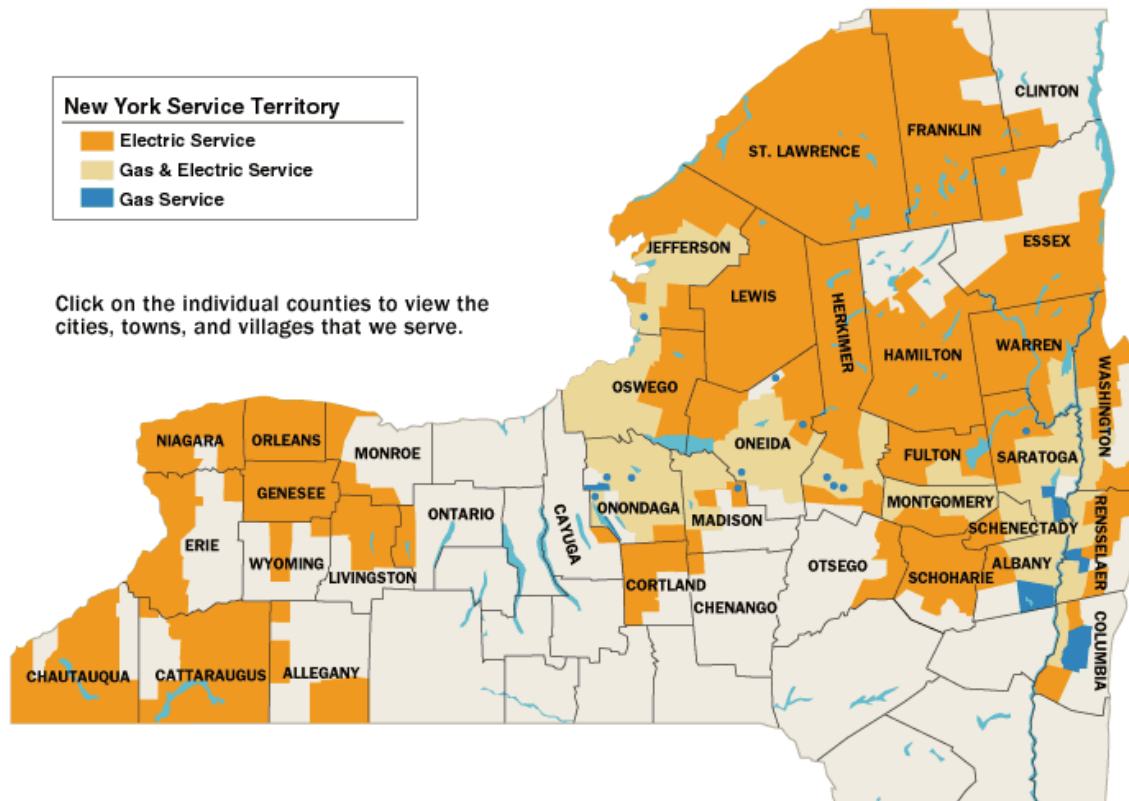

https://www.nationalgridus.com/niagaramohawk/about_us/serviceterr_map.asp

SERVING THESE COMMUNITIES:

(See the following pages for NY's Western, Central, and Eastern divisions.)

* Only part of town or village served by Company.

NY Western Division Service Area Cities, Towns, and Villages by County

Allegany

T Alma
T Andover*
T Centerville
T Cuba
T Independence
T New Hudson
T Scio
T Wellsville*
T Willing
V Cuba

Cattaraugus

C Olean
T Allegany
T Ashford
T Carrollton
T Cold Spring
T East Otto
T Ellicottville
T Farmersville
T Franklinville
T Freedom*
T Great Valley*
T Hinsdale
T Humphrey
T Ischua
T Little Valley*
T Lyndon
T Machias
T Mansfield
T Olean
T Otto
T Perrysburg*
T Portville
T Randolph*
T Redhouse
T South Valley
T Yorkshire*
V Allegany
V Cattaraugus
V Delevan
V Franklinville
V Limestone
V Portville

Chautauqua

C Dunkirk
T Arkwright
T Busti
T Carroll
T Charlotte

T Chautauqua*

T Clymer
T Dunkirk
T Ellery
T Ellicott
T French Creek
T Gerry
T Harmony
T Kaintone
T Mina
T North Harmony
T Poland
T Pomfret
T Portland*
T Ripley
T Sheridan
T Sherman
T Stockton
V Bemus Point
V Brocton*
V Cassadaga
V Celeron
V Falconer*
V Fredonia
V Lakewood
V Panama
V Sherman
V Sinclairville-Charlotte
V Sinclairville-Gerry
V Westfield*

Erie

C Buffalo
C Lackawanna
C Tonawanda
T Amherst*
T Brant
T Cheektowaga*
T Collins
T Eden
T Evans
T Grand Island
T Hamburg*
T Newstead*
T North Collins
T Tonawanda
T West Seneca*

V Angola
V Blasdell
V Depew-Cheektowaga*
V Depew-Lancaster*
V Ellicottville
V Farnham

V Kenmore
V Lancaster*
V North Collins
V Sloan-Cheektowaga*
V Williamsville-Amherst

Genesee

C Batavia
T Alabama
T Alexander
T Batavia
T Bergen*
T Bethany
T Byron
T Darien
T Elba
T LeRoy
T Oakfield
T Pavilion
T Pembroke
T Stafford
V Alexander
V Attica - Alexander
V Attica - Attica
V Corfu
V Elba
V LeRoy
V Oakfield

Livingston

T Avon
T Caledonia
T Conesus
T Geneseo*
T Groveland
T Lima
T Livonia
T York
V Avon
V Caledonia
V Lima
V Livonia

Monroe

T Clarkson
T Hamlin
T Mendon*
T Riga*
T Rush
T Sweden
V Brockport - Sweden
V Honeoye Falls
V Scottsville

Niagara

C Niagara Falls
C North Tonawanda
T Cambria
T Hartland
T Lewiston
T Lockport*
T Newfane
T Niagara
T Pendleton
T Porter
T Royalton
T Somerset
T Wheatfield
T Wilson
V Lewiston
V Middleport-Hartland
V Middleport-Royalton
V Wilson
V Youngstown

Ontario

T Canadice
T Richmond
T West Bloomfield
Orleans
T Albion
T Barre
T Carlton
T Clarendon
T Gaines
T Kendall
T Murray*
T Ridgeway
T Shelby
T Yates
V Albion - Albion
V Albion - Gaines
V Barker
V Holley
V Lyndonville
V Medina - Ridgeway
V Medina - Shelby

Wyoming

T Attica
T Covington
T Orangeville
T Wethersfield

NY Central Division Service Area Cities, Towns, and Villages by County

Cayuga	T Malone	T Brownville	T Martinsburg
T Niles	T Moira	T Cape Vincent	T Montague
Chenango	T Santa Clara	T Champion	T New Bremen*
T Lincklaen	T Waverly	T Clayton	T Osceola
Clinton	T Westville	T Ellisburg	T Pinckney
T Black Brook	V Brushton	T Henderson	T Turin
T Saranac*	V Fort Covington	T Hounsfield	T Watson
Cortland	V Malone	T LeRay	T West Turin
C Cortland	V Saranac Lake-Harr'town	T Lorraine	V Castorland
T Cortlandville	V Tupper Lk-Altamont*	T Lyme	V Constableville
T Cuyler	Fulton	T Orleans	V Copenhagen
T Homer	T Oppenheim	T Pamela	V Croghan
T Preble	T Stratford	T Philadelphia*	V Croghan - New Bremen
T Scott	V Dolgeville*	T Rodman	V Harrisville
T Solon	Hamilton	T Rutland	V Lowville
T Truxton	T Arietta	T Theresa	V Lyons Falls
T Virgil*	T Inlet	T Watertown	V Lyons Falls - Lyonsdale
V Homer	T Long Lake*	T Wilna	V Port Leyden
V Homer-Cortlandville	T Morehouse	T Worth	V Port Leyden-Lyonsdale
V McGraw	Herkimer	V Adams	V Turin
Essex	C Little Falls	V Alexandria Bay	Madison
T North Elba*	T Columbia*	V Antwerp	C Oneida - Inside
T St. Armand	T Danube	V Black River-LeRay	C Oneida - Outside
V Bloomingdale	T Fairfield	V Black River-Rutland	T Cazenovia
V Lake Placid - N Elba*	T Frankfort	V Brownville	T DeRuyter
V Saranac Lake - N Elba	T German Flatts	V Cape Vincent	T Fenner
V Saranac Lk-St Armand	T Herkimer	V Carthage	T Lenox
Franklin	T Litchfield*	V Chaumont	T Lincoln
T Altamont	T Little Falls	V Clayton	T Nelson
T Bangor	T Manheim	V Deferiet	T Stockbridge
T Belmont*	T Newport	V Dexter	T Sullivan
T Bombay	T Norway	V Ellisburg	V Canastota
T Brandon	T Ohio	V Evans Mills	V Cazenovia
T Brighton	T Russia	V Glen Park - Brownville	V Chittenango
T Constable*	T Salisbury	V Glen Park - Pamela	V DeRuyter
T Dickinson	T Schuyler	V Herrings	V Munnsville
T Duane	T Webb	V Mannsville	V Wampsville
T Fort Covington	V Cold Brook	V Philadelphia*	Oneida
T Franklin	V Dolgeville - Manhiem	V Sackets Harbor	C Rome Inside
T Harrietstown	V Frankfort*	V Theresa*	C Rome Outside
T Malone	V Herkimer	V West Carthage	C Utica
T Moira	V Ilion*	Lewis	T Annsville
T Santa Clara	V Middleville-Fairfield	T Constableville	T Ava*
T Waverly	V Middleville-Newport	T Croghan	T Boonville*
T Westville	V Mohawk*	T Denmark	T Camden
V Brushton	V Newport	T Diana	T Deerfield
V Fort Covington	V Poland - Newport	T Greig	T Florence
V Malone	V Poland - Russia	T Harrisburg	T Floyd
V Saranac Lake-Harr'town	Jefferson	T High Market	T Forestport
V Tupper Lk-Altamont*	C Watertown	T Lewis	T Kirkland
Fulton	T Adams	T Leyden	T Lee
T Oppenheim	T Alexandria	T Lowville	T Marcy
T Stratford	T Antwerp	T Lyonsdale	T New Hartford
			T Paris

NY Central Division Service Area (Cont'd)

Oneida (cont'd)

T Remsen	T Lafayette	T Parish	T Madrid
T Steuben	T Lysander	V Phoenix	T Massena*
T Trenton	T Manlius	T Redfield	T Morristown
T Vernon	T Onondaga	T Richland	T Norfolk*
T Verona	T Otisco*	T Sandy Creek	T Oswegatchie
T Vienna	T Pompey	T Schroepfel	T Parishville
V Sherrill*	T Salina	T Scriba	T Piercefield
T Western	T Skaneateles*	T Volney	T Pierrepont
T Westmoreland	T Tully	T West Monroe	T Pitcairn
T Whitestown	T Van Buren*	T Williamstown	T Potsdam
V Boonville*	V Baldwinsville-Lysander	V Altmar	T Rossie
V Camden	V Baldwinsville-Van Buren	V Central Square	T Russell
V Sherrill*	V Camillus	V Cleveland	T Stockholm*
V Clayville	V E Syracuse	V Hannibal	T Waddington
V Clinton	V Fabius	V Lacona	V Canton
V Holland Patent	V Fayetteville	V Mexico	V Edwards
V N Y Mills - Whitestown	V Liverpool	V Parish	V Gouverneur
V New Hartford	V Manlius	V Pulaski	V Hammond
V NY Mills-New Hartford	V Minoa	V Sandy Creek	V Hermon
V Oneida Castle	V North Syracuse-Cicero	St. Lawrence	V Heuvelton
V Oriskany	V North Syracuse-Clay	C Ogdensburg	V Massena*
V Prospect	V Skaneateles*	T Brasher*	V Morristown
V Remsen	V Solvay*	T Canton	V Norwood - Norfolk
V Remsen - Trenton	V Tully	T Clare	V Norwood - Potsdam
V Sylvan Beach	Oswego	T Clifton	V Potsdam
V Trenton	C Fulton	T Colton	V Rensselaer Falls
V Vernon	C Oswego	T DeKalb	V Richville
V Whitesboro	T Albion	T DePeyster	V Waddington
V Yorkville	T Amboy	T Edwards	
Onondaga	T Boylston	T Fine	
C Syracuse	T Constantia	T Fowler	
T Camillus	T Granby	T Gouverneur	
T Cicero	T Hannibal	T Hammond	
T Clay	T Hastings	T Hermon	
T Dewitt	T Mexico	T Hopkinton	
T Elbridge*	T Minetto	T Lawrence	
T Fabius	T New Haven	T Lisbon	
T Geddes*	T Orwell	T Louisville*	
	T Oswego	T Macomb	
	T Palermo		

NY Eastern Division Service Area Cities, Towns, and Villages by County

Albany

C Albany
C Cohoes
C Watervliet
T Berne
T Bethlehem
T Coeymans*
T Colonie
T Guilderland
T Knox
T New Scotland
V Altamont
V Colonie
V Green Island
V Menands
V Voorheesville

Columbia

C Hudson
T Chatham*
T Claverack*
T Clermont
T Gallatin*
T Germantown
T Ghent
T Greenport
T Kinderhook
T Livingston
T Stockport
T Stuyvesant
T Taghkanic*
V Kinderhook
V Valatie

Essex

T Crown Point
T Minerva
T Moriah
T North Hudson
T Schroon
T Ticonderoga
T Westport
V Port Henry
V Ticonderoga
V Westport

Fulton

C Gloversville
C Johnstown
T Bleecker
T Broadalbin
T Caroga

T Ephratah
T Johnstown
T Mayfield
T Northampton
T Oppenheim
T Perth
T Stratford
V Broadalbin
V Mayfield
V Northville

Hamilton

T Arietta
T Benson
T Hope
T Indian Lake*
T Lake Pleasant
T Wells
V Speculator

Herkimer

T Danube
T Manheim
T Stark

Montgomery

C Amsterdam
T Amsterdam
T Canajoharie
T Charleston
T Florida
T Glen
T Minden
T Mohawk
T Palatine
T Root

T St. Johnsville
V Ames
V Canajoharie
V Fonda
V Fort Johnson
V Fort Plain – T Canajoharie
V Fort Plain – T Minden
V Fort Plain – T Palantine
V Fultonville
V Hagaman
V Nelliston
V Palatine Bridge

Otsego

T Cherry Valley
T Decatur
T Maryland

T Roseboom
T Worcester
V Cherry Valley
V Schenevus

Rensselaer

C Rensselaer
C Troy
T Brunswick
T E Greenbush
T Grafton
T Hoosick
T Nassau
T North Greenbush*
T Pittstown
T Poestenkill
T Sand Lake*
T Schaghticoke*
T Schodack
V Castleton
V Hoosick Falls
V Nassau – T Nassau
V Nassau – T Schodack
V Schaghticoke
V Valley Falls – T Pittstown
V Valley Falls – T Schaghticoke

Saratoga

C Saratoga Springs
T Ballston
T Charlton
V St. Johnsville
T Corinth
T Day
T Edinburgh
T Galway
T Greenfield
T Hadley
T Half Moon*
T Malta*
T Milton
T Moreau
T Northumberland
T Providence
T Saratoga
T Stillwater*
T Waterford
T Wilton
V Ballston Spa - T Ballston
V Ballston Spa - T Milton
V Corinth
V Galway

V Schuylerville
V So. Glens Falls
V Victory Mills
V Waterford

Schenectady

C Schenectady
T Duanesburg
T Glenville
T Niskayuna
T Princetown
T Rotterdam
V Delanson
V Scotia

Schoharie

T Blenheim
T Broome
T Carlisle
T Cobleskill
T Esperance
T Fulton
T Middleburg
T Richmondville*
T Schoharie
T Seward
T Sharon
T Summit
T Wright
V Cobleskill
V Esperance
V Middleburg
V Schoharie
V Sharon Springs

Warren

C Glens Falls
T Bolton
T Chester
T Hague
T Horicon
T Johnsburg
T Lake George
T Lake Luzerne
T Queensbury
T Stony Creek
T Thurman
T Warrensburg
V Lake George


Washington

T Argyle

NY Eastern Division Service Area (Cont'd)

T Cambridge
T Dresden
T Easton
T Fort Ann
T Fort Edward
T Greenwich
T Hampton
T Hartford
T Jackson*
T Kingsbury
T Putnam
T White Creek
T Whitehall
V Argyle
V Cambridge – T Cambridge
V Cambridge – T White
Creek
V Fort Ann
V Fort Edward
V Greenwich – T Easton
V Greenwich – T Greenwich
V Hudson Falls
V Whitehall
V Broadalbin
V Mayfield
V Northville

National Grid in Rhode Island:

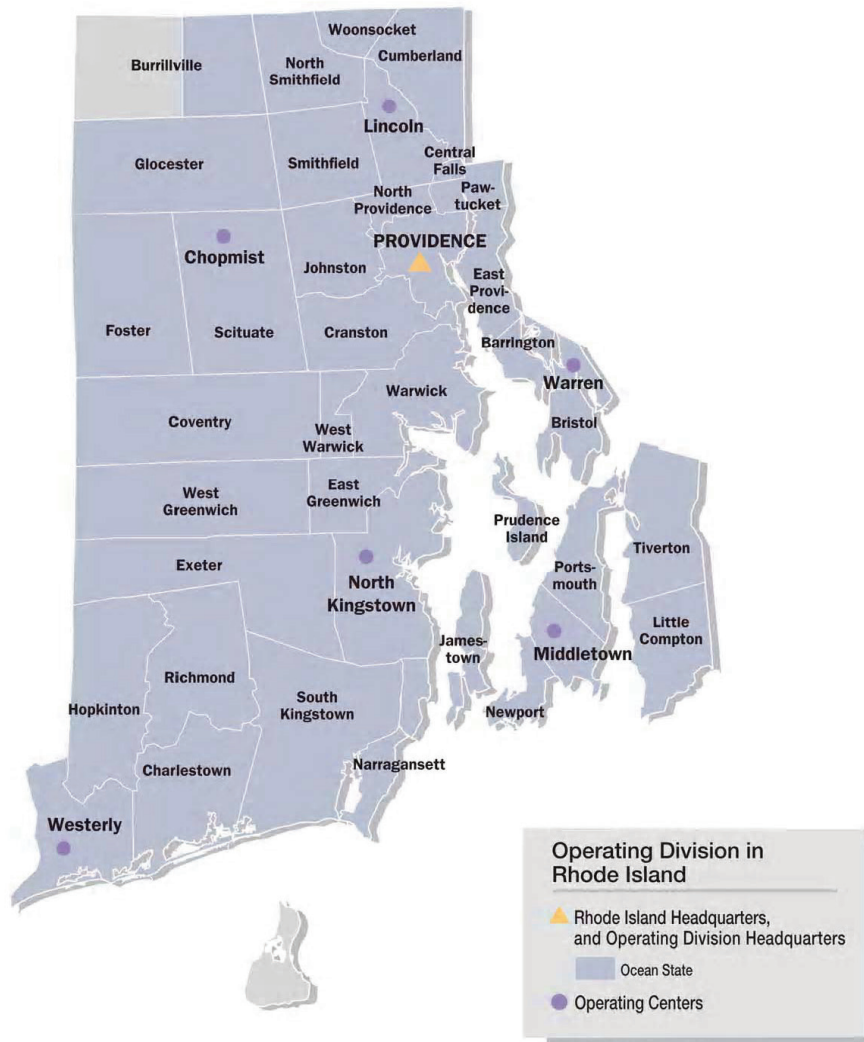

https://www.nationalgridus.com/non_html/shared_about_svcmap_neco.pdf

SERVING THESE COMMUNITIES:

Adamsville	Barrington	Centerdale	Crompton
Albion	Belleville	Central Falls	Crossmills
Allenton	Bonnett Shores	Centerville	Cumberland
Alton – Hopkinton	Boone Lake	Chepachet	Davisville
Alton – Richmond	Bradford – Hopkinton	Charlestown	East Greenwich
Anthony	Bradford – Westerly	Chopmist	East Providence
Apponaug	Branch Village	Clayville – Scituate	Edgewood
Arcadia – Exeter	Bristol	Clayville – Foster	Escoheag – Exeter
Arcadia – Richmond	Browning Beach	Connicut	Escoheag – West Greenwich
Arctic	Burrillville	Cononchet	Esmond
Ashaway	Carolina – Charlestown	Coventry	Exeter
Auburn	Carolina – Richmond	Cowessett	Fiskeville
Avondale		Cranston	Forestdale
			Foster

Foster Center	Matunuck	Rumford	White Rock
Galilee	Middletown	Saunderstown	Wickford
Glendale	Misquamicut	Scituate	Wood River Jct
Glocester	Mohegan	Shannock - Charlestown	Woodville - Hopkinton
Great Island	Moore's Field	Shannock - Richmond	Woodville - Richmond
Greene	Moosup Valley	Shawmut	Woonsocket
Greenville	Narragansett	Shelter Harbour	Wyoming
Greenwich Center	Nasonville	Slatersville	
Georgiaville	Natick	Slocum - Exeter	
Greystone	Newport	Slocum - North Kingstown	
Hamilton	North Kingstown	Smithfield	
Harmony	North Providence	Snug Harbour	
Haversham	North Scituate	South Kingstown	
Hope - Cranston	North Smithfield	Still Water	
Hope - Scituate	North Tiverton	Thornton	
Hope - Coventry	Norwood	Tiverton	
Hope Valley	Oakland	Tucker Town	
Hopkinton	Ocean Ridge	Union Village	
Jamestown	Pawtucket	Wakefield	
Jerusalem	Peacedale	Warren	
Johnston	Perryville	Warwick	
Kenyon	Pettasquamscutt	Washington	
Kingston	Point Judith	Watch Hill	
Lafayette	Pontiac	Weekapaug	
Lincoln	Portsmouth	West Barrington	
Lippitt	Potter Hill	Westerly	
Little Compton	Providence	West Glocester	
Lymansville	Prudence Island	West Greenwich	
Manton	Potowomot	West Kingston	
Manville	Quonochontaug	West Warwick	
Mapleville	Quonset		
Marieville	Rockland		
	Richmond		
	Rockville		

Safety Information

National Grid is committed to the pursuit of safety excellence through compliance with all OSHA, State, and Regulatory requirements. We encourage the Customer or its Contractor to comply with the same requirements and for safe trenching.

811 is the nationwide number for utility locate requests before trenching; see:

<http://www.call811.com/state-specific.aspx>

In the New England states:



Dig Safe System, Inc.
1-888-DIG-SAFE or 811 MA - ME - NH - RI - VT

<http://www.digsafe.com/>

For Utility Locate Requests call: **1-888-DIGSAFE (344-7233)** or Apply Online

In Upstate New York:

Dig Safely. New York

Dig Safely and Dig Safely. New York are used under license from Dig Safe System, Inc.

<http://www.digsafelynewyork.com/>

Call center operators at Dig Safely New York are available 24 hours a day, seven days a week to receive and process calls to the toll-free phone number (**1-800-962-7962**).

The Electrical Safety Foundation International (ESFI):



<http://esfi.org/>

For worker safety precautions as applicable for the installation, please refer to:

- ▶ NESC ANSI C2,
- ▶ NFPA 70E,
- ▶ OSHA, and
- ▶ any state and local requirements.

Contacting the Company

Please refer to the inside front cover for important phone numbers and our Internet Web sites for National Grid information in the USA.

Part A – “General Information”

Note: *The information provided in Part A contains common general conditions of electric service based upon state laws and regulations that govern the authority of utilities to provide electric service under applicable tariffs. While each utility's requirements may vary from state-to-state, most states have adopted some form of the National Electrical Safety Code (NESC). The NESC is an adoptable code promulgated by IEEE through the ANSI standards-making process.*

1.0 INTRODUCTION

1.1 PURPOSE

The purpose of this document is to provide National Grid's general electric service rules for basic requirements essential for maintaining satisfactory service or interconnection compatible with National Grid's electric power system (EPS). In addition, these rules are intended to properly protect the safety and interests of National Grid's customers and others served by the electric power system (EPS) operated by the utility. Where the term “Company” is used, it refers to the applicable serving utility within National Grid's service territories. These basic rules are supplemented by the applicable tariffs in effect in each of the Company's service territories, as such tariffs may be amended from time to time.

1.2 SCOPE

These electric service requirements cover conductors and equipment connecting the Company's EPS at the Customer's service point. These also include other topics associated with the supply of electricity that are of mutual interest to the Company, customers, design professionals, and qualified installers. It should be noted that this is not a complete set of rules governing the electrical premises wiring and equipment.

1.3 RATE SCHEDULE

Electric tariffs and associated rules and regulations are on file with the applicable state regulatory agencies and are also available for download from the Company's website for each state. The following are the associated National Grid tariffs for these specifications, as such tariffs may be amended from time to time:

- ▶ In Massachusetts, “Terms and Conditions for Distribution Service”
- ▶ In New Hampshire, “Tariff for Retail Delivery Service”
- ▶ In New York, P.S.C. No. 220, “Schedule for Electric Service”
- ▶ In Rhode Island, “Terms and Conditions for Distribution Service”

1.4 COOPERATION AND TIME REQUIREMENTS

The Customer, its authorized agent and/or design professional is responsible for cooperating with the Company and permitting a thorough and proper technical review by the Company for acceptance and timely delivery of the Company's services. Preliminary information leading to new or increased electric service requirements shall be submitted to the Company early in the planning stages. This will insure proper design and scheduling coordination of the work associated with the service connection.


1.5 CODES, STANDARDS, AND REFERENCES

These rules supplement, and may exceed standards of safety regarding the Customer's electrical installation set forth in the National Electrical Code (NEC) and the National Electrical Safety Code (NESC) and other applicable codes. These rules are not a substitute for the NEC, NESC, municipal codes, or any other authority having jurisdiction.

The Company requires that the Customer's premises wiring installations be made in accordance with all applicable codes and these rules. Service shall be denied if these codes and the Company's rules are not met. The Company accepts no liability for direct or indirect damages resulting from the Company's refusal to energize a service or the Company's termination of a service that does not meet these rules and all other applicable codes.

The following is a general illustration of where the Company's electric supply and the Customer's premises wiring meet for what is covered and what is not covered by the NEC as described in NEC Section 90.2. Local conditions of service may permit the Company's metering to be installed at any point on either side of the service point; see 90.2(B)(5) in the NEC. Conditions of electric service are based on governmental laws or regulations that determine the Company's authority to provide electric service under their tariffs. These conditions of electric service affect the location of the service point and facilities under the Company's exclusive control.

FIGURE 1.5-1 – ILLUSTRATION UTILITY ELECTRIC SUPPLY AND PREMISES WIRING

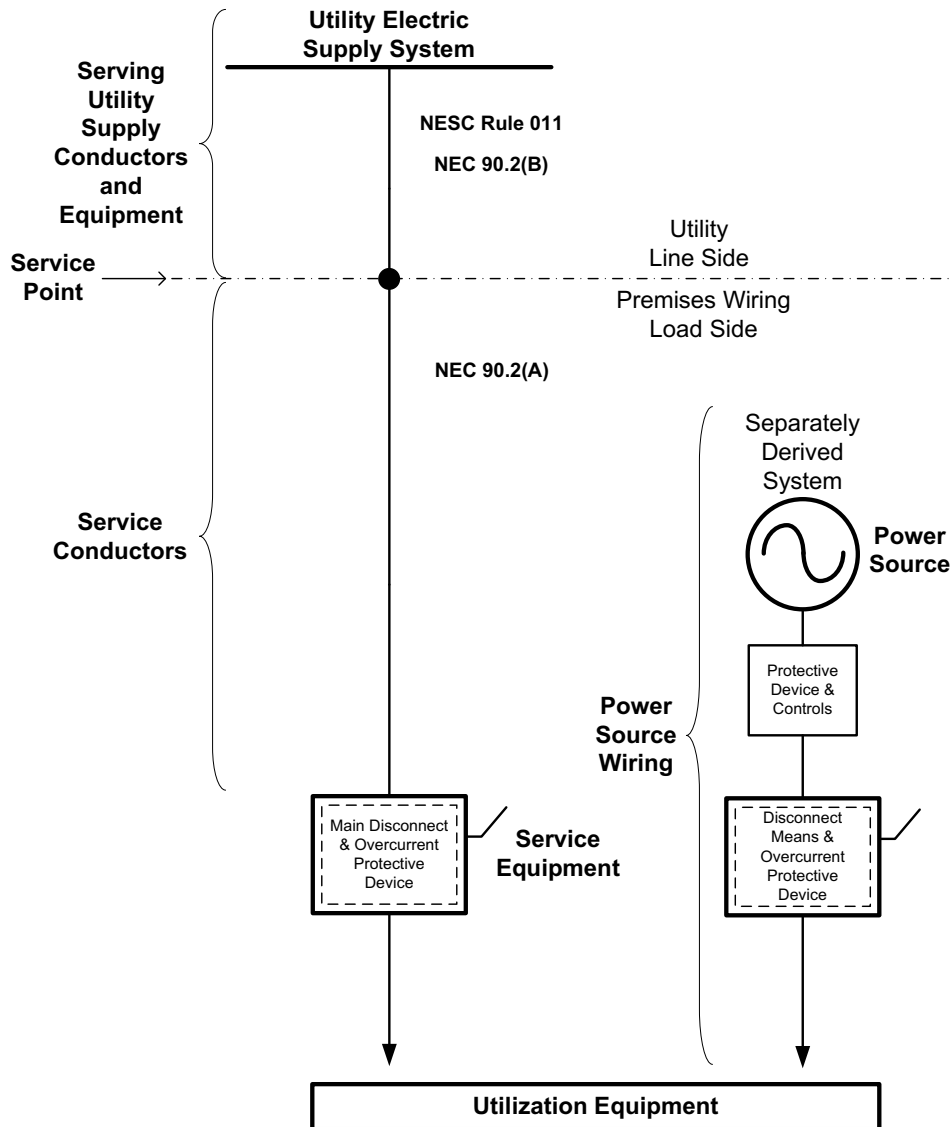

1.5.1 References

NFPA 70	National Electrical Code
NFPA 70B	Recommended Practice for Electrical Equipment Maintenance
NFPA 70E	Standard for Electrical Safety in the Workplace
ANSI/IEEE C2	National Electrical Safety Code
Building Code	States of MA, NH, NY, and RI
Massachusetts General Laws:	Chapter 82, Section 40A Chapter 164, Section 127 & 127A Chapter 166, Sections 21A-21G Chapter 266, Section 30 Chapter 266, Section 127
New Hampshire Revised Statutes:	Chapter 374, Sections 48-56 Chapter 539, Section 7
New York State Laws	Public Service Law, Chapter 48 of the Consolidated Laws High Voltage Proximity Act, contained in Labor Law, Chapter 31 of the Consolidated Laws, Section 202-h 16 NYCRR, Rules and Regulations of the Department of Public Service
General Laws of Rhode Island:	Chapter 35, Sections 11-35-4, 11-35-5, 11-35-6, 11-35-7, 11-41-1, 11-41-5, 11-41-6 Chapter 39-1.2, Sections 1-14
Federal Occupational Safety and Health Administration (OSHA)	29 CFR 1926.550(a)(15) 29 CFR 1926.651 (a) 29 CFR 1910.333 (c)
Excavation Notification Requirements - Dig Safe	In MA, NH, RI: 1-888-DIGSAFE (344-7233) In NY: 1-800-962-7962 811 is the nationwide number; see http://www.call811.com/state-specific.aspx

1.5.2 Supplemental Company Specifications

ESB No. 751	General Requirements Above 600-volt Service
ESB No. 752	Service above 15,000 volts
ESB No. 753	Primary Meter Pole
ESB No. 754	Outdoor Pad Mounted or Vault Enclosed Three Phase Transformer
ESB No. 754A	Single Phase Outdoor Pad Mounted Transformer
ESB No. 755	Operation & Maintenance Requirements for Service Above 600 volts
ESB No. 756	General Requirements for Parallel Generation Connected to a National Grid Owned EPS
- Appendix A	Requirements for Parallel Generation Connected to National Grid Facilities in NY
- Appendix B	Requirements for DG Connected to National Grid's Radial Distribution per the NYS SIR
- Appendix C	Requirements for Parallel Generation Connected to National Grid Facilities in Massachusetts
- Appendix D	Requirements for Parallel Generation Connected to National Grid Facilities in Rhode Island
- Appendix E	Requirements for Parallel Generation Connected to National Grid Facilities in New Hampshire
ESB No. 757	Network Services
ESB No. 758	Primary Service to Metal Enclosed Gear
ESB No. 759	Underground Distribution Guidelines
ESB No. 759A	Underground Residential Distribution Guideline
ESB No. 759B	Underground Commercial Distribution Guideline
See these Electric System Bulletins at http://www.nationalgridus.com/electricalspecifications	

1.6 REQUESTS FOR INFORMATION

The Company invites inquiries and will assist the Customer with the application of these rules. Refer to the “Process and Information” section in the beginning of this book.

1.7 CUSTOMER’S RESPONSIBILITY

1.7.1 All Customers

The Customer shall provide the service entrance, in accordance with the Company’s requirements, and all premises wiring on the load side of the service point. At all times, the Customer is responsible for ensuring that its electrical interconnection facilities attached to the Company’s EPS are designed, installed, operated, and maintained in accordance with all applicable codes, standards, rules, regulations, statutes, governmental ordinances, and third party permits (collectively referred to as all applicable requirements). The Customer is responsible for contacting all third parties and obtaining all applicable permits (including environmental if required), approvals and inspections, and underground facility locating services for its premises wiring installation. Documentation substantiating the completion of such activities shall be furnished to the Company upon request.

The Customer shall assume or delegate, to an authorized representative, the primary responsibility for approval and acceptance of its equipment and the timing of its installation. The Company cannot accept any responsibility for the condition of the Customer’s premises wiring and equipment. The Customer is responsible for and the cost of on-going compliance with all applicable requirements noted above as well as any and all system design and operating changes to its installation.

1.7.2 Customers served at voltages above 600 volts

1.7.2.1 Design Acceptance

The planning and design of electric service equipment at voltages above 600 volts requires skilled application of engineering principles and data to ensure proper interconnection and functionality with the utility electric supply system and to ensure safe operation and maintenance of the equipment following installation. Therefore a Professional Engineer, licensed in the state where service is made, shall prepare all documents submitted to the Company in connection with all electric service equipment above 600 volts. This requirement applies to new installations and alterations to existing installations. Designs involving alterations to existing electric service equipment shall include retrospective review of the original design to ensure the alteration will function properly.

This requirement is described in ESB 751 and applies to all submittals detailed in ESB’s 752, 753, 756 and 758, at all stages of a project, from initial conceptual planning through the final for-construction design that is accepted by the Company. All drawings shall be prepared in conformance with ANSI Y32.2, IEEE 141, and IEEE 446 symbol and drafting nomenclature.

Signature, license number, seal, or letterhead with return address, as appropriate, will suffice as evidence of preparation by a licensed PE. Documents not evidencing preparation by a licensed PE will be returned to the submitter without comment for resubmittal to the Company.

1.7.2.2 Operation and Maintenance

Customers owning electric service equipment above 600 volts shall operate and maintain such equipment in accordance with Company supplied operating instructions and specifically ESB 755, “Operation and Maintenance Requirements for Services above 600 volts.”

1.8 COMPANY’S RESPONSIBILITIES

The electric supply and service installation provisions and costs shall be in accordance with the Company’s filed tariffs.

These specifications are subject to revision without notice. They may be revised or amended as the Company shall determine, or as required by developments of the industry to protect the mutual interests of the Customer and Company. The latest revision shall be used. Additional copies of these specifications and any errata can be obtained from the Company; also see Section 1.5 for Company supplemental specifications.

1.9 INSPECTION, WIRING ADEQUACY, AND ENFORCEMENT

The Company requires the Customer to furnish satisfactory evidence of the safe condition of its wiring before any service is connected. This will be in the form of an electrical inspection approval certificate from the authority having jurisdiction (AHJ) or an inspection agency approved by the AHJ and the Company. Inspections shall confirm compliance with the National Electrical Code, any applicable municipal codes, and any specific utility service rules that are in addition to the aforementioned codes. The Company and its accepted inspection organizations have the authority for enforcement of these rules.

To re-energize a service that has been disconnected for an unsafe condition by any AHJ mandate or by the Company, the Customer must provide an electrical inspection certificate from an approved inspection agency to the Company prior to reconnection.

The Company requires certificates of inspection:

- ▶ On all new services and
- ▶ To re-energize any existing service that has been de-energized by any disconnect method (cutting service lateral conductors at pole or weatherhead, meter removal, etc.) for any of the reasons or durations listed below:
 1. an emergency,
 2. theft of service,
 3. duration exceeding twelve months,
 4. following 36 months of service inactivity, and
 5. when premises wiring (system) is replaced, altered or extended.

1.10 DISCLAIMER

1.10.1 Company Approval

The Company's approval of the Customer's installation constitutes the Company's acceptance of the Customer's proposed arrangement and equipment as meeting the Company's minimum requirements under these rules and does not relieve the Customer from the obligation of complying with all applicable codes, statutes, rules or regulations.

1.10.2 Use of Electricity

The Company shall not be liable for damage to the person or property of the Customer or any other persons resulting from the use of electricity or the presence of the Company's equipment on the Customer's premises. Relative to any information supplied by the Company in connection with a customer, it must be understood that the Company's EPS is a dynamic system that changes from moment to moment as demands are made to the system. Furthermore, permanent changes to the system are common which will change the information provided to Customers or their Agents. Although the Company makes every reasonable effort to obtain reliable information and proper calculations, the Company provides no warranty, expressed or implied, as to the accuracy, reliability or completeness of data furnished to Customers or their Agents. National Grid reserves the right to make improvements, upgrades or other changes to the electric system without notice. Such changes may invalidate any information provided.

1.10.3 Condition of Service

The Company shall not be liable for, or in any way in respect of, any interruption, abnormal voltage, discontinuance, or reversal of its service, due to causes beyond its immediate control whether accident, labor difficulties, condition of fuel supply, the decision of any public authority, or failure to receive any electricity for which in any manner it has contracted, or due to the operation in accordance with good utility practice of any emergency load reduction program by the Company or one with whom it has contracted for a supply of electricity, or inability for any other reason to maintain uninterrupted and continuous service; provided, however, that under the terms of the Company's applicable tariff if the Company is unable for any of the causes enumerated above to supply electricity for a continuous period of two (2) days or more, then upon request of the Customer, the Demand Charge, if any, shall be suspended for the duration of such inability.

1.10.4 Company Warranty Statement

For all voltages and services, the Company will cooperate with its customers or their representatives. However, neither by inspection, nor by the rendering of advisory service, nor in any other way, does the Company give any warranty, expressed or implied, as to the adequacy, safety, or other characteristics of any equipment, wires, appliances, or devices owned, used, or maintained by Customers.

1.11 ENFORCEMENT OF COMPANY REQUIREMENTS

1.11.1 Enforcement Criteria

The Company and the local AHJ have the authority to enforce these specifications. The Company's Specifications for Electrical Installations Committee has the responsibility for: making interpretations of the rules, deciding upon the approval* of equipment and materials, and granting the special permissions contemplated in a number of the rules.

Alternative construction methods not covered in these specifications must be submitted to the Company in writing and be approved* by the Company prior to purchase and/or installation of equipment. The Company shall only grant deviations from these specifications in writing.

Exceptions from the NEC or other codes shall only be granted in writing by the local code authority exercising jurisdiction and filed with the Company.

***Note:** See Section 2 for the definition of the term "Company approval". The Company does not "approve" all aspects of the Customer's equipment or premises wiring installation.

1.11.2 Diversion of Electrical Energy

A diversion of electrical energy is any method or device used by any person that prevents an electric meter from duly registering the quantity of electricity supplied by the Company and/or the taking of any electrical current without the Company's consent.


Where there is evidence of meter tampering or theft of electrical energy, the responsible person or persons shall be liable for prosecution under penalty of law.

2.0 DEFINITIONS

Notes:

- (1) The following are terms defined as used in this publication.
- (2) For graphical relationship of defined components and section references in this book, see Figure 2-1.

Figure 2-1: Typical Service Installation Diagram Below 600 volts – Excluding Network

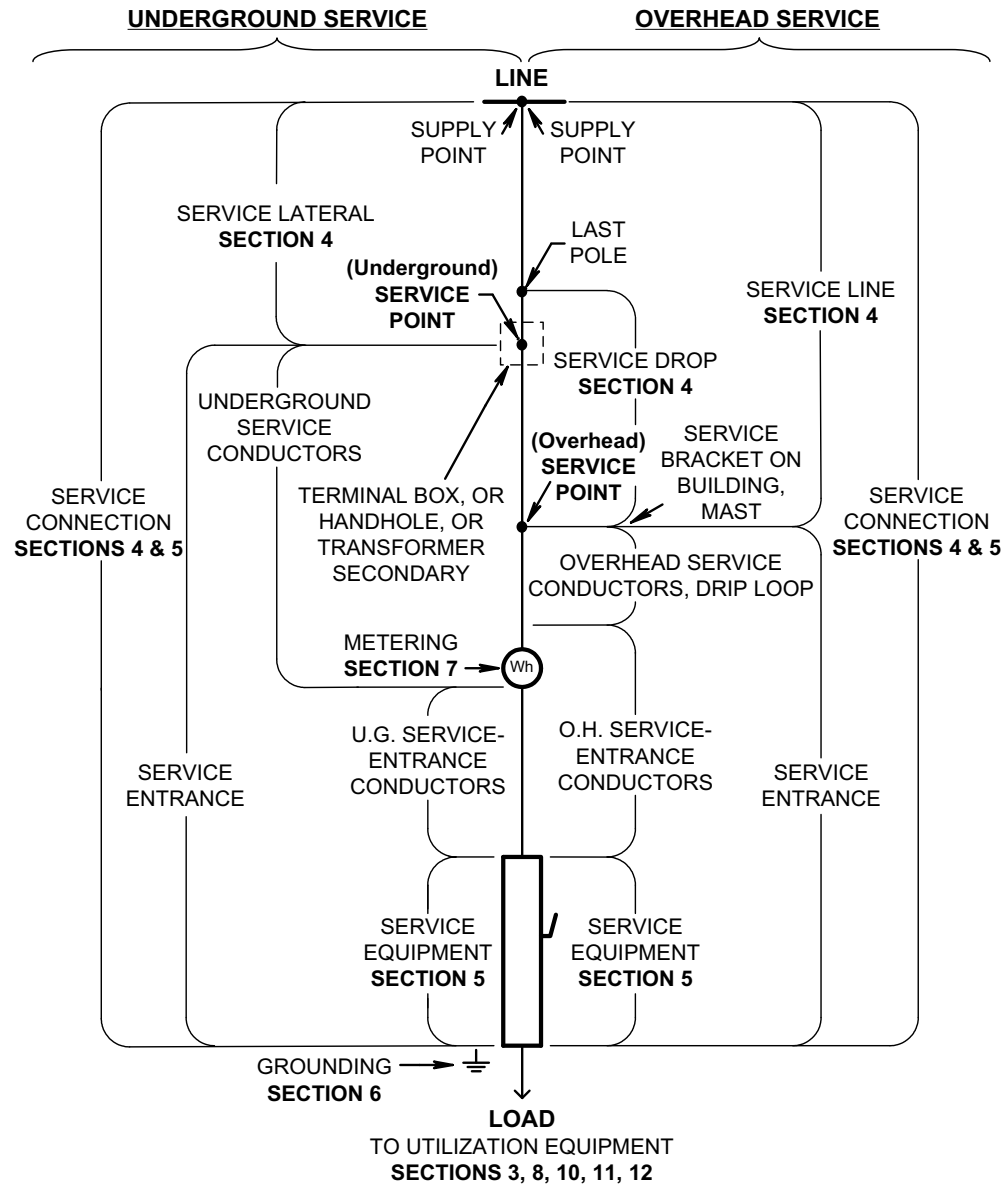

Applicant: Any entity (individual, firm, partnership, corporation, association, municipality, or governmental body) requesting a new service from the Company for their own use and not for resale or delivery to others.

Note: The Company must be consulted for specific Applicant rules as they apply in the Company's applicable tariff.

Area Lighting (Utility): A utility lighting distribution system that provides lumens on public or private property. (See NEC 90.2(A) where area lighting is not under the exclusive control of utilities and see the NESC for information that covers area lighting under the exclusive control of utilities.)


Authority Having Jurisdiction (AHJ): Governmental bodies or their Agent exercising legal jurisdiction over applicable codes.

Back-up Service: A service type provided during an unscheduled outage of the Customer's facility, up to the portion of Customer's electrical requirements supplied by the Customer's facility.

Building: A structure which stands alone or which is cut off from adjoining structures by approved fire walls with all openings therein protected by approved fire doors.

Clearance: Required separation mandated by codes or the Company.

Cold Sequence metering: Metering equipment located on the Customer's side of the service equipment.

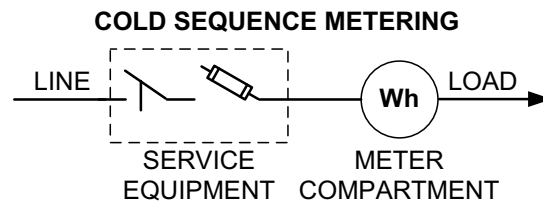

Company: The electric utility companies doing business as National Grid to which these requirements apply are:

- ▶ Granite State Electric Company
- ▶ Massachusetts Electric Company
- ▶ The Narragansett Electric Company
- ▶ Nantucket Electric Company
- ▶ Niagara Mohawk Power Corporation

Company Approval: Acceptance for the minimum requirements of National Grid exclusive of the Customer's obligation of complying with all applicable codes, statutes, rules or regulations. (See 1.10.1.)

Customer: An existing user of recurring electric service. (A contractor or developer performing work on behalf of a Customer is considered an agent of the Customer.)

Seasonal Customer: A Customer who applied for and receives the Company's service periodically each year, intermittently during the year, or at other irregular intervals.

Design Professional: A Professional Engineer (PE) licensed to practice in the state where service is being installed and who is directly retained by the Customer for that purpose. (If the state licensed PE is representing a multi-member design firm, the firm shall have state certification to practice professional engineering and a copy of such license must be provided to the Company upon request. Any Company requested design professional certification proof must be submitted to the Company in writing upon initial design submission.)

Distribution Line: A distribution line is an electric line, either overhead or underground, including the necessary and ancillary accessories to distribute electric energy, which may provide service to more than one customer. A distribution line may be located (1) in a street, highway, alley, or (2) on private right-of-way when used or useful to supply two or more customers at separate premises.

Drip Loop: Individual conductors formed to prevent the entrance of moisture, and which provide adequate length to meet the Company's and applicable code requirements.

Electrical Inspector: Inspectors external to the Company who are approved by the municipality in which they are working and recognized by the Company. Electrical Inspectors are responsible for ensuring that the installation complies with all applicable codes and Company requirements, service equipment, material, installations, and/or procedures.


Electric Service: Maintenance by the Company of the appropriate voltage and frequency at the point of delivery shall constitute the delivery of electric service to the Customer. (See Service.)
Emergency: An unplanned natural or accidental event that affects existing electric service.

Emergency Power System: A system legally required and classed as emergency by codes or any governmental agency having jurisdiction that automatically provides an independent reserve source of electricity, upon failure or outage of the normal power source, to elements of a power system essential to the safety of human life.

Exclusive Control: Generally covers installation, ownership, restricted access, operation, and maintenance by qualified and authorized persons.

Fire Wall: A wall separating buildings or subdividing a building to prevent the spread of fire and having a fire resistance rating and structural stability as determined and approved in writing by the AHJ.

Hot Sequence metering: Metering equipment located on the Company's side of the service equipment.

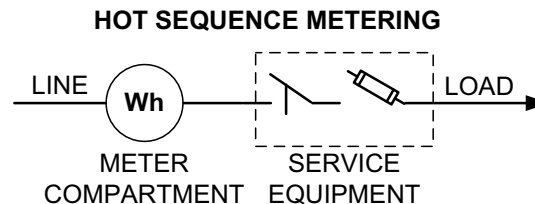

Line: A system of poles, conduit, wires, cables, transformers, fixtures and accessory equipment used for the distribution of electricity to the public. A line may be located: (1) in a street, highway, alley; or (2) on a private right-of-way when used or useful to supply two or more customers at separate premises.

Maintenance Service: A scheduled service for the Company to perform maintenance on the Customer's equipment, during a Customer's planned outage. Such service shall be pursuant to written agreement and, normally, scheduled at least one month in advance with the Company.

Manufactured Home: A factory assembled structure or structures transportable and designed to be used as a dwelling unit with a permanent foundation acceptable to the local AHJ.

Mobile Home: A factory assembled structure or structures transportable on their own running gear and designed to be used as a dwelling unit(s) without a permanent foundation.

Multiple Residential Occupancy Building: A structure, including row houses, enclosed within exterior walls or fire walls, which is built, erected and framed of component structural parts and is designed to contain four or more individual dwelling units for permanent residential occupancy.

Point of Attachment: The location of the service drop conductors to a building or structure provided by the Customer and installed to maintain clearances specified by the NEC (Article 230) and by the Company's requirements. (Service conductors are supported by mechanical attachment to the building or structure.)

Premise: A premise is a unified, undivided parcel of real property under the Customer or Applicant's control through ownership or lease which is not separated by a public road, right of way, or property belonging to another entity. A premise may or may not contain buildings or structures within the real property.

Premises: The land and buildings of the Customer located on the Customer's side of the service point.

Primary: The Company's distribution systems typically operating over 600 volts.

Recreational Vehicle: A vehicular type unit primarily designed as temporary living quarters for recreational, camping, or travel use, which either has its own motive power or is mounted on or drawn by another vehicle. These include: travel trailer, camping trailer, truck camper, and motor home.

Recreational Vehicle Park: Sometimes called "Trailer Park", is an accommodation for Recreational Vehicles where individual site occupancy is normally of short duration. Restricted Access by the Company. Areas where exclusive control by the Company is maintained.

Secondary: The Company's distribution systems typically operating at 600 volts or below.

Separately Derived System: A premises wiring system whose power is derived from another source of electricity and that has no direct electrical connection, including a solidly connected grounded circuit conductor, to the service.

Service: The conductors and equipment for delivering energy from the Company's distribution line to the wiring system of the Customer served. (*See Electric Service.*)

Residential Service: Service to one or more dwelling unit(s) providing complete and independent living facilities for one or more persons and which include permanent provisions for sleeping, cooking, and sanitation.

Non-Residential Service: All service types other than residential.

Service conductors: The conductors from the service point to the service equipment of the Customer supplied by the Company.

Overhead Service Conductors: The overhead conductors between the service point and the first point of connection to the service-entrance conductors at the building or other structure.

Underground Service Conductors: The underground conductors between the service point and the first point of connection to the service-entrance conductors in a terminal box, meter, or other enclosure, inside or outside the building wall. (Where there is no terminal box, meter, or other enclosure, the point of connection is considered to be the point of entrance of the service conductors into the building. Underground service conductors are not supplied by the Company.)

Service connection: One service lateral or service line and its associated service entrance.

Service drop: The overhead conductors between the last pole or other aerial support of the Company's electric supply line up to and including the splices connecting to the service point's service entrance conductors at the building or other structure.

Service entrance: That part of the Customer's wiring from the point of attachment or termination of the service lateral or service line to and including the service equipment.

Service entrance conductors: The wires or cables between the service conductors and the service equipment.

Overhead System Service-Entrance Conductors: The service conductors between the terminals of the service equipment and a point usually outside the building, clear of building walls, where joined by tap or splice to the service drop or overhead service conductors.

Underground System Service-Entrance Conductors: The service conductors between the terminals of the service equipment and the point of connection to the service lateral or underground service conductors. (Where service equipment is located outside the building walls, there may be no service-entrance conductors or they may be entirely outside the building.)

Service equipment: The Customer's necessary disconnecting and protective equipment intended to constitute the main control and cutoff of the supply from the service point. This consists of a circuit breaker(s) or switch(es) and fuse(s) and their accessories connected to the load end of service conductors. The service overcurrent device shall be an integral part of the service disconnecting means or shall be located immediately adjacent thereto.

Service Head: For cable in conduit risers, a service head is one that is raintight and listed for the purpose for preventing water from entering service entrance conductors, raceway, or equipment.

Service line or lateral: The Company's electric line including the necessary and ancillary accessories to connect a distribution line to an individual customer's meter or point of attachment. (A service line or service lateral, at the Company's discretion, may be connected to two or more meters at a single premise. Wiring along the outside of the Customer's house or building shall not be included in the service line or service lateral.)

Service line: The overhead conductors between the utility electric supply system and the service point. (A service line does include a service drop.)

Service lateral: The underground conductors between the utility electric supply system and the service point.

Service Point: The point of connection between the facilities of the Company and the Customer's premises wiring. (The service point can be described as the point of demarcation between where the serving utility ends and the premises wiring begins. The serving utility generally specifies the location of the service point based on their conditions of service. Refer to Figures 1.5-1 and 2-1.)

Service Riser Mast: A rigid metal conduit containing service entrance conductors that supports the service drop to maintain required vertical clearance.

Service Riser Pole: The Company's pole where the Customer's underground service conductors emerge to connect to the Company's overhead distribution line or transformer.

Short-term service: A service that is recurrently required only for short periods each time, either periodically each year, intermittently during the year, or at other irregular intervals.

Standby Power System: An alternate source of electricity incorporating necessary transfer equipment intended to supply power to selected loads upon loss of the normal power supply.

Supervised Installation: Conditions of maintenance and supervision ensure that only qualified persons monitor and service the system continuously provided by a single building management.

Supplemental Service: A service type provided to meet the Customer's electrical requirements in excess of on-site generation.

Supply Point: The point of connection of the Company's service lateral or service line and the facilities of the Company.

Temporary Service: A non-recurring service intended to be used for a short time only, not to exceed one year for residential or two years for commercial applications. (Temporary service can be to a non-permanent structure or personal property, or to a building or structure which is non-permanent in that it may be readily removed or relocated, or as a preliminary connection toward the establishment of permanent service.)

Underground Commercial Distribution (UCD): An underground electrical supply system using at-grade transformers and switchgear to serve commercial or industrial customers.

Underground Residential Distribution (URD): An underground electrical supply system using at-grade transformers and switchgear to serve five or more residential customers.

Utilization Equipment: An electrical installation that uses electric or light energy for electronic, electromechanical, chemical, heating, lighting, testing, communication, signaling, or similar purposes on the premises wiring side of the service point. (Performed under the NEC.)

Weatherhead: A weatherhead for service entrance cable installations is a manufactured raintight service head listed for the purpose as permitted according to the NEC.

3.0 GENERAL SERVICE CONNECTION REQUIREMENTS

3.1 APPLICATION FOR SERVICE

3.1.1 Application

Application for a new or changed service may ordinarily be made by mail, facsimile, telephone call to the Company, or by means of the Company's Internet Web site. Refer to the "Process and Information" section at the beginning of this book. Written application will be required when a service is taken from a line extension or when otherwise mandated by the provisions of the applicable tariff.

An applicant must make a separate application for each point of delivery and metering point, and for each class of service desired. That is, for each separate residence, apartment, business, building, structure, or premise where electric service is desired, a separate application is required. The Company will extend facilities to "premises" specifically identified on municipal tax maps.

Application should be made as far as possible in advance of the date the new or changed service is required to assure time for engineering, ordering of material, and construction. Delivery of equipment, depending on size and voltage rating, may take considerable time. A plot plan designating the location of buildings or additions should be provided with new electric load data.

3.1.2 Public grants and special permits

In many cases, public grants or special permits must be obtained by the Company from the local governmental authority where it is required that a service be run over, under, or along a public way. In some instances these grants and permits can be obtained only after public hearings are held. In such cases, delays in service connections can be avoided or curtailed by applying to the Company for service at the earliest possible date.

3.1.3 Easements

As a condition of service, the Applicant or Customer must provide the Company with an easement(s), properly executed by all owners of record drafted by the Company, for all Company owned facilities located on private property (to include User or Private Roads (NY) and Private Ways (MA, NH, RI)), whether or not such private property is owned by the Customer. The Applicant or Customer will provide such easement(s) prior to the start of the Company's construction and at no cost to the Company. The Applicant or Customer shall provide a copy of its mortgage and deed, together with a copy of the survey and/or plan of record, for the Company's use in preparation of the easement(s) as well as any other documents necessary for the Company to prepare such easement(s).

3.2 NUMBER OF SERVICES

3.2.1 With Respect to Building and Premise

One alternating current service will normally be installed to a building or structure on a premise.

3.2.2 Electricity Delivered Through More Than One Meter

Where electricity is delivered through more than one meter, the cost of service delivered through each meter will be computed separately.

3.2.3 Multiple Service Requests

Multiple service requests, by their nature, often impose complex issues with respect to state laws and the Company's obligations. For these requests the concepts of premise, building, and necessity, need to be evaluated individually. These key considerations require a prospective Customer contemplating such a multiple service request to contact the Company prior to proceeding with either a formal electric service request or project plans assuming such an arrangement. Even if approved by the AHJ, the Company will make the final determination as to whether multiple services will be permitted. To aid in the assessment of the above items, the Customer shall provide written documentation from the local AHJ over building and electrical codes indicating that the building or structure under consideration is approved by the AHJ for a multiple electric service arrangement. At a minimum, the AHJ's written approval shall state suitability in accordance with all provisions in effect of the applicable Fire Prevention and Building Code and National Electrical Code including local ordinances.

When the above documentation has been received and the Company approves of a multiple electric service arrangement, the Company will provide specific requirements for each service point. The Company recommends the Customer consult its building insurance carrier regarding the potential liabilities associated with specific multiple service point proposals.

In addition, as required by the Company's applicable tariff, the Customer shall reimburse the Company for any distribution facilities requested for the Customer's convenience that the Company deems to be over and beyond what is necessary in order to provide service to the Customer. The Company is under no obligation, however, to provide such facilities. Mutual agreement is required between the Customer and the Company. The Company will provide estimates for any cost contribution required for providing additional service(s) in accordance with its applicable tariff. A construction advance may be required. If a Customer desires more than one service in order to separately meter another building on the same premise, and if this building could otherwise be supplied through the one meter and if the Company allows such additional service, the Customer shall pay the entire cost of installing the additional service according to the Company's applicable tariff.

3.3 TEMPORARY SERVICE

3.3.1 Company Facilities

Temporary service facilities may include a line extension, a service lateral, installation of transformers, meter facilities, and other work by the Company. Examples of temporary service are those supplied to non-permanent structures, during the construction of permanent structures or projects, or for short-term service to carnivals, exhibits, decorative lighting, etc. Customer installations considered unsafe by the Company will not be energized.

3.3.2 Location

The temporary structure shall, whenever possible, be located adjacent to the permanent building so that the service may be transferred to the point of permanent attachment when the construction is completed. Typical overhead and underground temporary services are shown in Section 4.

3.3.3 Equipment

Service entrance, meter and other wiring on temporary installations are to be installed in the same manner as required for permanent installation with respect to service-drop clearances, metering, grounding, and safety. Service entrance equipment shall be installed on a structure; see Sections 4 and 5. Inspections and approval by an authorized inspection organization shall be required prior to the Company making the service connection. The Customer shall be required to provide a substantial and adequate support, guyed if necessary.

3.3.4 Duration

Temporary service shall be permitted for holiday decorative lighting, carnivals, and for similar purposes for the ninety (90) day period permitted by the NEC. Temporary service for residential home construction shall be permitted for a period not to exceed one (1) year or two (2) years for commercial construction depending upon the applicable Company tariff.

When temporary service is a result of an emergency, the permanent service shall be re-certified according to these specifications by an authorized NEC inspector within five (5) business days.

3.3.5 Cost

In accordance with the Company's applicable tariff, the Customer may be required to pay in advance the estimated cost of installing and removing the temporary service. Estimates of the cost for temporary service to commercial and industrial installations may be obtained from the Company's Customer Order Fulfillment (or the Account Manager, if applicable). If any such installation presents unusual difficulties as to metering the service supplied, the Company may estimate consumption for purposes of applying the rates as set forth in the applicable Company tariff.

3.4 ACCESS

In accepting service, the Customer grants to identified Company employees and agents the right of personnel, vehicle, and equipment access to the Customer's premises at all reasonable times for such purposes as the reading of meters, inspection of meters, and installing, operating, maintaining, disconnecting and removing, any or all of the property belonging to the Company. Such access shall be suitable for its intended purpose.

When the Company's conductors supply a building or structure, these conductors shall not pass beneath or through the interior of another building or structure. Any Customer building or structure shall not encroach on the Company's line conductors and line equipment, except where transformer vaults are installed within the building served.

The Company may discontinue service after reasonable notice, if access to its meters or other equipment is unreasonably refused, obstructed, or hazardous. The Customer may also be assessed a charge if access is prevented or hindered.

3.5 IDENTIFICATION OF EMPLOYEES

Employees of the Company, or its agents, authorized to visit the premises of its Customers, are furnished with photographic Company identification, which they will show upon request.

3.6 CHARACTER OF SERVICE

The Customer shall inquire of the Company as to the type of service to be supplied prior to the purchase of electrical equipment or before proceeding with its wiring installation. In response to such inquiry, the Company will designate the type of service and delivery voltage based on the location of the Customer and the size and character of its proposed load. Special consideration will be given to the selection of the type of service to supply electric motors, furnaces, welders, x-ray apparatus and other loads, which may interfere with satisfactory service to other customers. Normally only one service is provided to a premise. For multiple services to a building see Section 3.2.

3.7 VOLTAGES AVAILABLE

3.7.1 Available Services

All new services will be 60 Hertz, single phase or three phase alternating current designated by the Company. The following types of service in Table 3.7.1-1 are generally standard but not all types are available at all locations. To find which are available, please consult the Company. This must be done before any wiring is installed or equipment purchased.

To serve residential, commercial and industrial loads, one of the voltage services 600 volts and less, listed in Table 3.7.1-1, will be supplied at the Company's designation.

Table 3.7.1-1 - Available Services Below 600 volts

Phases	Wires	Company's Delivery Voltage (volts)	Company's Typical Voltage Delivery Levels		Note
			Minimum Customer Load (kVA)	Maximum Customer Load (kVA)	
1	3	120/240	None	100	1.
1	3	120/208	None	20	2.
1	3	277/480	None	50	3.
3	4	208 wye/120	None	300	4.

For the latest authorized version, please refer to the company's website at <http://www.nationalgridus.com/electricalspecifications>. 37

Phases	Wires	Company's Delivery Voltage (volts)	Company's Typical Voltage Delivery Levels		Note
			Minimum Customer Load (kVA)	Maximum Customer Load (kVA)	
3	4	208 wye/120	None	1000	
3	4	480 wye/277	None	500	4.
3	4	480 wye/277	None	2500	5.

Notes to Table 3.7.1-1:

1. Single-phase, 120/240 volt service is limited to 50 kVA maximum where utilization equipment includes individual motors not over 6-1/2 HP. Self-contained meter socket applications are limited to 72kW demand.
2. Where the present service is three phase, 4 wire, 208 wye/120 volts. Exception: In Network areas where standard service voltage is three-phase, 4 wire, 208 wye/120 volts, demand for single-phase service 120/208 volts is not to exceed either (a) 60 kVA for the Upstate New York area or (b) 20 kVA for the areas in Massachusetts, New Hampshire, and Rhode Island.
3. Where the present service is three phase, 4 wire, 480 wye/277 volts. Three-phase, 4 wire, 480 wye/277 volts is Commercial and Industrial use only.
4. Where supplied by cluster mounted overhead transformers at the Company's discretion; see Section 9.2.1. Demand of 150kVA or more is generally preferred to be supplied by a pad mounted transformer service. Three-phase service normally will not be made available for a residence.
5. With the exception of network service, transformer vault services are limited to 1500 kVA at 480 wye/277 volts.

For both new applicants and existing customers, the Applicant or Customer shall submit a written request that includes its proposed in-service date, connected load, diversified demand, and load factor information. Refer to the "Process and Information" section at the beginning of this book. Customers having the potential to exceed 75 kVA of transformer capacity may be required to supply space for electrical equipment on private property in accordance with the Company's Terms and Conditions; see Sections 4 and 9. Where three-phase secondary service is requested and available and the minimum Customer load is less than 50 kVA, the Customer may be required to contribute to the supply facilities' installation cost according to the Company's tariff in the specific service area.

For service above 600 volts, the Company will solely designate the type of service based on the location of the Applicant or Customer and the size and character of the proposed load. Please consult the Company early in the planning process to determine the specified delivery voltage. In Upstate NY, maximum demand can be limited by specific supply circuit conditions under the Company's tariff, PSC No. 220. An Applicant or existing Customer in Upstate NY with large quantifiable needs on a distribution system greater than the Company's specified limit will require a service of higher voltage characteristics offered in PSC No. 220 to efficiently and effectively manage the load supplied by the utility electric system meeting the public needs of more than one customer. Evaluation according to Rules 4.4 and 44 in PSC No. 220 permits the Company to determine and specify the delivery voltage to the Applicant or Customer in Upstate NY. In addition, see Section 3.8 for services no longer standard.

3.7.2 New Customers (Applicants)

The delivery voltage for service to a new Customer is determined based on engineering considerations such as system loading, location of electric supplies, reliability, circuit protection and coordination, planning, operation and maintenance.

3.7.3 Existing Customers

3.7.3.1 Customer Expansion

The new delivery voltage for service to an existing Customer contemplating an expansion that will result in a maximum customer peak demand greater than the limit specified in Table 3.7.1-1, is determined based

on engineering considerations such as system loading, location of electric supplies, reliability, circuit protection and coordination, planning, operation and maintenance. The Customer shall reimburse the Company as set forth in the applicable Company tariff.

3.7.3.2 Voltage Migration at Customer's Request

Voltage migration may be permitted upon written request to the Company, provided: (1) such increase in delivery voltage shall be allowed only when in the Company's sole judgment, system or facility loading, reliability and safety will not be jeopardized; and (2) the provisions of the Company's applicable tariff shall apply to any such increase in delivery voltage requested by the Customer.

3.7.3.3 Voltage Migration at Company's Request

When, in the Company's sole judgment, and consistent with the Company's applicable tariffs, the Company determines that changes in delivery voltage are necessary to alleviate system or facility loading, reliability or safety problems, the Company will make such changes and will be responsible for the associated costs.

3.8 SERVICES NO LONGER STANDARD

Non-standard services include, but are not limited to: 25 Hertz, 2 phase systems, 2 wire 120 volts, 240 volts delta, 460 volts wye, 480 volts delta, 600 volts delta, 2400 volts, 4160 volts or 4800 volts services. While 2400 volts, 4160 volts, or 4800 volts are no longer standard, they may still be available at certain locations; consult the Company.

Customers now receiving non-standard service shall not expand the use of such service, except in very limited circumstances at the sole discretion of the Company.

Customers with an existing non-standard service requesting a service change shall consult with the Company to obtain a standard single or three phase 60 Hertz service at an appropriate delivery voltage.

3.9 LOAD BALANCE

The Customer, in taking electric service, shall connect its lighting and other loads so as to maintain as nearly as is reasonably possible, equal current in each of the line conductors at the point of delivery. Voltage unbalance resulting from unbalanced currents shall not exceed 2% or shall not cause objectionable effects upon or interference with the operation of the Company's facilities and service to others. The Company may require the Customer to install any necessary operating and safety equipment in accordance with the requirements and specifications of the Company, provided such installation does not conflict with applicable electrical codes, federal, state or municipal law. The Customer is responsible for bearing the cost of any changes necessary to correct an unbalanced load condition.

3.10 INCREASE IN SERVICE

Company facilities are normally designed to meet the Customer's initial electric demand requirements at the time service is installed. The Customer shall provide the Company reasonable advance written notice of any proposed increase in service required. This notice shall include the amount and character of the proposed increased service, including the timing, frequency, and duration of the peak load, as well as the date the increased load will be required. Load increases requiring changes to the supply facilities (other than metering equipment) for the sole use of the Customer may require a contribution to the Company in accordance with the Company's applicable tariff. See previous Section 3.7. The Customer shall not make additions unless the Company has notified the Customer that it can supply the increased load.

3.11 UNAUTHORIZED ATTACHMENTS

The Company forbids any unauthorized attachments to its poles and towers, such as banners, signs, clothes lines, antennas, basketball hoops, lighting fixtures, etc. It forbids the use of any of its facilities for placards or other advertising materials. The Company will remove any such unauthorized attachments without notice and may prosecute such trespassing.

The Company forbids any work by contractors on or in any of its facilities without prior written authorization by the Company.

The attachment of antenna systems to Customer-owned electric service masts or poles carrying the Company's conductors is strictly prohibited due to the possibility of serious results from accidental contacts. Such attachments will be removed immediately upon discovery by the Company, and the removal will be at the Customer's expense.

3.12 DISCONTINUANCE OF SERVICE

The Company may discontinue service where the Customer's equipment or its operation is deemed to be unsafe or results in objectionable effects on the operation of the Company's facilities or its other customers, consistent with the procedures set forth in the Company's applicable tariff. Reconnection of service will occur after the Customer has made the required corrections at its cost. See also Section 10.

Part B – “Electric Service Requirements”

4.0 SERVICE CONNECTIONS

4.1 GENERAL

Types of Service Connections

The Company offers the following service connections, depending on the Customer’s location, character of service, and expected electrical demand:

- ▶ Overhead Secondary Voltage Service Connection (Under 600V)
- ▶ Overhead Primary Voltage Service Connection (from 2.4kV to 34.5kV inclusive)
- ▶ Overhead Transmission Voltage Service Connection
- ▶ Underground Secondary Voltage Service Connection (Under 600V)
- ▶ Underground Primary Voltage Service Connection (from 2.4kV to 34.5kV inclusive)
- ▶ Underground Transmission Voltage Service Connection

Definitions to be familiar with from Section 2:

Line	Primary
Emergency System	Service Point
Multiple Residential Occupancy Building	Supply Point
Service Connection	Service Equipment
Service Drop	Temporary Service
Service Lateral	URD
Service Line	UCD

4.1.1 Rights-of-Way, Easements

See Section 3.1.3 for property rights as a condition of service.

In UCD, URD, or multiple occupancy building applications, the Customer shall provide the Company with two copies of the approved development map, certified as final by a design professional or licensed land surveyor, which the plan shall have been recorded or filed with the Registry of Deeds. The map shall indicate lot lines, building setback lines, grade lines, sidewalk, roadway, sewer, water, drainage, and other facilities. The map shall also include the identification and, where appropriate, delineation of sensitive environmental resources including, but not limited to, wetlands, streams, archaeologically sensitive areas, and hazardous waste disposal areas, etc. In addition to this base information, this map shall clearly indicate the easement strips dedicated to the Company and the location of the lots (units) for which electric service is requested. The governmental authority having control over land use shall approve this map. In addition, when electronic maps are used, the Customer must consult the Company for submittal.

Rights-of-way and easements must be cleared of any obstructions at no charge to the Company. The applicant shall grade the right-of-way or easement to within six inches (150 mm) of final grade before the Company commences construction. The applicant must maintain the Company’s clearance and grading requirements.

4.1.2 Number, Routing and Location of Service Laterals or Service Lines

The Company will designate the number of service laterals or service lines required to provide service to a Customer. Normally, the Company runs only one service lateral or service line to a Customer. Service laterals or service lines will not be run from building to building. The Company will designate the location from which the service will be taken, the type of construction to be employed, the routing of the service lateral or service line, and the service point location. The Company will consider appearance, accessibility, available right-of-way, and the desires of the Customer in making this decision.

4.1.3 Relocation of Service Laterals

When electric service relocation is at the request of the Customer, all costs associated with the relocation of the service lateral on both private and public land shall be borne by the Customer.

When the service lateral relocation is the result of an order by a public authority, the Customer shall pay for that portion of the cost associated with the service lateral movement on private property. In some instances, the public authority may compensate the Customer for this expense.

When the pole from which a customer-owned underground service lateral originates must be replaced it is the Customer's responsibility to move its service lateral to the new pole location at its sole expense. For a customer-owned electric service lateral needing relocation, it is the Customer's responsibility to arrange with its contractor to move its service lateral. This responsibility includes coordination of this relocation with the Company and inspection of the newly relocated service lateral by an authorized electrical inspector.

Company-owned facilities involved with any relocation will be the responsibility of the Company.

4.1.4 Allowable Voltage Drop

The Company recommends that the Customer's conductors from the service point to the main service equipment (see Figure 2-1) be sized to limit voltage drop to 1%. Normally, the Company's voltage range measured at the service point for service below 600 volts is between 114 volts and 123 volts on a 120-volt AC base within the Company's Upstate NY service territory, and between 114 volts and 126 volts within the Company's MA, NH, and RI service territories. It is the Customer's responsibility to maintain adequate voltage beyond the service point.

4.1.5 Minimum Size-Single Phase Service Connections

A new single-phase service connection for an installation of one meter shall have a current carrying capacity of not less than 100 amperes, and for an installation of more than one meter not less than 150 amperes. The Company, in its sole discretion may also allow non-dwelling type installations such as, but not limited to CATV equipment, signs, and service to traffic control systems to be a minimum of 30 amperes. The Company may grant an exception in writing if the Company determines adequate service facilities are assured. The Company recommends ampere capacities greater than the National Electrical Code's required minimum, when significant future load increases are expected.

4.1.6 Service Conductor Splicing

Service conductors may be spliced in accordance with the National Electrical Code (NEC) except for the following situations:

- ▶ above grade on Company pole unless in the supply space at transformer by Company,
- ▶ within meter socket enclosure,
- ▶ within conduits on pole, and
- ▶ inside of a building unless approved by the NEC.

Where extensions within a secondary transformer compartment or within a Customer vault are necessary, splicing is done by either the Company or the Customer depending on the application: for single-phase pad-mounted transformers, splicing is done by the Company; for three-phase pad-mounted transformers and vault installations, splicing is done by the Customer.

4.1.7 Routing of Metered and Unmetered Conductors

Metered and unmetered conductors of any voltage shall not be installed in the same raceway, auxiliary gutters and/or pull boxes. Where unmetered conductors are run through the Customer's premises, they shall be enclosed in a continuous run of (threaded) rigid metal conduit with no conduit bodies, or in service busway, or in concrete-encased ductline (which may be required by the AHJ for certain situations). The installation of pull boxes or other similar devices is only permitted on unmetered raceways on the Customer's premises with the Company's written approval.

Where unmetered plug-in type armor-clad busway is used to serve customers in the same building, all plug-in access openings shall be provided with a steel hasp assembly for the Company's padlocking of the hinged hood in the closed position.

The sealing of unmetered raceways with lead-wire or padlock type meter seals is not permitted by the Company.


4.1.8 Inhibiting Grease

Caution: Inhibiting grease shall not be applied on meter socket jaws or meter blades.

4.1.9 Electric and Gas Meter Clearances

Electric meters for newly installed services shall be located outdoors, unless permitted by the Company in certain limited circumstances. Electric meters shall not be located above or below gas regulating vents and must maintain a minimum 36" horizontal distance from a gas regulating vent. In all cases, the Gas Service Provider shall be consulted regarding the location of gas meters near electric meters or electrical equipment.

Figure 4.1.9-1 Electric Meter to Gas Meter Clearances

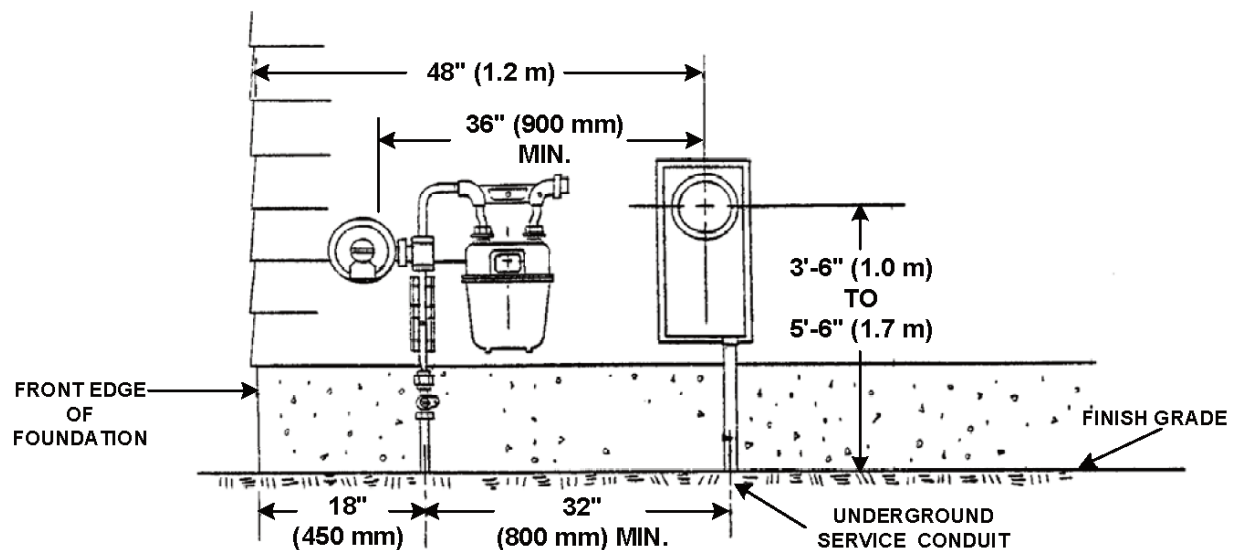


4.1.10 Temporary Service

Temporary service may include the installation of a line extension, service lateral or service line, setting meters or other extra work by the Company. The Customer may be required to pay, in advance, the entire cost of the temporary service including removal of the temporary service; see Section 3.3. Temporary service is generally provided as an overhead secondary service voltage connection. The Customer will provide, as the point of attachment, either:

- ▶ A properly guyed wood pole or a building on which the service bracket can be attached. The wood pole shall be ANSI Class 7 minimum, pressure treated and of sufficient height to provide proper ground clearance for conductors. This installed pole shall be safe for climbing. Where a 25 ft. (7.5 m) pole is permitted, a 5 ft. (1.5 m) minimum burial depth is required. Installations determined to be unsafe by the Company shall not be energized. The span for the service drop shall not exceed 150 feet (45 m). Temporary service drops shall not be attached to construction trailers. This arrangement is shown in Figure 4.1.10-1 below.

Figure 4.1.10-1 Typical Overhead Service Pole for Permanent or Temporary Service Below 600V

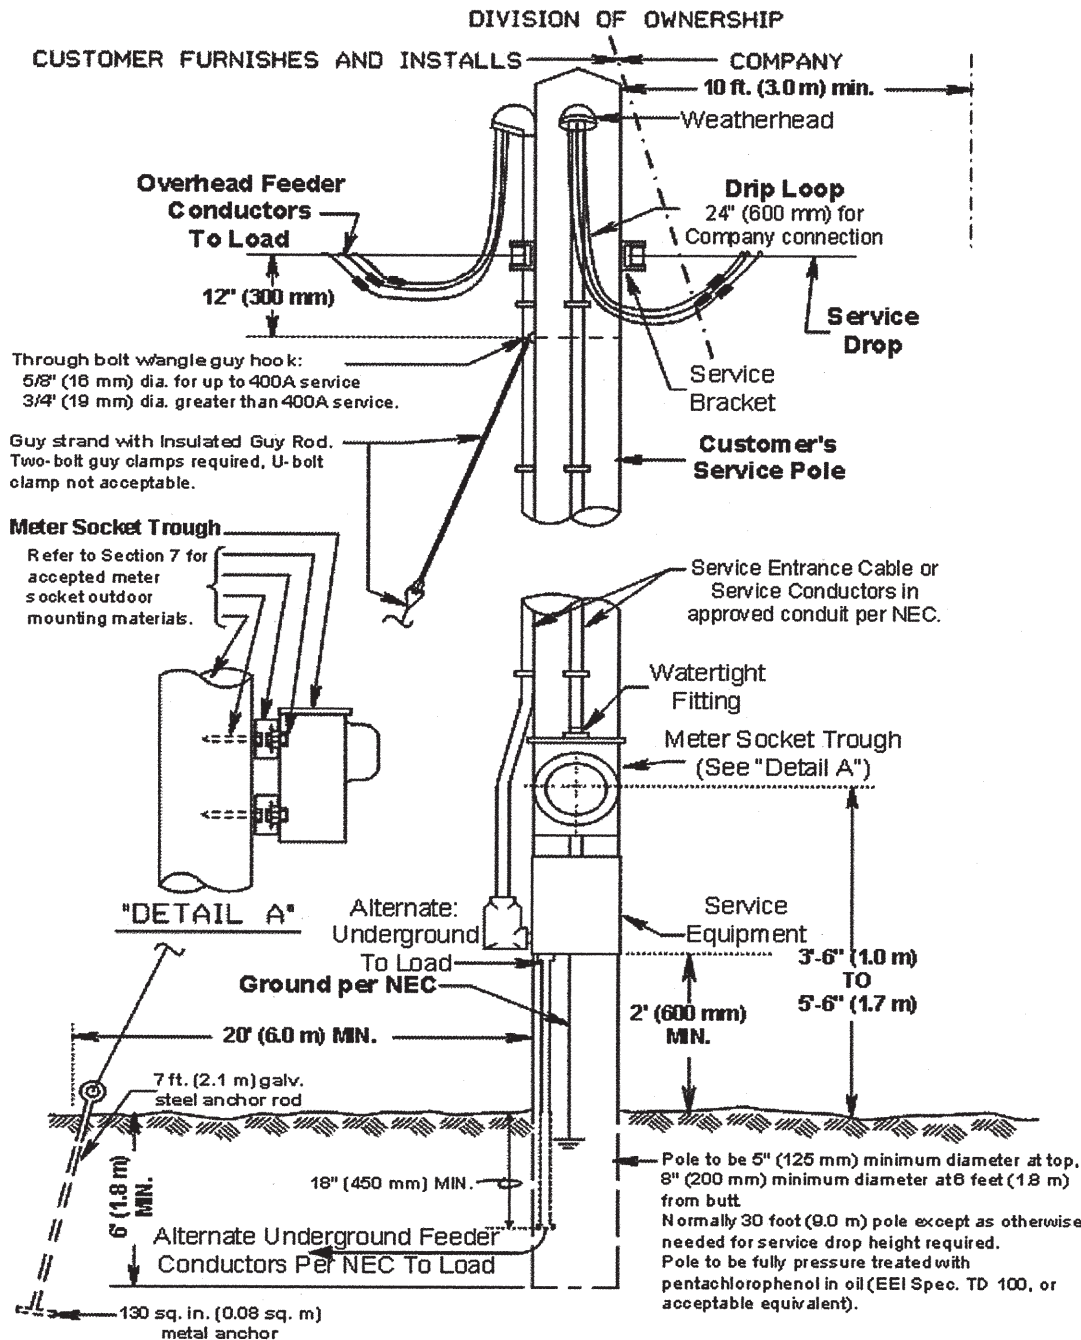

- For an alternate temporary overhead service arrangement, a 6" (150 mm) X 6" (150 mm) foundation grade treated post with cross bracing as shown in Figure 4.1.10-2 below may be permitted.

6" (150 mm) x 6" (150 mm) Nominal x 18' (5.5 m) min.
 Alternate (4) 2" (50 mm) x 6" (150 mm)
 nominal x 18' (5.5 m) assembled with Galvanized
 20D nails or equivalent use of deck screws.
 Pressure treated recommended.

Service Drop

14'-6" (4.45 m) Min.

By utility

Drip Loop

6" (150 mm)

6" (150 mm)

SE cable & weatherhead

10' (3.0 m) Approx.

Meter socket

Rear brace in-line with service drop.

Service equipment with GFI according to

2" (50 mm) x 4" (100 mm) Nominal lumber brace

8' (2.5 m)

5' (1.5 m)

8' (2.5 m)

8' (2.5 m)

3' (900 mm)


#6 Bare copper min. ground wire, moulding, staples & ground rod. Grounding System installed according to NEC.

2" (50 mm) x 4" (100 mm) Nominal by 3' (900 mm) long stake press. treat

Grounding System installed according to NEC.

- For the latest authorized version, please refer to the company's website at <http://www.nationalgridus.com/electricalspecifications>. 45

Figure 4.1.10-3 Temporary Underground Service Below 600 volts

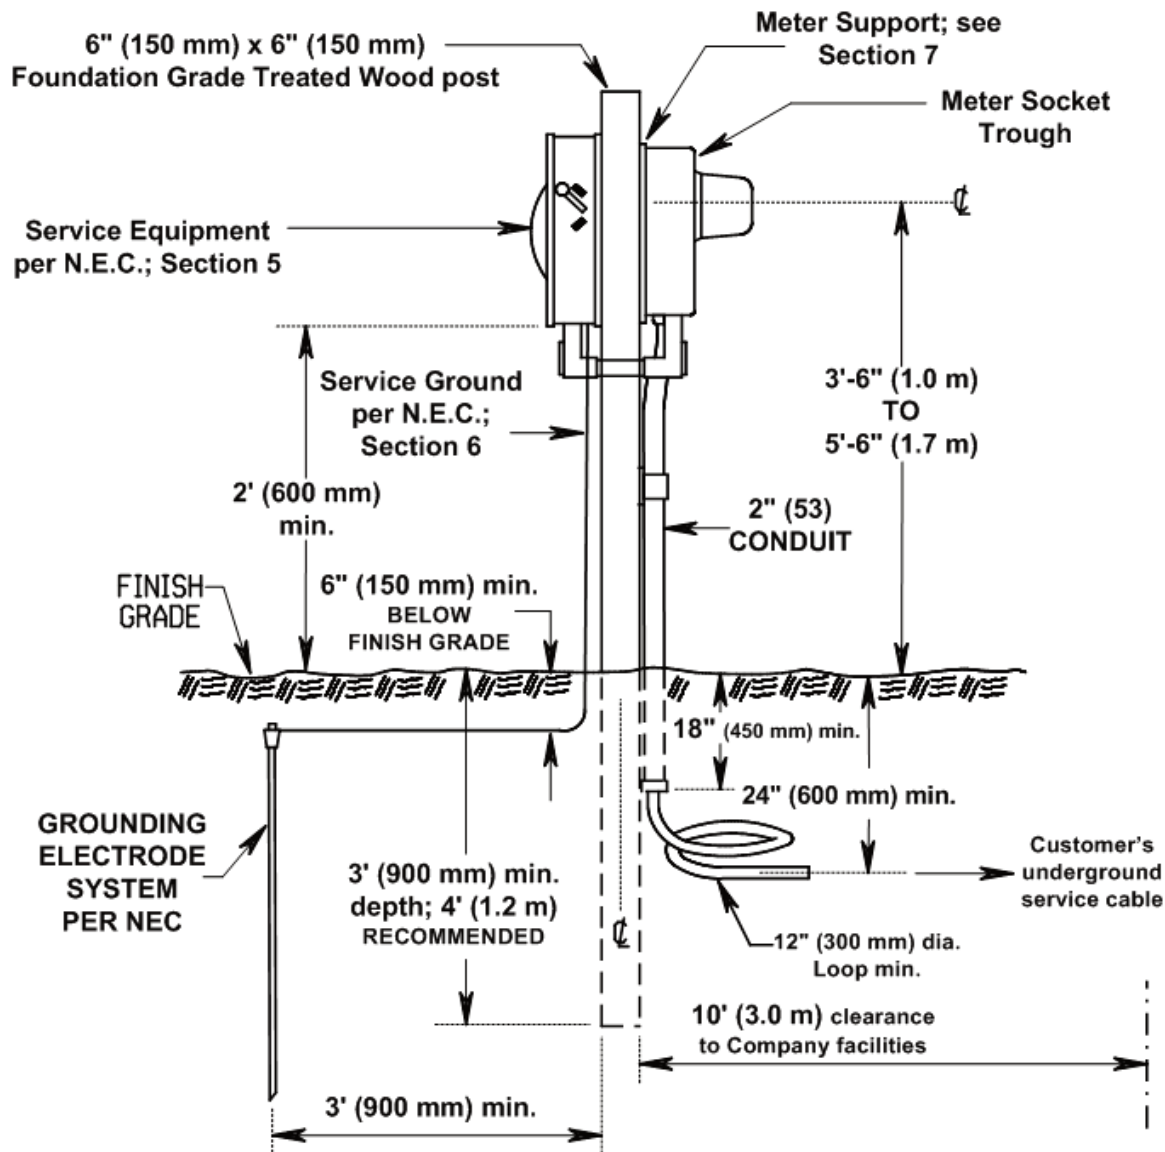

4.1.11 Fire Alarm and Emergency Systems

4.1.11.1 Fire Alarms

All fire alarm circuits shall be metered. If the authority having jurisdiction requires that the fire alarm service connection be ahead of the normal metering, then a second meter for the fire alarm shall be installed. Where self-contained meter sockets are applied, the meter socket provided by the Customer shall be equipped with a lever bypass. The Customer shall pay the entire cost of metering the fire alarm service.

4.1.11.2 Emergency Systems

Emergency systems may be served through the building's main service equipment or through separate main service equipment and separate metering, tapped ahead of the building's main service equipment. Due to NEC requirements for the continuous duty of emergency systems, these systems shall be instrument transformer metered only, and shall not be metered by self-contained meters. The Customer shall consult with the AHJ regarding specific requirements for emergency systems. The Customer shall pay the entire cost of separately metering the emergency system service.

4.1.12 Service to Manufactured and Mobile Homes, Mobile Home Parks, and Recreational Vehicle Parks

The provision of electric service to these types of structures present challenges to the Company and the Customer because general service drops and underground service laterals cannot be placed directly on the structure itself, but rather, must be metered and served through a remote meter assembly (meter pedestal or Customer service pole) and service equipment.


4.1.12.1 Service to Manufactured and Mobile Homes and Mobile Home Parks

Mobile home parks of certain sizes (number of lots) and within various locations may require the Company to comply with Underground Residential Development (URD) rules. These rules may differ by state. The Customer or Developer is urged to contact the Company prior to planning electric service to a new or expanding mobile home park to discuss the specific arrangements necessary to provide electric service consistent with the Company's applicable tariff.

When the Company determines that overhead service shall serve a single manufactured or mobile home, the Customer shall install a Customer service pole, as shown in Figure 4.1.10-1. When the Company determines that underground service shall serve a single manufactured or mobile home, the Customer shall install a service post shown in Figure 4.1.10-3 or meter pedestal as shown in Figure 7.3-8.

Depending on the arrangement and number of manufactured or mobile homes to be served, a meter board may be installed as shown in Figure 4.1.12.1-1 below and in Figure 7.3-10. This arrangement allows a number of metered manufactured/mobile homes to be served from the same service point, and to be metered in the same location. The Customer/Developer is cautioned to comply with the necessary load calculations as described within the National Electrical Code and to comply with the requirements as set forth by the local AHJ.

Figure 4.1.12.1-1 Typical Overhead Service Installation for Mobile Home Park

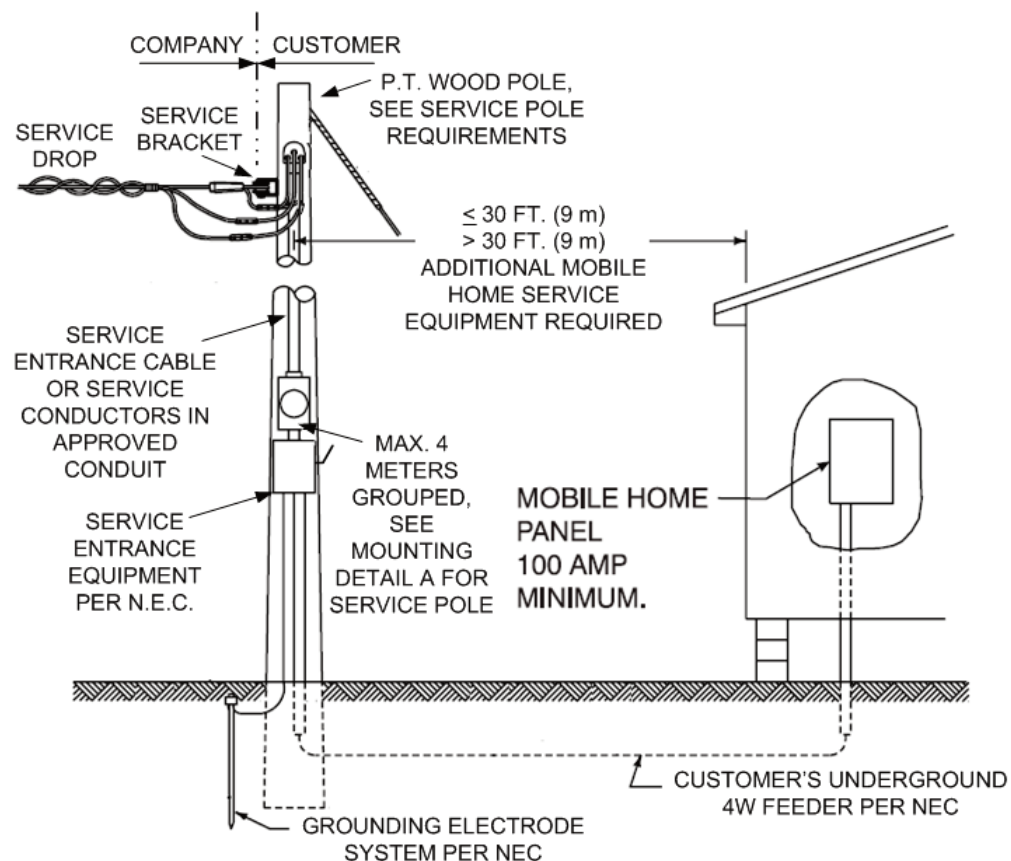

4.1.12.2 Service to Recreational Vehicle Parks

Electric service to Recreational Vehicle Parks shall be provided through one single service lateral or service line and one or more meters at a single location. Individual lots shall not be separately metered. The Customer/Developer shall comply with the NEC requirements regarding the distribution of its own electric service throughout the park. The Customer/Developer shall contact the Company regarding "Seasonal", "Temporary" or "Permanent" service types. See Section 2 for definitions and Section 3.3 for short-term and temporary service requirements.

4.2 OVERHEAD SECONDARY VOLTAGE SERVICE CONNECTION (UNDER 600V)


4.2.1 General

An example of a typical Company-provided secondary voltage overhead service is shown in Figure 4.2.1-1 below. The Company will construct, own and maintain all overhead service lines, that is, that portion of the supply circuit between the Company's secondary distribution line serving other customers and the service point in accordance with the Company's applicable tariff. Refer to Section 2 for the definition of the term service line.

An overhead service drop may be provided to supply services rated 800 amperes or less. No more than two sets of service entrance conductors, with their end terminations grouped at one location shall be connected to a service drop.

At single-phase installations where the anticipated demand as determined by the Company does not exceed 72 kVA, a self-contained meter shall be used; see Section 7. Where the anticipated single-phase demand exceeds 72 kVA, a current transformer installation shall be provided by the Company as indicated in Section 7. Where the anticipated demand exceeds 100 kVA, three-phase service is required.


Figure 4.2.1-1 Typical Overhead Service Installation under 600V

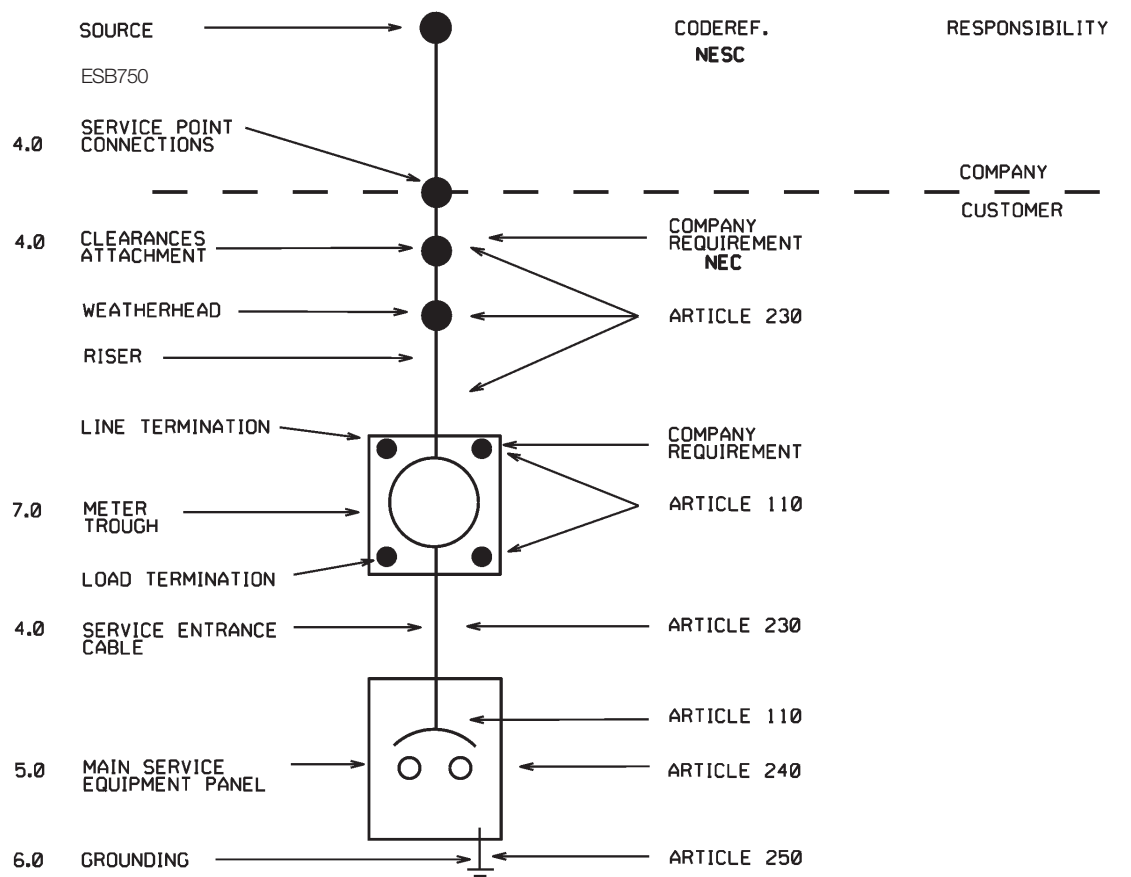

4.2.2 Service Attachment, Location

The Customer shall furnish, own, and install a 600 volt insulated service bracket assembly to which the Company's service drop will be attached; see Appendix 1. This assembly shall be properly affixed to a structural member of the supporting building, service pole, or riser mast, and capable of withstanding the tension shown in Table 4.2.4.3-1 for the size of the service being installed. Attachments to chimneys are not permitted. The service bracket shall be positioned below the service entrance conductor weather-head as shown in Figure 4.2.2-1.

Figure 4.2.2-1 Typical Residential Overhead Service under 300 volts and 400 amperes

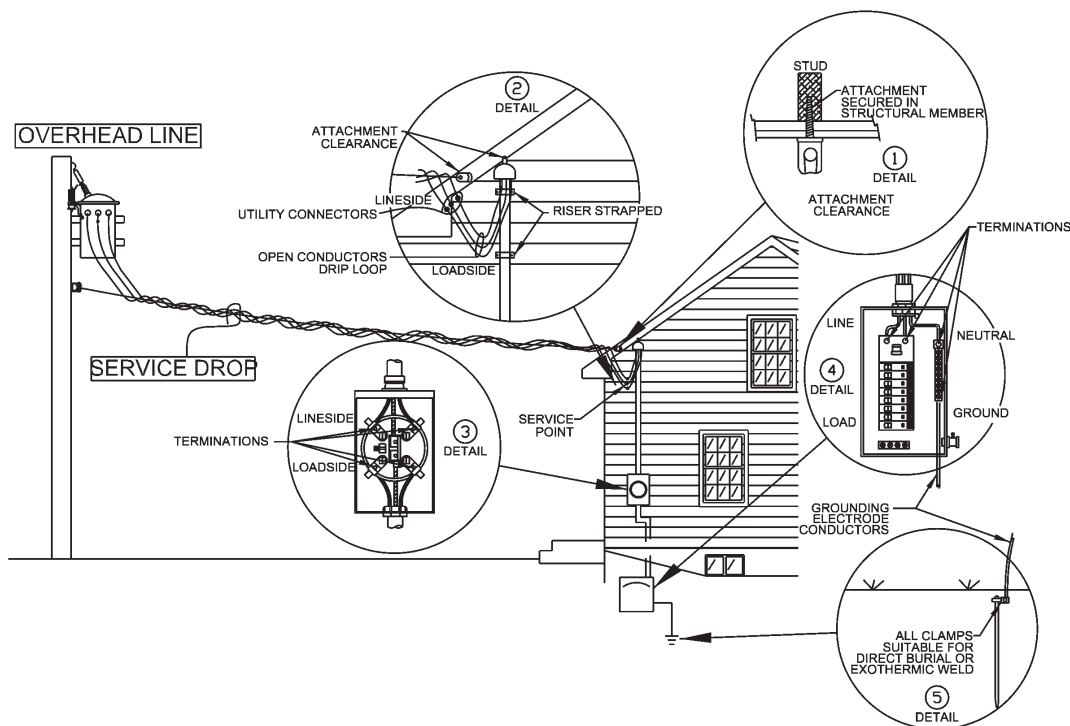

Notes to Figure 4.2.2-1:

1. **Point of Attachment** – 600 volt insulator installed at proper clearance. See Sections 4.2.4.1 and 4.2.4.2 and NEC Sections 230.24 and 230.26.
2. **Drip Loop** –
 - A. To prevent the entrance of moisture drip loops shall be formed on individual conductors. See Section 4 and NEC 230.54.
 - B. Open conductors' clearances from openings – See Section 4.2.4.1 and NEC 230.9.
3. **Meter Socket Trough** –
 - A. Location, Mounting, and Work Space – See Section 7 and NEC 110.26.
 - B. Independent Test Laboratory Certification – See Section 7.2 and NEC 110.3.
 - C. Service conductors connected in terminals – See Sections 7.2 and 7.3 and NEC Sections 110.14 and 312.5.
4. **Service Equipment (Main Disconnecting Means and Overcurrent Protection)** –
 - A. Main means to disconnect and protect from overcurrent all premises wiring conductors. See Section 5 and NEC Sections 230.70, 230.71, 230.72, 230.90, and 230.91.
 - B. Service conductors shall be connected to the service disconnecting means. See Sections 4 and 5 and NEC 230.81.

5. **Grounding and Bonding** – The service equipment shall be grounded. See Sections 5 and 6 and NEC Sections 250.4 and 250.24.
6. **Electrical Inspection by the AHJ** – Final inspection through inspector field verification and approval. See Section 1.9 and NEC Sections 90.4, 90.7, 110.2, and 110.3.
 - A. Inspection approval sticker on right side of meter socket trough. See Section 1.9 and NEC 110.2.
 - B. For third party inspection agencies, see utility agreement for electrical inspection agencies (in Upstate NY) and NFPA Electrical Inspection Manual. For other references see NFPA standards 73, 70B, and 70E.

4.2.3 Customer-owned Service Pole

On farms, or other locations, where several buildings or structures are under one ownership; and, where a single electric service point and billing meter are feasible (service rating, 800 ampere, maximum), a Customer furnished, installed, owned and maintained service pole, complete with billing meter and service equipment, may be permitted. A service pole shall be installed according to the requirements noted in the Figure 4.1.10-1. All materials and methods used shall not be less than those specified in the applicable figures. For a service drop greater than 30 feet (9.0 m), guying of the pole is required. The Company shall be consulted in each case to determine installation requirements.

4.2.4 Overhead Service Line Clearances

National Grid's overhead service line conductors must comply with the clearance requirements of the National Electrical Safety Code and National Grid's Overhead Construction Standards. The Customer's service bracket, located near the point of attachment, must be installed in such a location to allow for minimum clearance of overhead service line conductors to be met. Placement of swimming pools under existing overhead service line conductors is prohibited. Should a new service require placement over an existing swimming pool, the Company must be consulted to insure that minimum clearance requirements can be met. In all cases, the Company shall determine the location of the point of attachment.

4.2.4.1 General Overhead Service Line Clearances

The following general clearances are in effect for National Grid's overhead service line conductors:

Clearance Requirement	Effectively Grounded Neutral, Grounded Guys and Ungrounded Guys Exposed to 0 to 300V		0 to 750V Multiplex Supply Cables	
	(ft.)	(m)	(ft.)	(m)
Vertical clearance above roads, streets, alleys, parking lots, driveways and other areas subject to truck traffic.	17.0	5.2	17.5	5.4
Spaces and ways subject to pedestrians or restricted traffic only.	11.0	3.4	13.5	4.2
Vertical or diagonal clearances over or under roofs or projections not readily accessible to pedestrians.	4.5	1.4	5.0	1.6
Vertical or diagonal clearances over or under balconies or roofs readily accessible to pedestrians.	12.0	3.7	12.5	3.9
Maximum vertical height above ground to service drop drip loop from finished grade.	25.0	7.7	25.0	7.7
Any direction from eavestrough or downspout.	0.5	0.2	0.5	0.2
Clearance in any direction to unguarded windows or doors.	4.5	1.4	5.0	1.6
Vertical above window top and around non-opening windows (with no sag adders).	1.0	0.4	1.0	0.4

4.2.4.2 Clearances to Swimming Pools

Customers with noted clearance violations caused by the placement of an above ground or in-ground swimming pool will be responsible for the relocation of the swimming pool or the cost of relocation of overhead conductors to meet the Company's minimum clearance standards. Electric service will be discontinued if correction cannot be made within a reasonable time frame as determined by the Company, see Section 3.12.

Service lines within 25' (7.6 m) of the edge of the water surface of the swimming pool must meet the minimum requirements as described in the table below, otherwise, the standard clearance requirements above must be adhered to.

Clearance Requirement	Effectively Grounded Neutral, Grounded Guys and Ungrounded Guys Exposed to 0 to 300V		0 to 750V Multiplex Supply Cables	
	(ft.)	(m)	(ft.)	(m)
Clearance in any direction from the water level, edge of pool, base of diving platform, or anchored raft.	23.5	7.2	24.0	7.4
Clearance in any direction to the diving platform, tower, water slide or other fixed pool-related structures.	15.5	4.8	16.0	4.9


4.2.4.3 Service to Low Buildings

Where the Customer's building or structure is too low to serve as the attachment point for the service bracket, and clearances described by Section 4.2.4 cannot be met, the Company shall be consulted. When National Electrical Code and National Electrical Safety Code standards permit, the Customer can submit the matter to the Company which may approve the installation of the service bracket at an alternate point. As another alternative, the Customer may install a service "riser" to mount the service bracket at the required height. This service "riser" shall be galvanized rigid steel conduit or a galvanized structural steel member similar to the design shown in Figure 4.2.4.3-1. This service riser shall be capable of withstanding the service drop tensions in Table 4.2.4.3-1. The conduit for service riser masts shall be at least 2-1/2 inches (63). Where mast heights exceed the maximum heights allowed by Table 4.2.4.3-1, an anchor may be installed to resist the bending moment imposed by the wire as shown in the bottom of the table. Where clearance remains a problem, the Company recommends the Customer install an underground service lateral and service conductors as described in Section 4.5.

Table 4.2.4.3-1 - Galvanized Riser Mast Bracing Requirements

Galvanized Steel Riser Mast								
Maximum Unbraced Height From Roof to Attachment Bracket								
See Details in Figure 4.2.4.3-1.	Service Rating							
	1 Phase 200A & Below		3 Phase 150A		1 or 3 Phase 400A		3 Phase 800A	
	lb.	kN	lb.	kN	lb.	kN	lb.	kN
Service Cable Tension →	650	2.9	680	3.0	1000	4.4	2000	8.9
Riser Material:	in.	cm	in.	cm	in.	cm	in.	cm
Angle Size								
3" (75 mm) x 3" (75 mm) x 1/4" (6mm)	30	80	30	80	N/A	N/A	N/A	N/A
3" (75 mm) x 3" (75 mm) x 3/8" (10 mm)	42	110	42	110	24	60	2 @ 24 ea.	2 @ 60 ea.
3-1/2" (90 mm) x 3-1/2" (90 mm) x 3/8" (10 mm)	48	120	48	120	42	110	2 @ 42 ea.	2 @ 110 ea.
Channel Size								
6" (150 mm) x 2" (50 mm) - 8.2 lb (3.7 kg)	24	60	24	60	N/A	N/A	N/A	N/A
8" (200 mm) x 2-1/4" (57 mm) - 11.5 lb (5.2 kg)	42	110	36	90	24	60	2 @ 24 ea.	2 @ 60 ea.
9" (225 mm) x 2-1/2" (65 mm) - 13.4 lb (6.1 kg)	48	120	48	120	30	80	2 @ 30 ea.	2 @ 80 ea.
I-Beam Size (Detail B)								
4" (100 mm) x 2-5/8" (66 mm) - 7.7 lb (3.5 kg)	36	90	30	80	N/A	N/A	N/A	N/A
5" (125 mm) x 3" (75 mm) - 10.0 lb (4.5 kg)	48	120	48	120	36	90	2 @ 36 ea.	2 @ 90 ea.
6" (150 mm) x 3-3/8" (85 mm) - 12.5 lb (5.7 kg)	48	120	48	120	42	110	2 @ 42 ea.	2 @ 110 ea.
Nom. Diameter Steel Conduit (Detail A)								
2.5 inch (63)	36	90	30	80	24	60	2 @ 24 ea.	2 @ 60 ea.
3 inch (78)	48	120	48	120	36	90	2 @ 36 ea.	2 @ 90 ea.
3.5 inch (91)	48	120	48	120	48	120	2 @ 48 ea.	2 @ 120 ea.
4 inch (103)	48	120	48	120	48	120	2 @ 48 ea.	2 @ 120 ea.
Minimum Guy Wire Bracing	5/16" (8mm)		5/16" (8mm)		3/8" (10mm)		1/2" (13mm)	

Figure 4.2.4.3-1 Overhead Service Attachment and Riser Mast Requirements

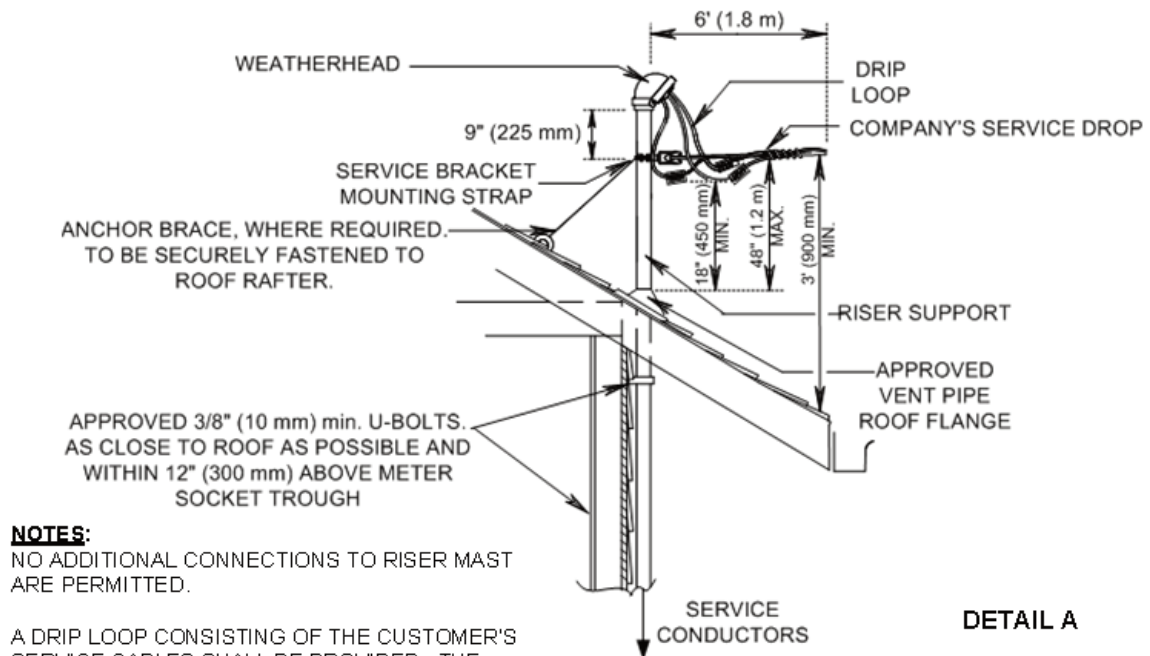


NOTES:

NO ADDITIONAL CONNECTIONS TO RISER MAST ARE PERMITTED.

A DRIP LOOP CONSISTING OF THE CUSTOMER'S SERVICE CABLES SHALL BE PROVIDED. THE LOOP SHALL MAINTAIN CLEARANCES SHOWN ABOVE THE ROOF AND SHALL BE INSTALLED WITHIN 6' (1.8 m) OF MAST.

UPON INITIAL INSTALLATION, LEAVE 24" (600 mm) OF SERVICE CONDUCTORS BEYOND ATTACHMENT BRACKET FOR SERVICE CONNECTION BY COMPANY.

SERVICES GREATER THAN 400A SHALL HAVE TWO MASTS WITH THEIR SERVICE CONDUCTORS PARALLELED AT ONE END.

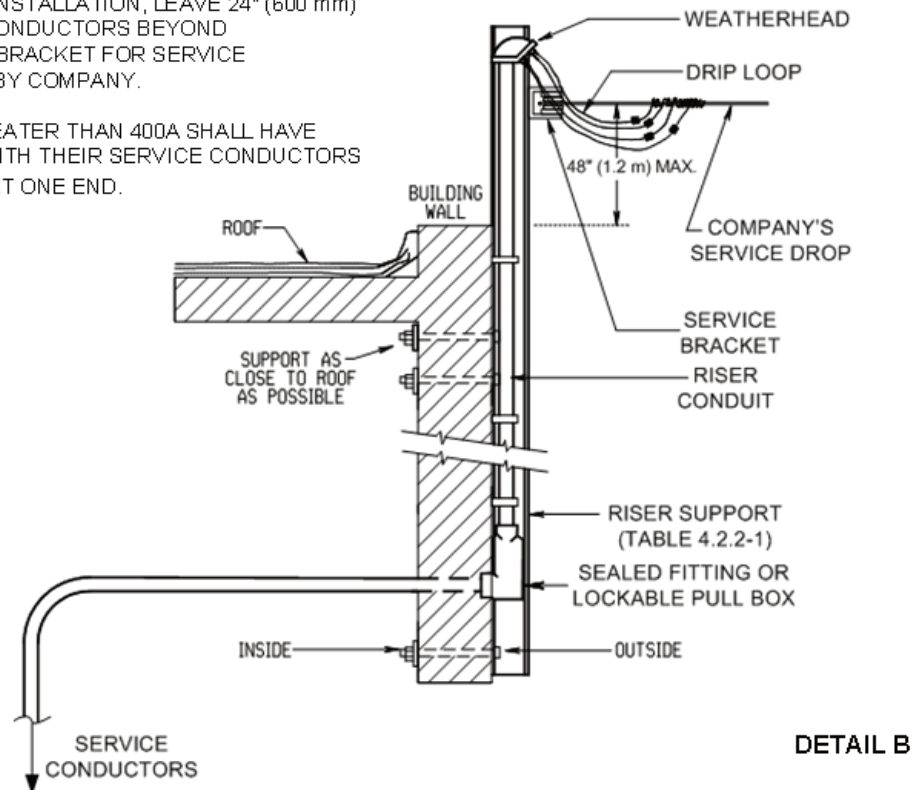

4.2.5 Service Drop and Connection to Service Conductors

The Customer shall furnish, install, own and maintain all service entrance conductors. The Company shall make all connections, permanent or temporary, between the overhead service drop and these entrance conductors. The Company will not permit this connection to be made by others, unless as specifically described in Section 4.2.6 below.

At least twenty-four inches (600 mm) of each service entrance conductor shall project beyond the weatherhead or termination of the service entrance cable for connection to the service drop conductors. Manufactured weatherheads shall be mounted vertically and filled with duct seal to inhibit water penetration.

The service entrance cable itself, or the conduit, or wireway containing the service entrance conductors, shall be exposed from the connection at the service drop conductors to the meter location, except where this service entrance directly passes through a roof or building wall. These openings shall be weatherproofed to prevent the entrance of water and protect the service conductors from physical damage up to the service equipment.

4.2.6 Residential Overhead Service Upgrade

The Company has a program where available for only licensed electricians (as determined by the AHJ) to have the option to disconnect and permanently reconnect a residential overhead service in lieu of scheduling multiple appointments for the Company to perform the work. To do this, the following conditions must be met:

- ▶ Residential single-phase overhead service of 200 amperes or less.
- ▶ There is no change in the point of service location.
- ▶ Service drop maintains minimum clearances according to Section 4.2.4 and the NEC.

The licensed electrician must make arrangements first by contacting the Company for the program available in accordance with the Company's applicable tariff. See the "Process and Information" section on obtaining electric service and the inside front cover of this book.

4.3 OVERHEAD PRIMARY VOLTAGE SERVICE CONNECTION (2.4kV TO 46kV INCLUSIVE)

Refer to the Company's Electric System Bulletin's 751, 752, and 753 for installations within National Grid's New York Service Territory Only.

Primary service, by its nature, provides more opportunity for a given primary Customer to directly affect other electric system customers. Primary customers are responsible for obtaining and maintaining their own equipment.

The Company provides a number of services of this type. Normally, such services are three phase. Depending upon site location, actual service voltage, and use characteristics, certain load restrictions may apply. Customers within National Grid's New York Service Territory who require service at 34.5kV are required to provide a substation, which is reviewed and approved by the Company prior to energization. The Customer is urged to contact the Company prior to planning for an overhead primary voltage service. For more detailed requirements, see ESB 753 "Primary Meter Pole" for 2.4kV to 15kV class installations and ESB 752 for those 23kV to 46kV primary metering installations.

The Company constructs, owns and maintains all overhead primary service lines in the voltage range from 2,400 volts and above. Where intermediate support is required, or an extension of the primary service lateral or line is necessary, the Customer may be required to contribute to the cost of that portion of the service lateral or service line, in accordance with the Company's filed tariffs.

When the service lateral terminates in a building or vault, the section between the last pole and the building or vault shall be cable.

4.4 OVERHEAD TRANSMISSION VOLTAGE SERVICE CONNECTION

Refer to the Company's Electric System Bulletins 751 and 752.

Customers within National Grid's New York Service Territory may accept transmission level voltage service (69kV and above) and shall consult with the Company so that all details concerning the design and installation of the service lateral or service line may be worked out to the mutual satisfaction of both the Customer and the Company. Refer to the Company's ESB 752 for details regarding this service type.


4.5 UNDERGROUND SECONDARY SERVICE VOLTAGE CONNECTION (UNDER 600V)

4.5.1 General

The Company will provide an underground secondary service connection by one of the following methods:

- ▶ Underground secondary service connection from the Company's overhead distribution supply line (see Figure 4.5.4.2-1)
- ▶ Underground secondary service connection from the Company's underground supply line, including network service
 - ▶ Figures 4.5.5.3.1-1; 4.5.5.3.2-1; 4.5.5.3.3-1; and 4.5.5.3.4-1 – Underground secondary service connection from a Company Network or Radial Underground Line
 - ▶ Figure 4.5.6-1 – Underground secondary service connection from a Company pad-mount transformer or handhole within a URD
 - ▶ See ESB's 751 and 754 – Underground secondary service connection from a Company owned primary underground service lateral and pad-mount transformer

Figure 4.5.1-1 Typical Underground Service Installation under 600V (Excluding Network Services)

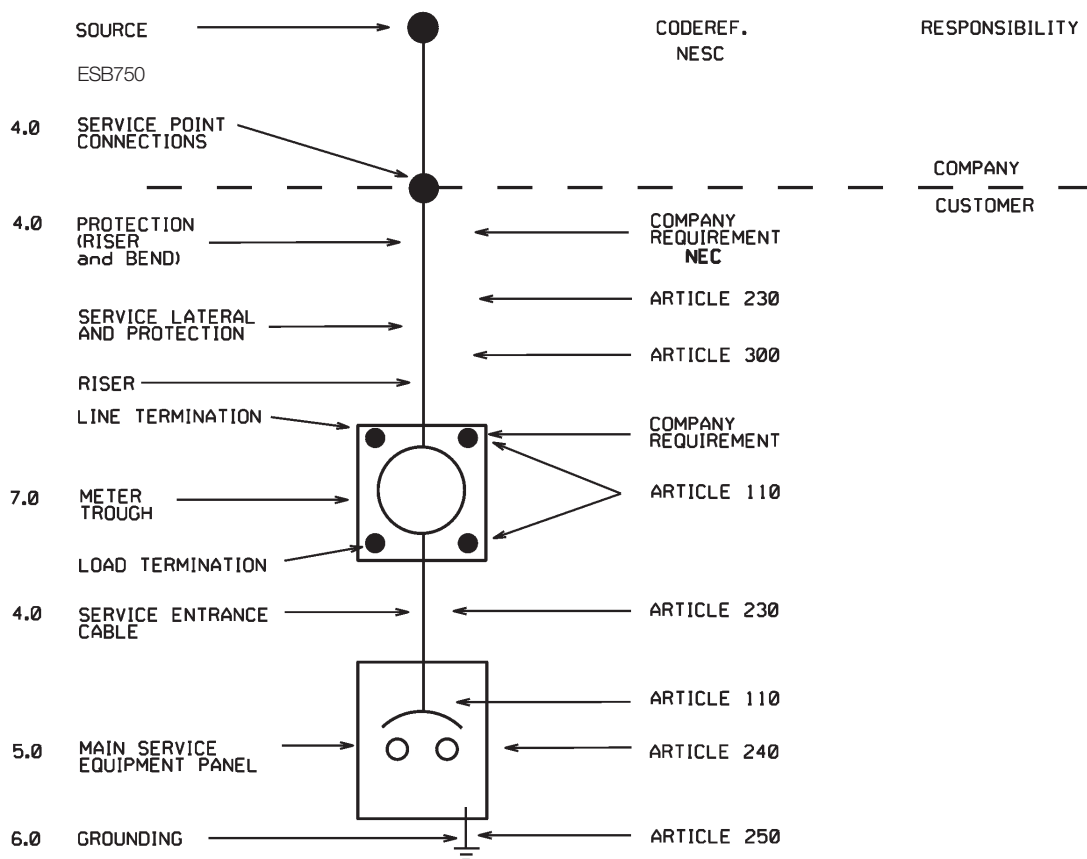

4.5.2 Facilities in Shared Trench

The Customer's underground electric service lateral may be installed in the same trench as facilities providing other utility services in accordance with the National Electrical Code and the National Electrical Safety Code. The Customer should contact the owners of these other utility facilities for their requirements on the use of shared trench. The Company shall be consulted for its requirements when its underground distribution line or service lateral cable is involved with trench shared with other underground facilities.

The use of a common trench for Customer owned underground facilities and Company distribution lines is not permitted; however, a perpendicular crossing may be allowed after approval by the Company.

4.5.3 Conduit System

Certain conduit construction techniques are essential to maintain the integrity of an electric service over its lifetime. For services less than 600 volts, Company conduit requirements are minimal, covering only situations where both the Company and the Customer have a mutual interest; however, the Customer's conduit installation shall meet the National Electrical Code. The Company requires that all conduits on the line side of the revenue metering be installed in a secure manner. No conduit body fittings (condulets) or unlocked access panels are permitted. For network services and services above 600 volts, where the Company furnishes, installs, and thereafter maintains the cable, there are more requirements as noted in this book and National Grid's ESB No. 754.

Where conduit installations are made, it is especially important where future placement of conduit will be awkward, time consuming, and costly that a spare conduit be provided. Spare conduit is required for primary service laterals and all network services. Where the underground secondary voltage service cable terminates on the outside of a building in a meter socket or trough, the cable shall be protected by conduit. Where the underground secondary voltage service cable terminates in a building, the cable through the wall shall be protected by conduit.

For services supplied from radial underground systems, the Customer shall seal conduits where they enter the building to limit water ingress from either around or within the service conduits. For services supplied from the secondary network, the Customer shall install a fire-stop conduit seal to limit ingress of water, smoke, fire, and hazardous gases from either around or within the service conduits. The Customer is responsible for meeting the NEC and any other code requirements as necessary for sealing of underground conduits.

4.5.4 Underground Secondary Service Connection from the Company's Overhead Distribution Supply Line

4.5.4.1 Customer-owned Underground Secondary Service Conductors


Where the Company elects to provide service from its overhead distribution supply line, the Customer shall own, operate, and maintain the underground service conductors from the service point at the Company's supply line to the service equipment. The Customer's underground service conductors installed in the public way shall be as permitted by the Company's applicable tariff. The Customer shall also be responsible for the conduit, fasteners and trenching required to attach to the Company's distribution pole. The conduit for underground service risers shall have an inside diameter of at least 2 inches (50 mm).

Where the Company's pole is not located on the same side of the road as the proposed underground service, the Customer shall contact the Company to discuss the necessary arrangements. In some instances and in some roadway jurisdictions, the Customer may be allowed to install their own conduit and underground service cable across the road. Otherwise, the Company may be required to install an additional distribution pole to provide this type of service. In these instances, as is the case with all customer riser pole installations, the Company requires an inspection of the installation, including the riser pole location, fastening and grounding only after the Company has set the required pole and all work in association with the electric service has been completed. Note, depending on the roadway jurisdiction and if service is in the public way, a petition to the roadway jurisdiction may be required.

4.5.4.2 Company Riser Pole Attachments

The Company will permit the use of PVC Schedule 80 conduit on secondary voltage service riser poles. The conduit shall be placed, in a location on the pole away from traffic. Primary voltage services must be installed within galvanized rigid steel conduit, see Electric System Bulletin 754. See Figure 4.5.4.2-1 as follows for requirements.

Figure 4.5.4.2-1 Underground Secondary Service Riser Pole Detail

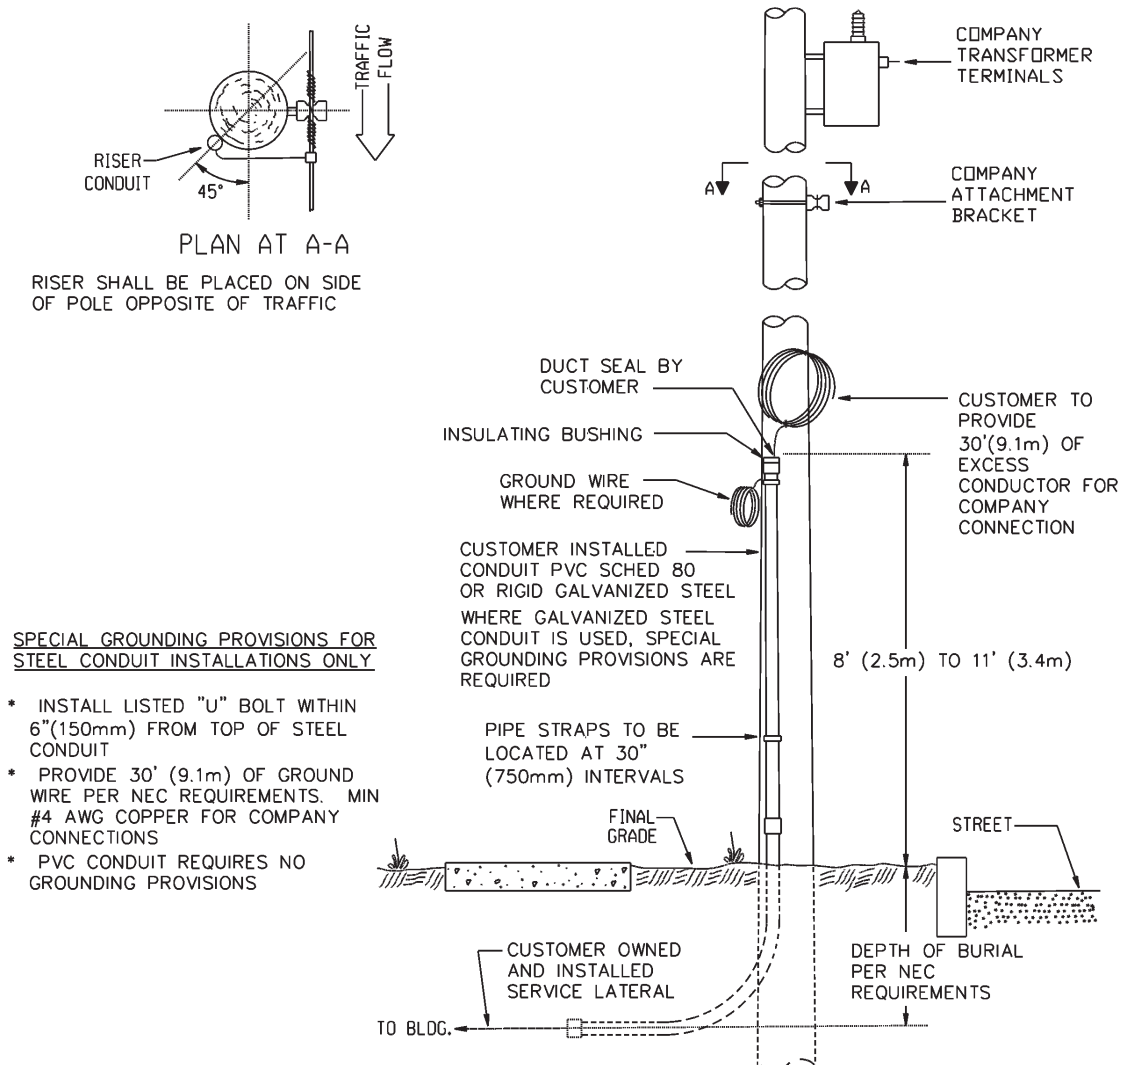

4.5.5 Underground Secondary Service Connection from the Company's Underground Supply Lines

4.5.5.1 General

Services of this type are normally found in urban areas, network areas and underground residential developments (URD). Special considerations apply to each category. For the most part, except for URD, all require cable-in-conduit construction, with the conduit encased in concrete (3-inch (75 mm) envelope). Network services, because of the high fault currents available in such systems, require more attention.

All direct connections to Company-owned cable shall be made by the Company. The Customer shall provide the Company with a compression type splice, listed for the application. All cable sections shall be taped by the Company and secured to the satisfaction of the Company. The Company will not make direct connections to the Customer's main switch or fuse box.

4.5.5.2 Radial fed underground secondary services

For urban areas, where radial underground service is provided, and where the Company's secondary termination point is inside the Customer's premise, termination boxes of the following size shall be used.

- ▶ For a single set of conductors up to and including 500 kcmil, the minimum sized service box shall be 24" (600 mm) x 24" (600 mm) x 12" (300 mm). Note that customers will have to use 600 kcmil conductors to meet NEC requirements for 400A services.
- ▶ An alternate smaller service box may be permitted for a single set of conductors up to #4/0 AWG if there is a space limitation for the 24" (600 mm) x 24" (600 mm) x 12" (300 mm) box. This alternate service box is 18" (450 mm) x 18" (450 mm) x 10" (250 mm).
- ▶ For a parallel set of conductors up to and including 600 kcmil, the minimum sized service box shall be 24" (600 mm) x 32" (800 mm) x 12" (300 mm).


4.5.5.3 Network Areas and Underground Lines

4.5.5.3.1 General

In certain urban areas within the Company's service territory, Customers may be served by the Company's "general" network, or "spot" network. The network system has redundant facilities that is the most reliable power supply for large loads in a dense urban area. Customers may receive a "general" network service, at 120/208V, either single or three phase. Customers having larger loads, may receive service through the Company's "spot" network at either 120/208V or 277/480V.

Due to the various locations where the Company provides network services and the differences in operational and design requirements for the various networks, Customers must contact and coordinate the requirements of network services with the Company.

Figure 4.5.5.3.1-1 Typical Service from Network or Underground Line

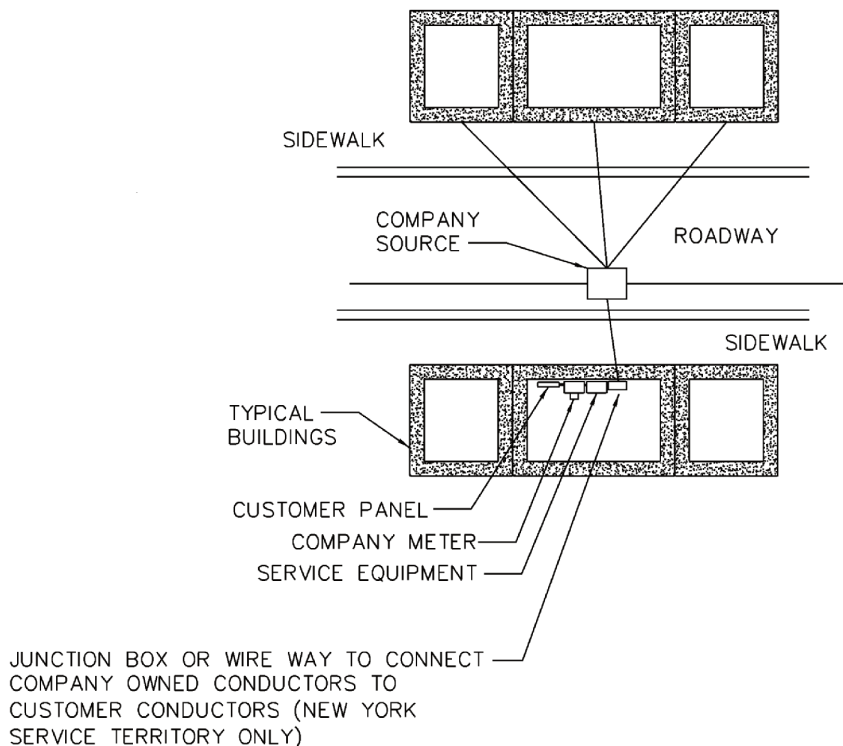



4.5.6 Underground Residential Distribution (URD) Areas

Service within an Underground Residential Distribution Area shall be taken from the Company's transformer, or, the Company's handhole.

The Customer shall furnish, install, own and maintain the underground secondary service conductors between the Company's underground system supply point (in this instance, the supply point and service point are the same) and the Customer's service equipment. The Customer shall install approved underground secondary service conductors and shall tightly seal conductor ends to prevent entrance of moisture. (See Figure 4.5.6-1.) The Company may refuse to energize the service if conductor ends are not moisture sealed. The Customer shall dig to approximately 1 ft. (300 mm) from the Company's transformer base or service handhole, and leave a coil of cable of at least 6 ft. (1.8 m). After inspection agency approval, the underground service conductors shall be backfilled prior to the Company energizing the service.

Figure 4.5.6-1 Underground Residential Distribution (URD)

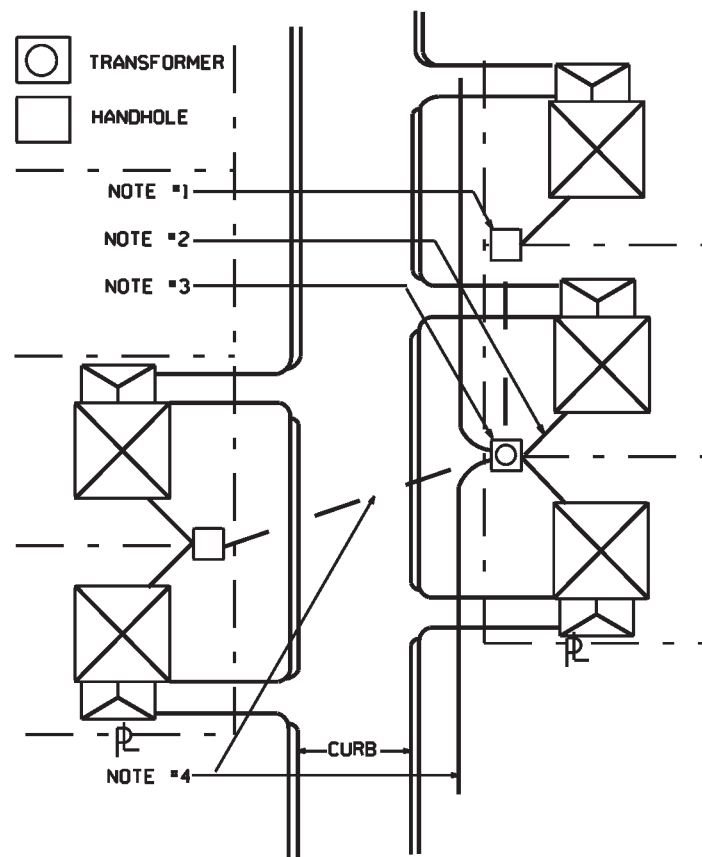

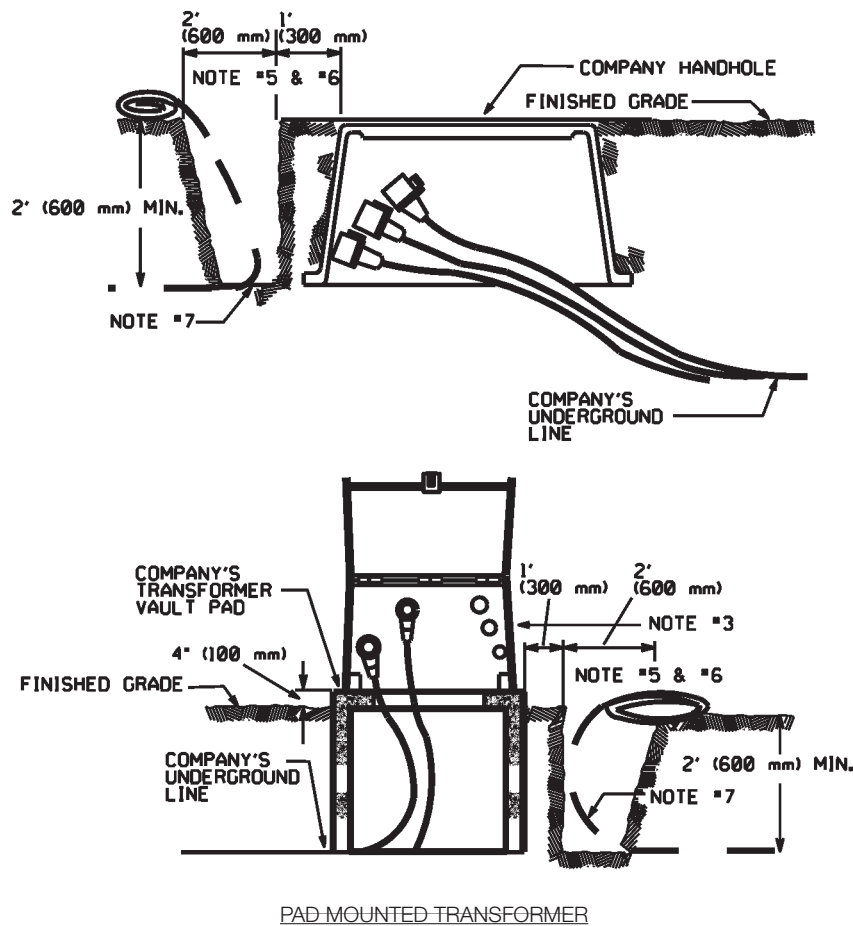

Notes to Figure 4.5.6-1:

NOTE #1	Handhole by Company.	NOTE #8	Customer to trench to within one foot (300 mm) of handhole or transformer pad and leave 2 ft. (600 mm) of trench open. Customer to leave adequate length of sealed service conductors for connection by Company. Length for: handhole – 5 ft. (1.5 m), transformer – 10 ft. (3.0 m).
NOTE #2	Customer underground service conductors.		
NOTE #3	Single phase transformer by Company.		
NOTE #4	Company's underground line.		
NOTE #5	200 A service -- not more than one set of service conductors, maximum size 350 kcmil.		
NOTE #6	400 A service -- not more than two sets of service conductors, maximum size 350 kcmil (one set of 500 kcmil maximum copper service conductors is acceptable).	NOTE #9	The Company is committed to the pursuit of safety excellence through compliance with all OSHA, State, and Regulatory requirements. The Company advises the Customer or their Contractor to comply with the same requirements for safe trenching.
NOTE #7	Customer to seal cable ends to prevent entrance of moisture during installation		


For the latest authorized version, please refer to the company's website at <http://www.nationalgridus.com/electricalspecifications>. 61

- ▶ Feeder bus duct risers may be installed between the service equipment and the meter centers.
- ▶ Tap boxes or provisions for plug-in units between meter centers are not permitted.
- ▶ The proposed unmetered risers shall meet the minimum voltage drop provisions in accordance with the National Electrical Code, Article 215. (See Section 4.1.4.)
- ▶ If the proposed unmetered risers are considered inadequate by the Company, then a single meter room will be required adjacent to the service point.

Unless otherwise exempt by the Company's tariff, the Company will provide underground distribution to a residential multiple occupancy building and the Customer will provide the necessary facilities for the padmounted transformer installation as noted in ESB No. 754. Primary underground lines installed to serve these buildings are considered underground residential or commercial distribution extensions. For services above 600 volts consult the Company.

Where there is an inquiry for supplying service to individual tenants within a building, the Customer shall install and maintain feeders from a Company designated service entrance location to connect each such tenant. The Customer shall provide transformation required for other utilization voltages within the building on the load side of the meter.

Figure 4.5.7.4-1 Typical Service to Multiple Occupancy Building

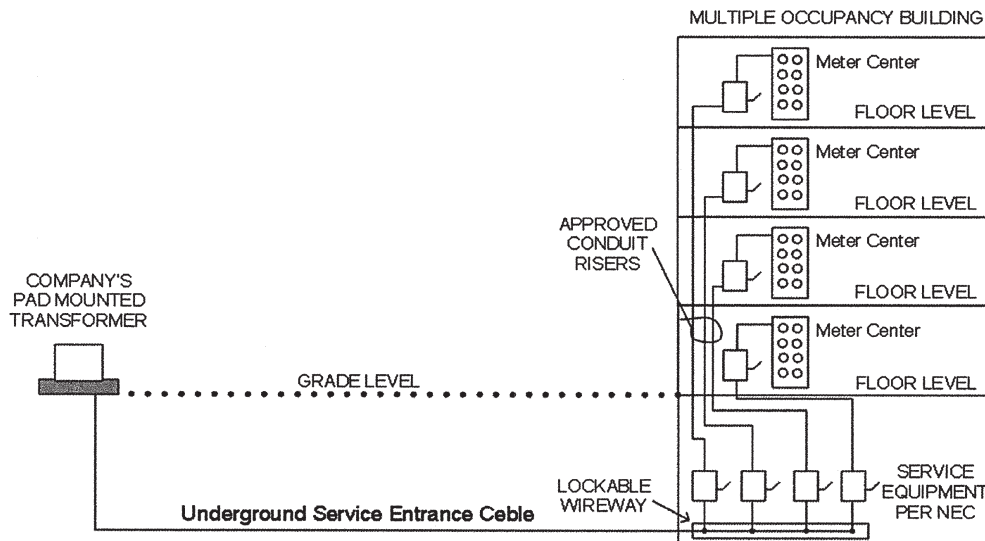

4.6 UNDERGROUND PRIMARY VOLTAGE SERVICE CONNECTION (FROM 2.4kV TO 35kV INCLUSIVE)

Refer to the Company's Electric System Bulletins 751 and 758 and consult with the Company so that all details concerning the design and installation of the primary service lateral may be worked out to the mutual satisfaction of both the Customer and the Company. Also, see Section 7 for metering requirements.

4.7 UNDERGROUND TRANSMISSION VOLTAGE SERVICE CONNECTION (ABOVE 15kV)

Refer to the Company's Electric System Bulletins 751, 752, and 758.

The Customer shall consult with the Company in every case where the service lateral will be above 15,000 volts so that all details concerning the design and installation of the service lateral may be worked out to the mutual satisfaction of both the Customer and the Company. Ask for supplement ESB 752 or 758 for details regarding this service type and see Section 7 for metering requirements.

5.0 SERVICE EQUIPMENT

5.1 GENERAL

Most of the Company's requirements in this section account for specific Company operating practices or concerns. Company imposed requirements address in particular: network services, where high fault values are available; theft of service precautions; and certain required service configurations to permit the Company to operate its supply system in a safe and reliable manner for all customers.

5.1.1 Service Equipment Required

Service Equipment shall be furnished, installed owned and maintained by the Customer as part of the permanent wiring of each service entrance for any Company-provided service.

All service equipment shall meet the requirements of the National Electrical Code and all local authorities having jurisdiction. Service equipment rated above 400 amperes shall also meet the requirements of the American National Standards Institute and National Electrical Manufacturers Association (NEMA) as well as the additional requirements as outlined in this section. All service equipment housed in a compartment shall be adequately ventilated to limit the temperature rise in accordance with the latest NEMA Standards. As stated in the National Electrical Code (NEC), Customer service equipment shall be located at the nearest point of entrance of the service conductors and ample workspace shall be provided. On group installations, all service equipment shall be permanently marked by the Customer to clearly identify the space, office, store, apartment, etc. to which it is connected.

5.1.2 Service Equipment Minimum Continuous Current Rating

For single residential and small commercial applications, service equipment shall have a minimum rating of 100 amperes. Consult the Company for acceptable minimum service equipment ratings for other uses.

5.1.3 Service Equipment Minimum Short Circuit Withstand Capability

Service equipment shall be suitable for the short circuit current available at its supply terminals. For residential single phase services supplied from the Company's radial supply system, the minimum short circuit withstand current shall be no less than 10,000 amperes RMS symmetrical. For services supplied directly from a transformer, see Section 9.3 for available fault current. For network services, see Section 5.3.

5.1.4 Routing of Metered and Unmetered Conductors

See Section 4.1.7. Portions of the service equipment shall have provisions for security locking by the Company from the supply point to the metering location where they contain unmetered conductors.

5.1.5 Taps Ahead of Main Service Equipment

Any tap made ahead of the main service equipment for emergency systems, control power for circuit breaker, etc. shall be provided with disconnecting means and overcurrent protection adequate for the duty. Such connections shall be made only where specifically accepted by the Company and approved by the NEC.

5.1.6 When Service Equipment Ahead of Metering is Required

Refer to Section 7 for accepted metering configurations where a Customer shall install main service equipment ahead of metering in applications 600 volts and less. Consult the Company for metering and service equipment configurations in applications above 600 volts.

5.1.7 Service Equipment on Service Poles, Pedestals, or Posts

5.1.7.1 Service equipment must be installed by the Customer on all service poles, pedestals, or posts:

- ▶ where the service pole, pedestal, or post is greater than 10 feet (3.0 m) from a single building or structure; see the NEC for disconnect requirements in the building;
- ▶ where more than one building or structure is supplied by a service pole that is served overhead by the Company; and
- ▶ for mobile home(s).

Note: Conduit is required for all service entrance conductors installed underground between the meter and service equipment.

5.1.7.2 Meter pedestals are free-standing units intended to be mounted outdoors on a concrete pad in conjunction with underground wiring. If a free-standing meter pedestal is used, it shall extend a minimum below the finished grade or ground line with stabilizing means extending below the frost line to ensure that the meter mounting stays in a plumb position. See Section 7 for further details. Meter pedestals for self-contained metering must be listed devices and shall also incorporate circuit breakers, but these are not intended to replace the service disconnecting means required at the building.

5.1.8 Grouped Metered Services to Separate Buildings on One Premise

Where the Company and local AHJ approve more than one metered service to separate buildings on a Customer's premise, all metering shall be grouped at a specific location(s) approved by the Company. These metered services shall have associated service equipment on the load side of the meter at the grouped meter location. All meters and service equipment must be properly identified.

5.1.9 Service Equipment Arrangement

The Service Equipment may consist of multiple circuit breakers or fused switches with fuses, provided:

- ▶ the number of breakers or fused switches does not exceed six;
- ▶ breakers and fused switches must be in a common enclosure, or in a group of separate enclosures grouped in one location.

Exceptions:

- ▶ Service to a building in a network area having main switch capacity up to and including 4,000 amperes requires a single main disconnecting device.
- ▶ Service to a building in a network area having main switch capacity greater than 4,000 amperes, may generally have a maximum of three main disconnecting devices, with no device smaller than 2,000 amperes.
- ▶ Service less than 600 volts from an underground distribution line (excluding URD and UCD) requires a single main disconnecting device.
- ▶ Standby generation with a transfer switch need not be grouped; however, identification is required in accordance with the National Electrical Code.
- ▶ A Customer-designated emergency system that requires separate service equipment for a Customer supplied by the Company's radial system. This service equipment shall be located within 100 circuit feet (30 circuit meters) from a padlockable load break disconnect switch installed in the service entrance cable at the building's grouped main service equipment location.

Any service equipment located on the line side of meters (cold sequence) shall be an enclosed type, with facilities for sealing by the Company. Fuse replacement or breaker reset must be possible without disturbing the enclosure seal.

Where multiple service equipment is provided for either commercial or dwelling occupancy, each disconnecting means shall be marked in a conspicuous, legible, and permanent manner to indicate which portion of the installation it controls.

5.1.10 Service Equipment Minimum Attributes

Service equipment 600 volts and less shall meet the following minimum requirements:

5.1.10.1 Interrupting Rating

See Section 5.1.3 and the National Electrical Code to select proper service equipment to withstand the maximum available fault current from the Company's supply and utilization equipment contribution. Overcurrent protection shall provide fault interrupting capability, at service voltage, not less than the value specified by the Company (see Section 9).

The disconnecting means shall be capable of opening load current.

5.1.10.2 Inductive Heating

Current carrying parts shall be sufficiently spaced from enclosure metals to preclude inductive heating. Enclosures of nonferrous metals may be used, if desired.

5.1.10.3 Metering Transformer Space

Where used, provide required space and accessible mounting facilities for the Company's metering transformers based on full rating of the service equipment.

5.1.10.4 Bonding

All non-current carrying metal parts, mounting brackets, frameworks, enclosures, etc. shall be bonded to an equipment ground.

5.1.10.5 Spare Fuses

Where a switch and fuse combination is used, the Customer shall be responsible for maintaining a readily accessible stock of spare fuses.

5.1.10.6 Circuit Breaker

If an air circuit breaker is used, it shall meet the following requirements in addition to those in 5.1.10.1 and 5.1.10.4 above:

5.1.10.6.1 No Undervoltage Tripping

No undervoltage tripping devices except by Company's permission.

5.1.10.6.2 Control Circuit Protection

A control circuit used only for closing the circuit breaker may be connected on its line side provided the tap is protected by high interrupting capacity fuses of a type acceptable to the Company.

5.1.11 Instrumentation and Control Wiring

All instrumentation and control wiring shall utilize stranded conductors rated for the use intended, refer to IEEE Std. 525 for a design and installation guide of cable systems.

5.2 RESIDENTIAL

It is recommended that service equipment for a residence include the necessary feeder and branch circuit protective devices in accordance with the National Electrical Code.

5.3 NETWORK SERVICE

5.3.1 General

It is important that the Company be consulted at an early stage concerning the design and coordination of the service lateral connections with the service equipment when the supply is from a network system. The Customer shall submit three copies of detailed plans and specifications of the service location and equipment to the Company for approval. The network service entrance equipment shall be approved by the Company prior to fabrication.

The Company will inform the Customer concerning the number and size of the service conductors and the magnitude of the short circuit that the service equipment may be called upon to interrupt.

Due to the various locations where the Company provides network services and the differences in operational and design requirements for the various networks, Customers must contact and coordinate the requirements of network service equipment with the Company.

5.4 RADIAL SERVICES

Service Equipment specifications and arrangements shall be discussed with the Company for approval prior to the purchase of equipment or proceeding with the installation.

The Company will inform the Customer concerning the magnitude of the current that the service equipment may be called upon to interrupt.

5.4.1 More than Six Service Disconnects

A single main service equipment shall be installed where there are more than six disconnects and overcurrent means at one location.

Where line-side connected, self-contained grouped meter sockets are installed, additional service equipment on the line side of meters is required if the number of line-connected meters exceeds six.

5.4.2 Radial Service, 300 amperes Continuous or Less Served at Less Than 600 volts

Note: Excluding URD areas, service equipment rated 300 amperes continuous or less served from radial underground lines shall conform to requirements of service equipment for network service. (See Sections 5.3.3 to 5.3.6.)

Where the Service Equipment is rated 300 amperes continuous or less, and the secondary service voltage is as indicated, the Customer shall terminate its service entrance conductors at a location designated by the Company in the following manner: (See figures in Section 7.)

- ▶ in a self-contained meter socket for all 240 volt single phase and below including 208/120 volt three phase services.
- ▶ in service equipment on the line side of a self-contained meter socket for all 480 volt class services.

5.4.3 Radial Service, Above 300 amperes Continuous Served at Less Than 600 volts

Note: Service equipment rated above 300 amperes continuous, served from radial underground lines shall conform to requirements of service equipment for network service. (See Sections 5.3.3 to 5.3.6.)

An overcurrent device on each pole of an air circuit breaker, if used, shall provide time delay overload protection and instantaneous tripping for currents of fault magnitude.

For service equipment less than 600 volts rated above 300 amperes continuous, it is important that the Company be consulted at an early stage concerning the design and coordination of the service lateral connections with the service equipment. The Customer shall submit detailed plans and specifications to the Company for approval before the purchase of the service equipment.

5.5 INDIVIDUAL MULTIPLE OCCUPANCY BUILDING SERVICE

In multi-occupancy buildings several stories high, the installation of unmetered risers in conduit to a single approved, accessible meter center located on various floors shall conform to the following criteria and be reviewed by the Company for acceptance.

- ▶ Disconnecting and protective equipment shall be provided at the service entrance point for each floor level(s).
- ▶ Disconnects at the service point shall indicate the floor level(s) served.
- ▶ Where a single riser is being provided for several floor levels, disconnecting and protective equipment shall be provided at each grouped meter location. The purpose of this requirement is to allow isolation of equipment on a specific floor without affecting the service to other floors.
- ▶ Any disconnect, pull box or any access to unmetered conductors shall have provisions for sealing by the Company.

5.6 RADIAL LOADS SERVED ABOVE 600 VOLTS

The Customer shall consult the Company in every case where the service voltage may exceed 600 volts. The Company will designate the type of service based on the location, size and nature of the proposed load and its relation to the Company's facilities. See Company's Electric System Bulletin Nos. 751, 752, 753, or 758 for further details.

The location of the service equipment and the general electrical arrangement will be agreed upon after mutual consideration of all factors by the Customer and the Company. Based on the electrical arrangement selected, the Company will advise the Customer concerning its requirements for basic insulation level, protective equipment and metering facilities and will supply such additional information as short circuit data, relay recommendations, etc., so the Customer can complete the design of its installation. The Customer shall submit detailed plans for inspection and approval by the Company prior to the purchase of equipment or proceeding with the installation in accordance with the applicable supplement to these specifications noted above.

6.0 GROUNDING

6.1 GENERAL

This section applies to services 600 volts and below. Refer to the applicable supplements to these specifications and consult the Company for grounding applications above 600 volts.

6.2 EQUIPMENT TO BE GROUNDED

The Customer shall provide an effective ground and shall connect it to the service equipment and the following equipment in accordance with the National Electrical Code (NEC):

- ▶ The grounding stud of a self-contained meter socket trough for existing meter pole services without service equipment.
- ▶ The grounding stud of a transformer rated meter socket trough from the Customer's service ground or for pad mounted transformers, the transformer ground grid.
- ▶ The grounding stud and neutral bus of the service equipment.
- ▶ All metal service enclosures and conduits.
- ▶ The frames and secondary neutral of all instrument transformers.
- ▶ The rigid metal conduit riser on the Company's pole at a point ten (10) feet above ground.
- ▶ CSST gas piping systems shall be bonded to the electrical service grounding electrode system at the point where the gas service enters the building in accordance with NFPA 54. The bonding jumper shall not be smaller than 6 AWG copper wire or equivalent.

6.3 GROUNDING METHODS

6.3.1 All grounding shall be done in accordance with the NEC as a minimum or any other applicable code enforced by the inspection authority having jurisdiction. The Company is not responsible for problems or damage to customer equipment due to a less-than-optimum grounding electrode system. The Company shall not be liable for damage to the property of the Customer resulting from unbalanced voltage conditions due to the opening of a neutral service conductor.

6.3.2 In the absence of a suitable water piping system, the Customer's grounding system shall consist of electrodes as permitted by the NEC.

6.3.3 Achieving a resistance to ground value that exceeds NEC requirements provides better protection from lightning transients and can help improve power quality. A single grounding electrode, which does not have a resistance to ground of 25 ohms or less, shall be augmented by additional electrode(s) in accordance with the NEC.

6.4 GROUNDING RESTRICTIONS

Exclusive of the above requirements:

- ▶ Gas service piping and gas meters shall not be used as a grounding electrode for the connection of a grounding electrode conductor.
- ▶ A grounding electrode conductor shall not be connected to the meter socket trough.
- ▶ The meter socket trough shall not be used to ground other equipment.
- ▶ Consult the Company on existing 3-phase delta services no longer standard where the service conductors shall be insulated from the service equipment according to the NEC and grounded only at the Company's supply transformer.

6.5 GROUND FAULT PROTECTION

The Customer shall install ground fault protection for its equipment in accordance with the NEC.

7.0 METERING

7.1 GENERAL

In most instances, the Company will furnish, install, own, maintain, and connect all meters required for billing purposes at the delivery voltage on the Customer's side of the service point in accordance with the Company's applicable tariff and applicable state laws and regulations. This includes meter instrument transformers and meter cable when required. The Company's metering equipment shall not be used to operate any Customer devices except for metering pulse signals as permitted in Section 7.6. The Customer, regardless of equipment ownership, shall permit minor alterations by the Company for the metering purpose.

7.1.1 Access

It is in the interest of both the Customer and the Company that a suitable and adequately protected meter location be provided to ensure accuracy and to facilitate installation, reading, and maintenance. All metering equipment must be readily accessible to the Company's personnel at all times. The Company will designate this location. The Company requires the Customer to install its service wiring so that the meter is accessible to Company employees from the outside of the Customer's building in accordance with the Company's applicable tariff. Meter installations for services 600 volts and less up to and including 320 continuous amperes, normally will be located outdoors.

Meters shall not be installed in, or allowed to remain in areas that later become, stairways, fire escapes, coal bins, fruit cellars, bathrooms, toilets, bedrooms, attics, store windows, transformer vaults, behind shelves, near moving machinery or similar inconvenient or dangerous locations.

7.1.3 Working Clearances

7.1.3.1 Indoor Installations

In those cases where transformer rated meters or grouped meters are installed indoors, they shall be located as close as practicable to the point where the service enters the building and adjacent to the service equipment.

For multiple metering centers, the mounting height to the center of the meters shall be 6 feet (1.8 m) maximum and 2 feet (600 mm) minimum above floor indoors.

A clear working space of at least four feet (1.2 m) shall be provided and maintained in front of all meter socket covers with a minimum headroom of 6-1/2 feet (2.0 m).

7.1.3.2 Outdoor Installations

The mounting height of individual or ganged meter troughs shall be mounted with the center of the meter 3-1/2 to 5-1/2 feet (1.0 to 1.7 m) above final grade. For multiple metering centers, the mounting height of the center of the meters shall be 6 feet (1.8 m) maximum and 2-1/2 feet (750 mm) minimum above final grade outdoors.

For Traffic Signal services where the Company's service drop is attached to the Customer's traffic pole structure in the public way, the bottoms of the traffic control box, the meter socket trough, and any wire drip loops must be more than 8 feet (2.5 m) above grade. Or, the tops of the traffic control box and the meter socket trough must be below 6 feet (1.8 m) and there must be 8 feet (2.5 m) clear space without handholds or footholds starting at no higher than 6 feet (1.8 m) above grade. The meter socket trough shall be mounted in a location away from traffic for reasonable protection from damage and preventing climbing into energized overhead conductors.

7.1.4 Physical Protection

Electric Meters shall be located away, or fully protected in a manner acceptable to the Company, from opening doors, commercial driveways, areas used for the piling of snow and where, in the Company's determination, the meter or service entrance is subject to damage through vibration or any other physical means. Examples of suitable protection methods include bollards, fender posts, guardrails, etc.

Where the meter is located in residential driveways or walkway areas, it shall be mounted to have reasonable protection from damage.

On a service pole, post, or pedestal, the meter shall be mounted to have reasonable protection from damage. Metering facilities for customers shall not be installed on a Company pole.

Where the Company provides the gas service, no electrical equipment or electric meter(s) shall be located directly over or under any gas meter or regulator vent. Eighteen inches (450 mm) of horizontal clearance shall be maintained between any electric meter socket and a gas regulator vent. Consult the Company prior to the installation of either service to avoid conflicts of meter location or where the gas service is supplied by others, consult that company.

7.1.5 Violations

Any Customer or Contractor wiring to a meter or service location that is not approved by the Company is done at its own risk. Corrections of such violations shall be at the Customer's or Contractor's expense.

7.1.6 Unmetered Wiring

The Company will seal all meters and meter facilities on the Customer's premises. All cabinets, equipment enclosures and conduit fittings containing unmetered wiring of any voltage shall be made secure before the service will be energized.

No conduit body fittings (condulets) or pull boxes in raceways containing unmetered service conductors are permitted. Where unavoidable in some special situations, pull boxes or wiring troughs may be permitted upon the Company's prior acceptance and shall have provisions for the Company's lock and seal and be accessible to the Company.

The breaking of seals or tampering with meters or unmetered wiring by unauthorized persons is prohibited. Attention is called to the criminal laws in the states where service is rendered, which make such unauthorized tampering a misdemeanor punishable by fine or imprisonment, or both.

7.1.7 Taps Ahead of Metering

Any tap made ahead of the main service billing meter(s), for emergency systems, control power for utilization equipment, etc. shall be specifically approved by the Company and shall be metered.

Exception: Control power for circuit breaker operation only shall be permitted to be unmetered.

7.1.8 Meter Relocation

Whenever it is necessary to relocate an existing service entrance, service equipment, or meter board, the new installation shall be made by the Customer at its expense in accordance with these specifications. When the change is to be made, the Customer's electrician should make a definite time arrangement in advance, so the Company can have the new service drop or lateral and the meter available on completion of the Customer's electrical work. No service entrance shall be left unmetered.

7.1.9 Group Metering

Where two or more meters are to be installed, all shall be grouped at one location. Prior to the Company setting the meters, each meter position shall be permanently marked by the Customer to clearly identify the space or apartment to which it is connected.

Where the Customer desires to provide either a meter center (multi-socket panel base assembly) or a pedestal style metering assembly, they must be approved by the Company prior to installation. See Section 7.2 for specifications. Meter centers and metering assemblies are limited to either 120/240 volts or 208Y/120 volts or 277/480 volts or 480Y/277 volts, with individual meters rated for either 100, 150, 200 or 320 amperes.

7.1.10 Emergency System Metering

Customer designated emergency system metering in most cases will be transformer rated. Consult the Company for specific guidance.

7.1.11 Shared Metering (for NY only)

In a multiple tenant building with individual metering, the house load requires a separate meter. The house load is that which is common to the property such as halls, entryways, outdoor lighting, building appliances, etc. and under the property owner's management. The Company shall be consulted in each case.

7.2 METER APPLICATIONS AND REQUIREMENTS 600 VOLTS AND LESS

The following tables are the Company's specified metering applications and requirements for services 600 volts and less.

Table 7.2-1 Meter Socket and Transformer-rated Meter Applications

Note #	Service Type	Service Voltage	# Phases	Service Size (Amps)	# Wires	# Meter Terminals	Hot / Cold Sequence	Manual Bypass Required	Figure #
Self-contained									
	Residential	120/240	1	100 / 200	3	4	Hot	No	7.3-1
	Residential URD	120/240	1	200	3	4	Hot	No	7.3-2
	Residential 2-6 gang	120/240	1	150 each	3	4	Hot	No	7.3-7
1	Residential	120/240	1	400	3	4	Hot	Yes	7.3-3
2	Residential	120/208	1	100 / 200	3	5	Hot	No	7.3-4
3	Commercial	120/240	1	100 / 200	3	4	Hot	Yes	7.3-1
	Commercial 2-6 gang	120/240	1	200 each	3	4	Hot	Yes	7.3-7
1	Commercial	120/240	1	400	3	4	Hot	Yes	7.3-3
2	Commercial	120/208	1	100 / 200	3	5	Hot	Yes	7.3-4
2	Commercial - Network	120/208	1	200	3	5	Cold	Yes	7.3-4
	Commercial 2-6 gang	120/208	1	100 each	3	5	Hot	Yes	7.3-7
	Commercial	277/480	1	100	3	5	Cold	Yes	7.3-4
1	Commercial	277/480	1	400	3	5	Cold	Yes	7.3-3
	Commercial	208/120	3	200	4	7	Hot	Yes	7.3-5
1	Commercial	208/120	3	400	4	7	Hot	Yes	7.3-6
1	Commercial - Network	208/120	3	400	4	7	Cold	Yes	7.3-6
	Commercial	480/277	3	200	4	7	Cold	Yes	7.3-5
1 & 4	Commercial	480/277	3	400	4	7	Cold	Yes	7.3-6
above 400A (non-self contained, metering transformers are used)									
	Residential	120/240	1	Above 400	Company Supplies Socket		Hot	N/A	7.4.1-1, -4
	Commercial	208/120	3	Above 400	Company Supplies Socket		Hot	N/A	7.4.1-1, -2, -4
	Commercial	480/277	3	Above 400	Company Supplies Socket		Hot	N/A	7.4.1-1, -2, -4
	Commercial - Network	208/120 480/277	3	400	Company Supplies Socket		Cold	N/A	7.4.1-3
Notes									
1	A 400A service with a class 320 meter and socket is limited to 320 continuous amperes load capacity - See Table 7.2-4 for rating requirements of service.								

2	5 th meter terminal is located in the 9:00 o'clock position and connected to the neutral.
3	Where a non-standard 120V, 2 wire, 30A service is maintained, use 240V, 3 wire, 100A service and use 2 wire for load connection.
4	This service (self-contained 480V class - 400A) shall be suitable for available fault current, see Table 7.2-2. [New requirement in MA, NH, and RI.]

Table 7.2-2 Self-contained Meter Socket Requirements

Req.	Self-contained Meter Socket Criteria
1	All meter sockets shall have independent test laboratory listing agency label certifying to ANSI/UL 414, ANSI C12.7, NEMA 250, NEMA Publication No. EL-17, and NFPA 70 (NEC).
2	All meter sockets shall be ringless and individual covers must have a hasp provision for the Company's seal.
3	All meter socket enclosures shall be outdoor NEMA 3R rated and withstand the ambient and environmental conditions where located. Meter facilities shall be protected from dust, moisture, corrosion, etc. (Some extreme conditions may require a minimum NEMA 4X rated enclosure.)
4	Overhead types shall have hub opening at top for top entry in meter socket or central wiring space of ganged sockets.
5	All meter sockets shall have adequate continuous duty and short circuit withstand ratings applicable for the service connection. Refer to Sections 5 and 9 and note following this table.
6	Jaw assembly shall permit use of "Mylar plastic disconnect sleeves" being applied over the blades of the watt-hour meter without cutting or mutilation of the insulator material.
7	100A and 150A rated meter socket jaw assemblies shall be compatible with Class 200 rated watt-hour meters.
8	Neutral position shall be bonded to the meter socket enclosure.
9	Bolted or lay-in type terminals and terminal blocks shall have Allen or hex head terminal screws rated for 150 inch-pounds (17 Newton-meters) tightening torque minimum.
10	Underground (bottom entry) types and central wiring space of ganged types shall have 3/8 inch (10 mm) diameter stud terminals capable of pulling tensions up to 400 lbs. (1.78 kN) force. <ul style="list-style-type: none"> ✓ The Customer shall install crimp type or approved spring-type compression connectors. Mechanical (bolted) connectors are not acceptable. ✓ Parallel conductors (2 maximum) attached to stud terminals shall be terminated with stackable crimp type compression connectors (or spacers approved for the purpose). ✓ Completed connection requires two threads of the stud exposed.
11	Connection temperature rating is preferred at 90 degrees C and insulation material to be rated 600V and arc track resistant.
12	The meter socket meets the wire bending requirements within the enclosure and at terminations according to the NEC.
13	A manual, single handled By-Pass with locking jaw and safety arc shield is required for all commercial and 320A class residential applications.

Note: *Meter Socket Minimum Short Circuit Withstand Capability*

Meter sockets shall have a minimum short-circuit withstand rating of 10,000 amperes rms symmetrical at 300 volts AC. The exceptions are 200 and 320 ampere-rated single or three phase meter sockets having short circuit ratings based on the use of an overcurrent protective device on a circuit capable of delivering not more than:

RMS SYM. AMPS, MAX.	MAX. OVERCURRENT PROTECTION, AMPS	VOLTS MAX.	RMS SYM. AMPS, MAX.	MAX. OVERCURRENT PROTECTION, AMPS	VOLTS MAX.
200,000	200 CLASS J or T FUSE	600	25,000	100 CIRCUIT BREAKER	240
100,000	400 CLASS J or T FUSE	600	22,000	1 ph. 125 CIRCUIT BREAKER	240
100,000	100 CLASS RK5 FUSE	600	18,000	200 CIRCUIT BREAKER	240
50,000	600 CLASS T (300V) FUSE	300	14,000	ANY CIRCUIT BREAKER	600
42,000	200 CLASS RK1 FUSE	480			

Table 7.2-3 General Self-contained Meter Socket Installation Responsibilities Checklist

The Company will:

- ✓ Designate Service and Meter Locations.
- ✓ Furnish and install service drop conductors to the point of connection and make final connection, except as permitted under Section 4.2.6 for residential overhead service upgrade projects.
- ✓ Install the meter.

Customer will:

- ✓ Furnish and install the service entrance conductors and equipment in accordance with the requirements of the National Electrical Code and the Company.
 - ▶ Use an approved oxide inhibiting compound on aluminum conductors (not on meter jaws).
 - ▶ Install expansion joint in underground conduit according to NEC Article 300 for underground served meter socket
- ✓ Make connections in meter socket trough.
 - ▶ Use approved compression connectors on stud-type underground line connections for URD type meter sockets.
- ✓ Install the meter socket on approved support according to Section 7.7.
- ✓ Obtain an electrical inspection certificate from a recognized electrical inspection authority.

Table 7.2-4: 320A Meter Socket Applications

[New requirement in MA, NH, and RI.]

Those applicants or existing customers applying for 400-ampere service at a delivery voltage of 120/240, 120/208 or 277/480 volts that propose to install a self-contained 320-ampere meter socket shall meet the following criteria:


- ✓ Group the Class 320 meter socket with an 80% derated main circuit breaker service equipment.
- ✓ Demonstrate as part of the municipal or third party inspection approval that the load side capacity is not more than 320-ampere continuous (see NEC Article 220).
- ✓ Customer designs resulting in higher calculated peak load current or using 100% rated main circuit breaker or fuses greater than 320 amperes will require an instrument transformer metered service.
- ✓ The Customer shall reserve space for a future instrument transformer meter cabinet, since any failure of the Company's self-contained meter due to loads exceeding 320 continuous amperes will require an upgrade to instrument transformer metering prior to re-energization.
- ✓ All 480 volt class self-contained metering installations shall be cold sequenced and include line side service equipment that allows the meter(s) to be de-energized by Company employees. Additional disconnects may be installed between the service equipment and each self contained 480V meter as necessary for multiple metered applications.

Note: In all cases, the Company reserves the sole right to specify the final metering configuration based on the Customer's load characteristics and Good Utility Practice.

7.3 SELF-CONTAINED METER SOCKET INSTALLATIONS


Meter socket troughs shall not be used as junction boxes or wiring troughs for splices or taps. The Customer shall consult with the Company prior to meter trough installation when considering a meter installation using other than the preferred wiring configuration. The following illustrations are typical arrangements required for the applications and requirements specified in Section 7.2.

Figure 7.3-1 Typical Single Phase Residential or Commercial Meter Socket Connections 120/240 Volt, 3 Wire, 200 Ampere Maximum Continuous Duty

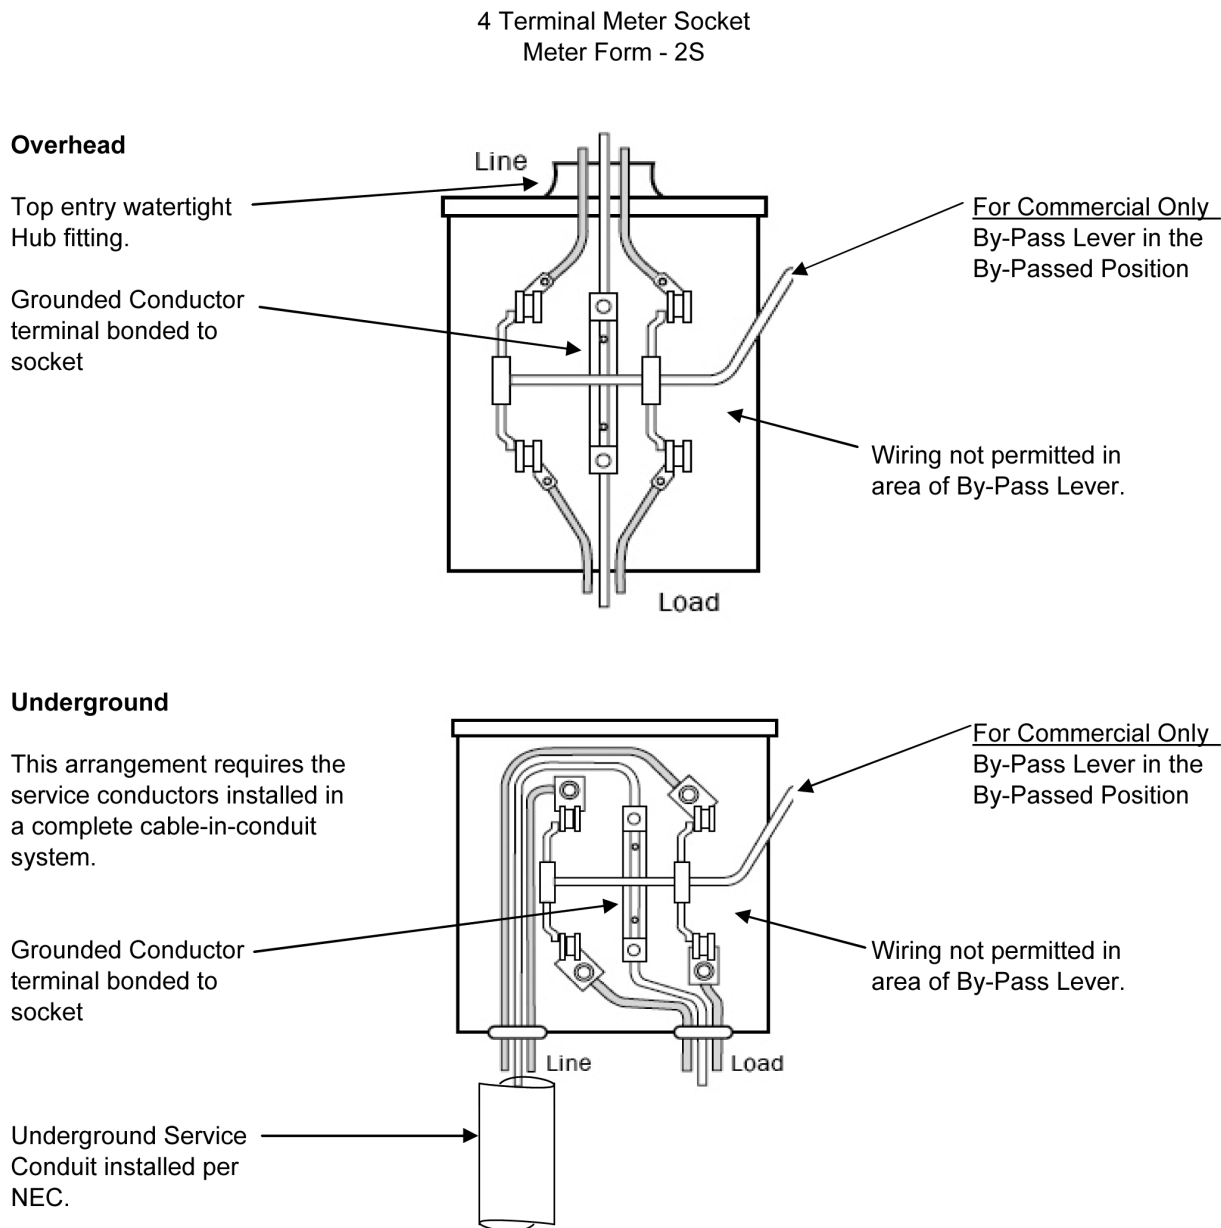


See Tables 7.2-1 through 7.2-3 for further details on application, requirements, and responsibilities.

Figure 7.3-2 Typical Single Phase Residential URD Meter Socket Connection 120/240 Volt, 3 Wire, 200 Ampere Maximum Continuous Duty

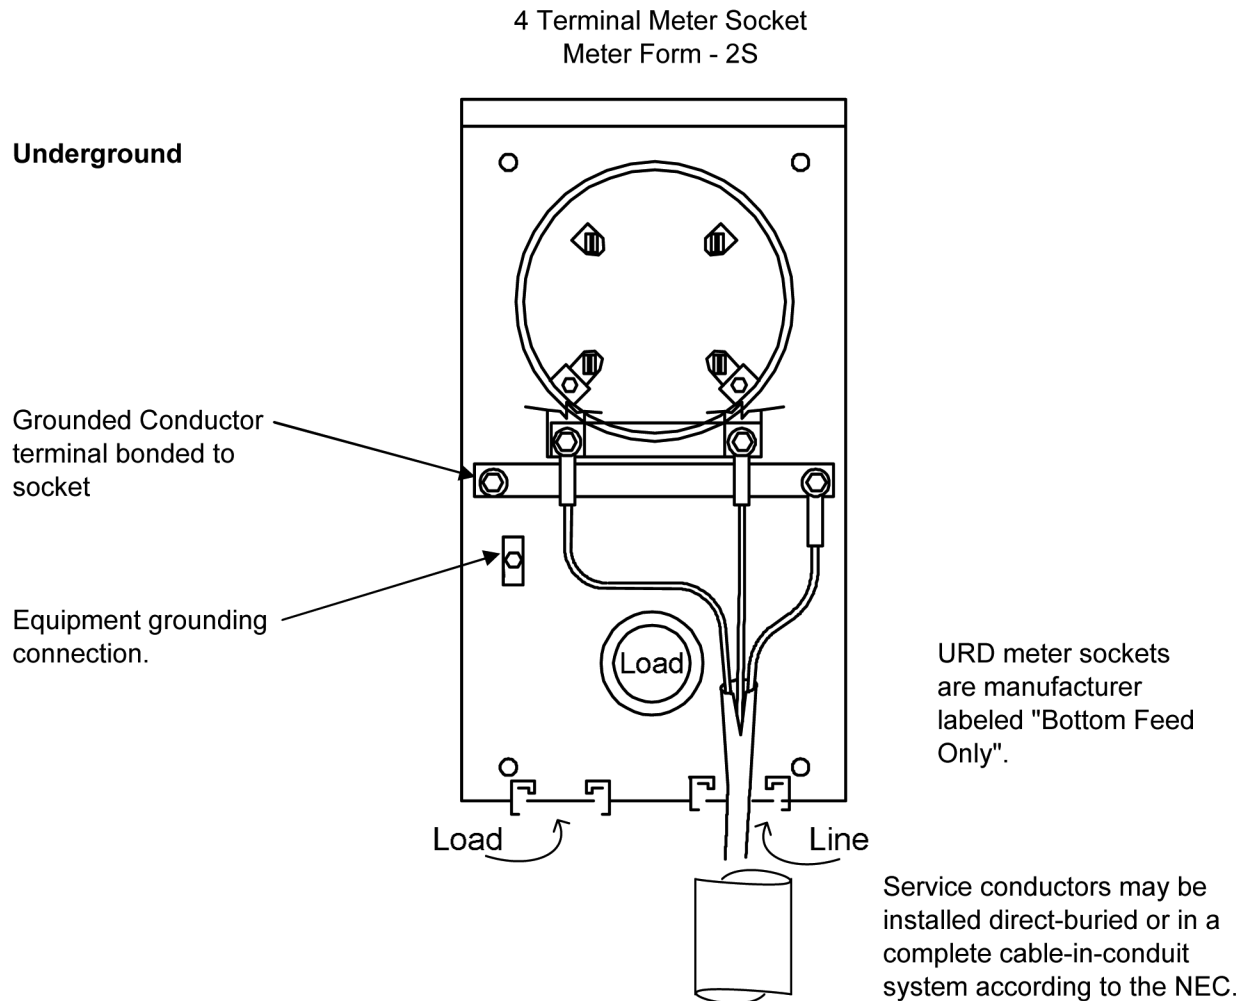

See Tables 7.2-1 through 7.2-3 for further details on application, requirements, and responsibilities.


**Figure 7.3-3 Typical Single Phase Residential or Commercial Meter Socket Connections
120/240 Volt or 120/208 Volt or 277/480 Volt, 3 Wire, 320 Ampere Maximum Continuous Duty**

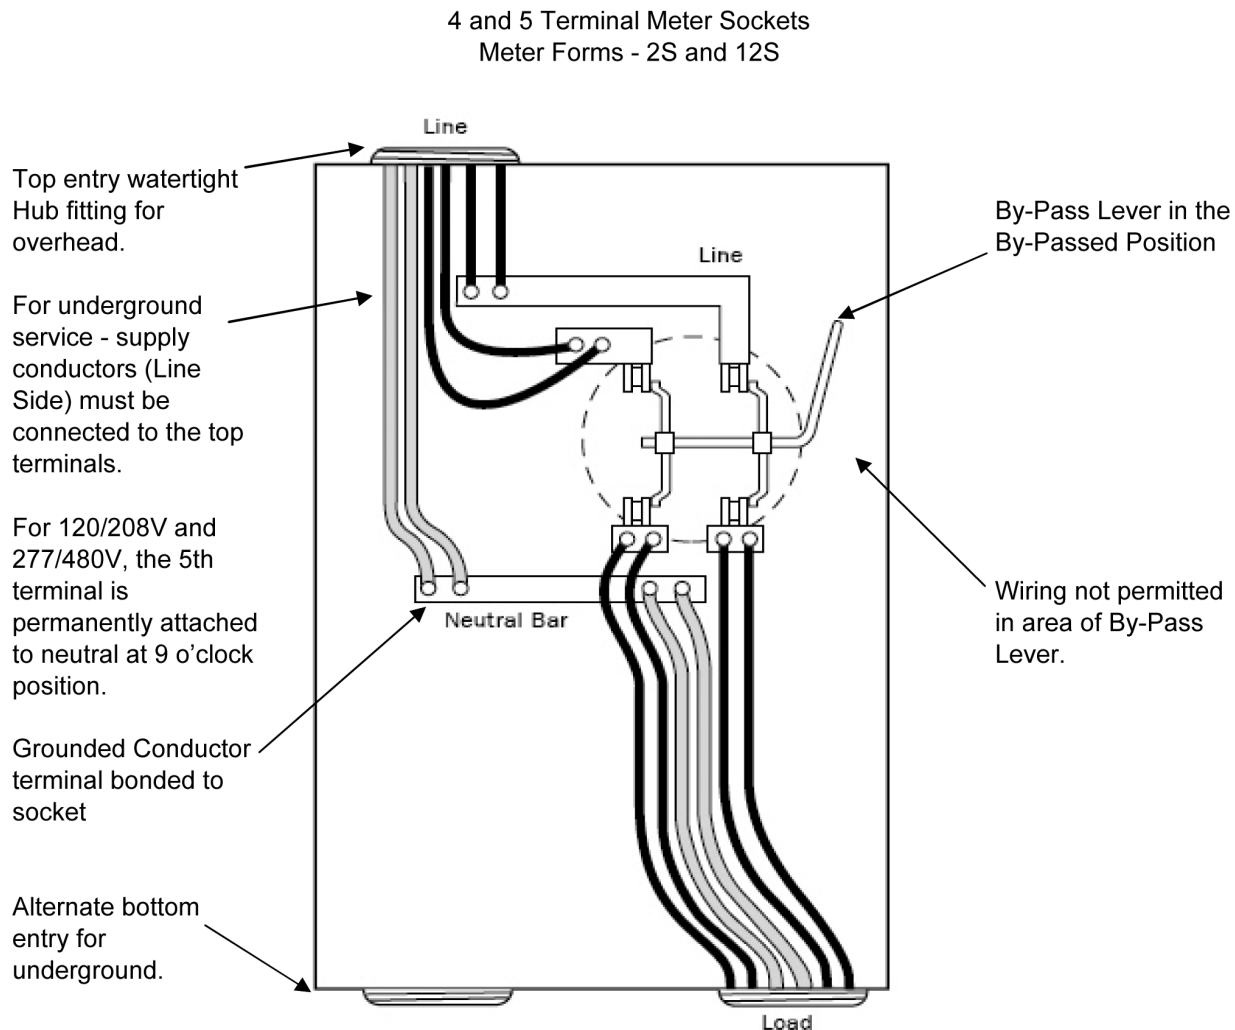

- ✓ Applications: For Single phase 3 wire 120/240 volts or 120/208 volts or 277/480 volts 320 ampere continuous service (one meter installation).
- ✓ Service entrance cable or service entrance conductors shall be installed according to the NEC. Side or rear entry (exit) not permitted. The preferred wiring for overhead installation is in the top of the meter socket and exiting the bottom. The preferred wiring for underground installation is in the bottom left side of the meter socket and exiting the bottom right side.
- ✓ Underground service conductors for residential may be installed direct-buried or in a complete cable-in-conduit system according to the NEC. Conduit is required for commercial.

See Tables 7.2-1 through 7.2-3 for further details on application, requirements, and responsibilities.


Figure 7.3-4 Typical Single Phase Residential or Commercial Meter Socket Connections 120/208 Volt and 277/480 Volt, 3 Wire, 200 Ampere Maximum Continuous Duty

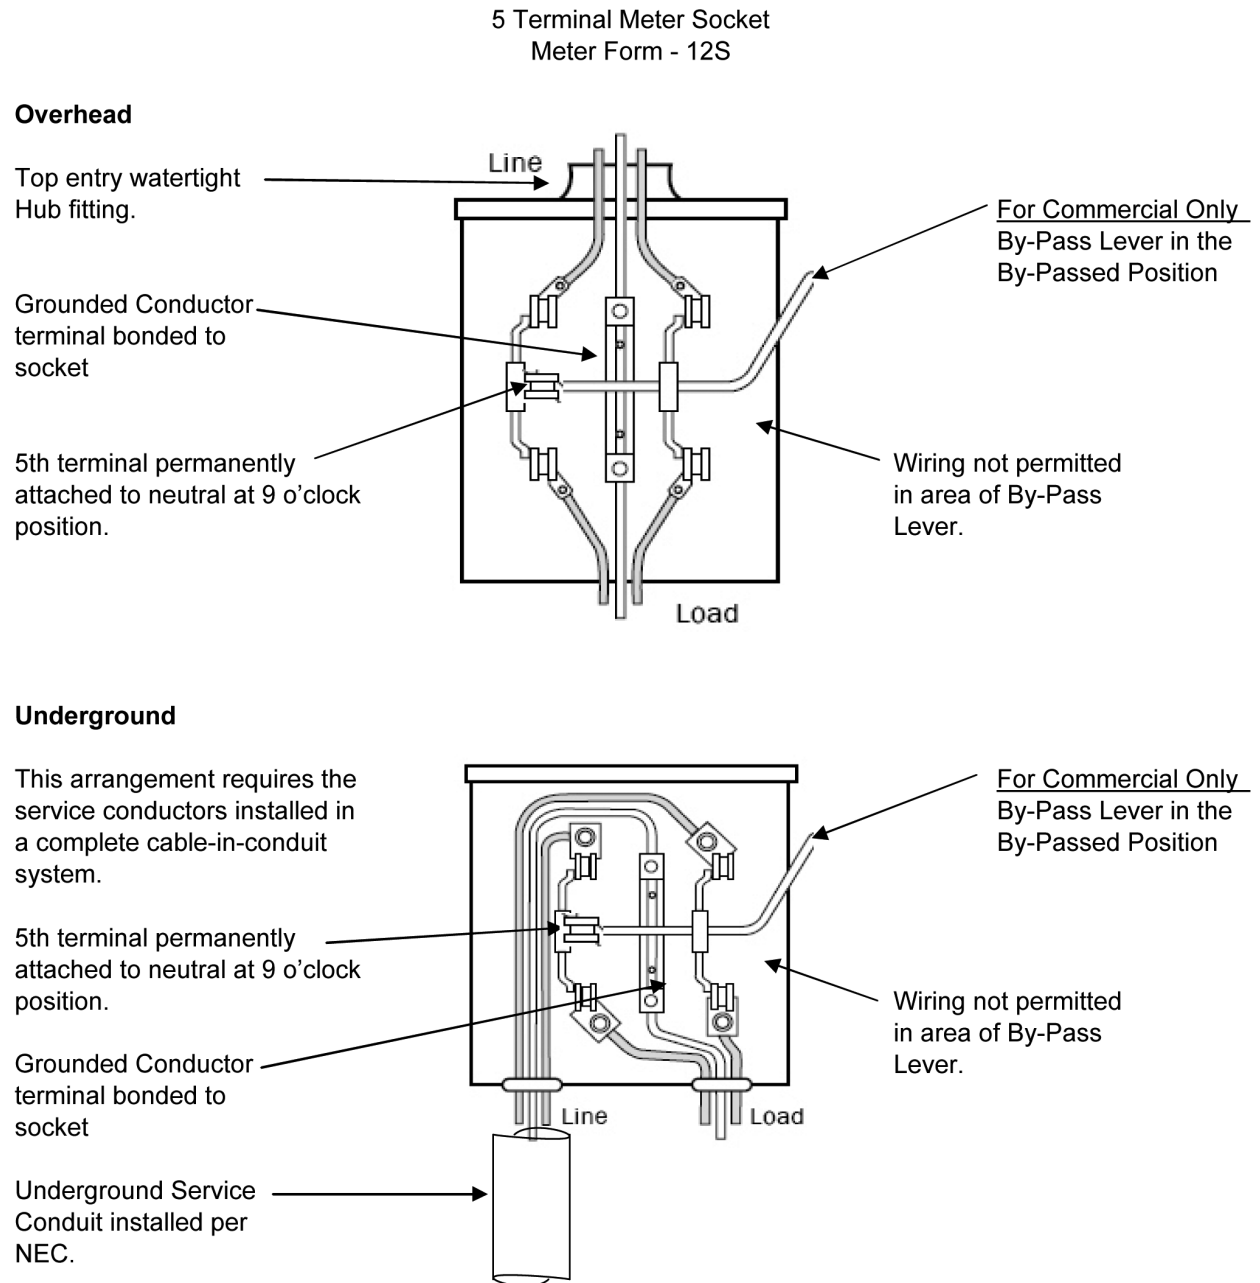

All 480 Volt class self-contained meters shall be cold sequenced.

See Tables 7.2-1 through 7.2-3 for further details on application, requirements, and responsibilities.

Figure 7.3-5 Typical Three Phase Commercial Meter Socket Connections 208Y/120 Volt and 480Y/277 Volt, 4 Wire, 200 Ampere Maximum Continuous Duty

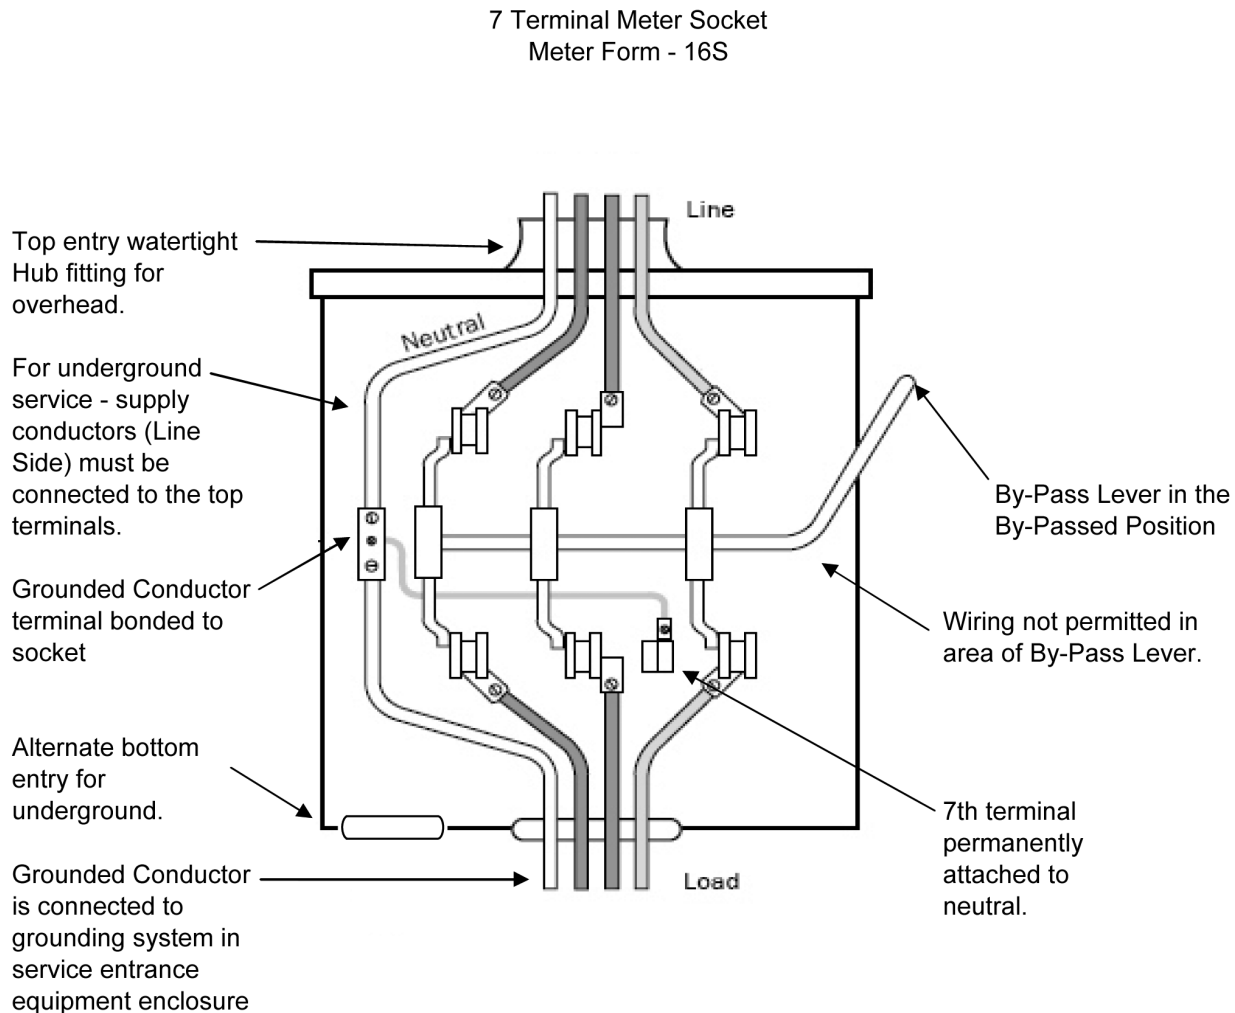


Service conductors shall be installed in a complete cable-in-conduit system according to the NEC.

All 480 Volt class self-contained meters shall be cold sequenced.

See Tables 7.2-1 through 7.2-3 for further details on application, requirements, and responsibilities.


Figure 7.3-6 Typical Three Phase Commercial Meter Socket Connections 208Y/120 Volt and 480Y/277 Volt, 4 Wire, 320 Ampere Maximum Continuous Duty

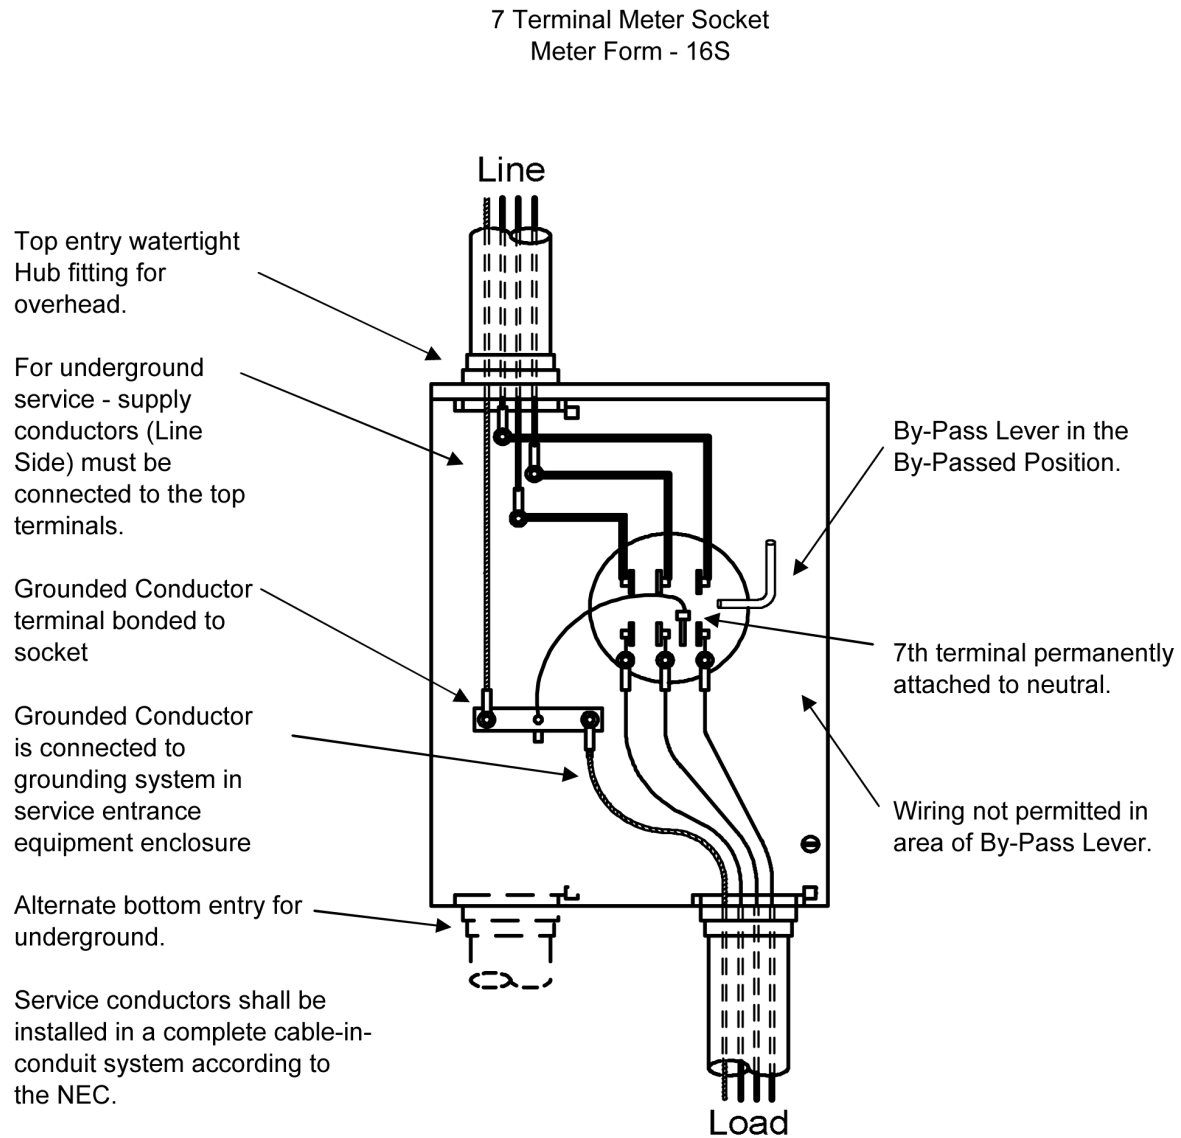

- ✓ Applications: For three phase 4 wire 208 wye/120 volts or 480 wye/277 volts 320 ampere continuous service (one meter installation).
- ✓ Service entrance cable or service entrance conductors shall be installed according to the NEC. Side or rear entry (exit) not permitted. The preferred wiring for overhead installation is in the top of the meter socket and exiting the bottom. The preferred wiring for underground installation is in the bottom left side of the meter socket and exiting the bottom right side.
- ✓ Cold sequence metering arrangement is required if single-phase 277/480V or 3 phase 480Y/277V service.

See Tables 7.2-1 through 7.2-3 for further details on application, requirements, and responsibilities.


Figure 7.3-7 Typical Single Phase Residential or Commercial 2-to-6 Ganged Meter Socket Connections 3 Wire, 120/240 Volt 150 Ampere and 120/208 Volt 100 Ampere, Maximum Continuous Duty per

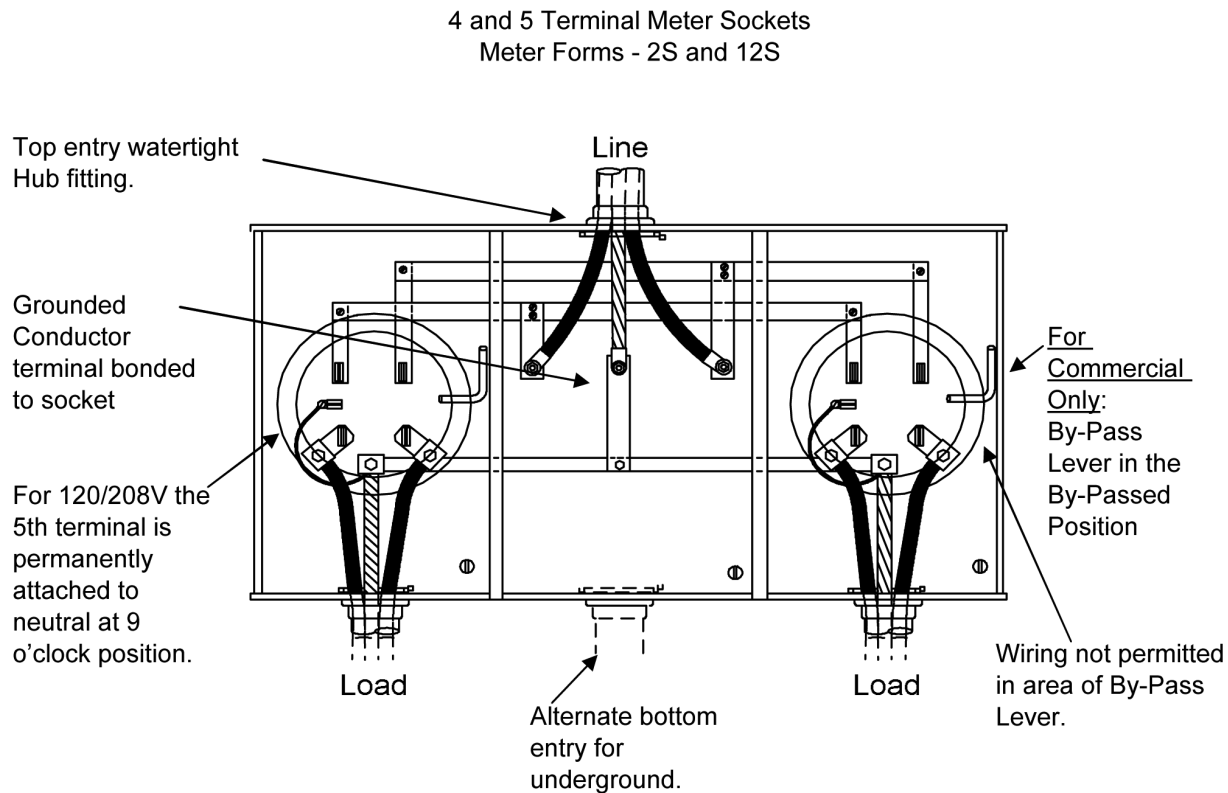

- ✓ One-hole pad crimp-type or spring type compression connector for 3/8"(10mm) stud size to be furnished and installed by customer.
- ✓ Fifth terminal supplied by Customer. Connected to socket trough neutral stud by Customer with #10 AWG copper insulated conductor.
- ✓ Multimeter channel cannot be modified for additional positions.
- ✓ Connect grounded circuit conductor to service equipment neutral bus.
- ✓ Grounding system shall be installed according to NEC requirements.
- ✓ Load side to Customer's service equipment. If the meters serve another building or structure, service equipment shall be adjacent to the meters.
- ✓ For underground service, service conductors for residential may be installed direct-buried or in a complete cable-in-conduit system according to the NEC. Conduit is required for commercial.

See Tables 7.2-1 through 7.2-3 for further details on application, requirements, and responsibilities.

Figure 7.3-8 Typical Residential or Commercial Service Pedestal Single Phase Service 120/240 Volt 200 Amp and 120/208 Volt 100 Amp, 3 Wire Figure

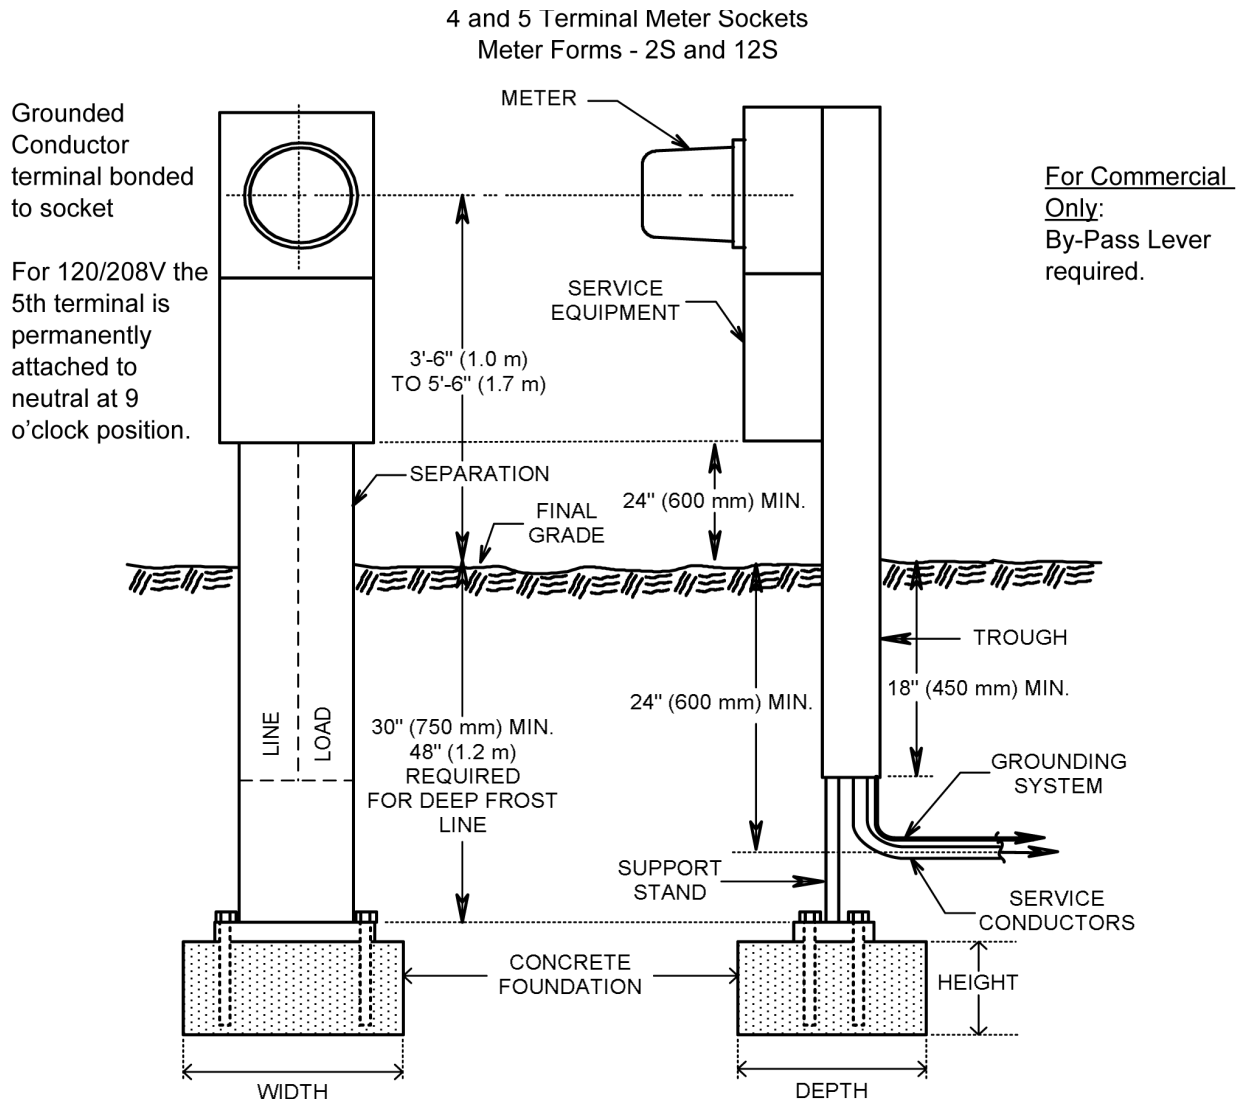


- ✓ Applications include mobile homes, residential, and small commercial service.
- ✓ Grounding system installed as required by NEC.
- ✓ Underground service conductors to handhole or transformer by Customer for residential may be installed direct-buried or in a complete cable-in-conduit system according to the NEC. Conduit is required for commercial. Metered and unmetered conductors shall not occupy same raceway. Six inch (150mm) minimum cable separation between line and load cables in common trench.
- ✓ Concrete footing minimum dimensions shown for a single pedestal [28" (710mm) wide, 18" (450mm) deep, 12" (300mm) high] greater size footing required for multiple or larger pedestal units.
- ✓ Service pedestal to be furnished, installed and maintained by Customer. Pedestal shall meet Table 7.2.-2 for meter socket section. Pedestal location shall be accepted by the Company.
- ✓ Other service supports may be considered. Prior approval is required from the Company.

See Tables 7.2-1 through 7.2-3 for further details on application, requirements, and responsibilities.


4 and 5 and 7 Terminal Meter Sockets

Meter Forms - 2S and 12S and 16S

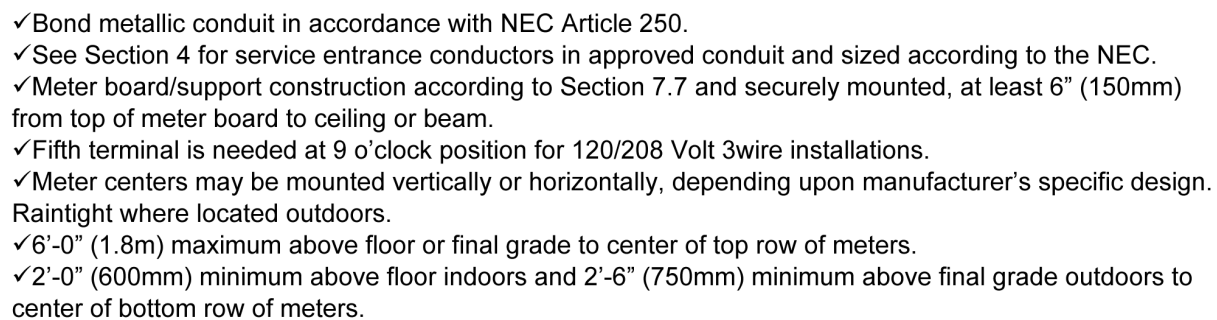

82 For the latest authorized version, please refer to the company's website at <http://www.nationalgridus.com/electricalspecifications>.

Figure 7.3-10 Typical Mobile Home and Recreational Vehicle Park Meter Socket Applications

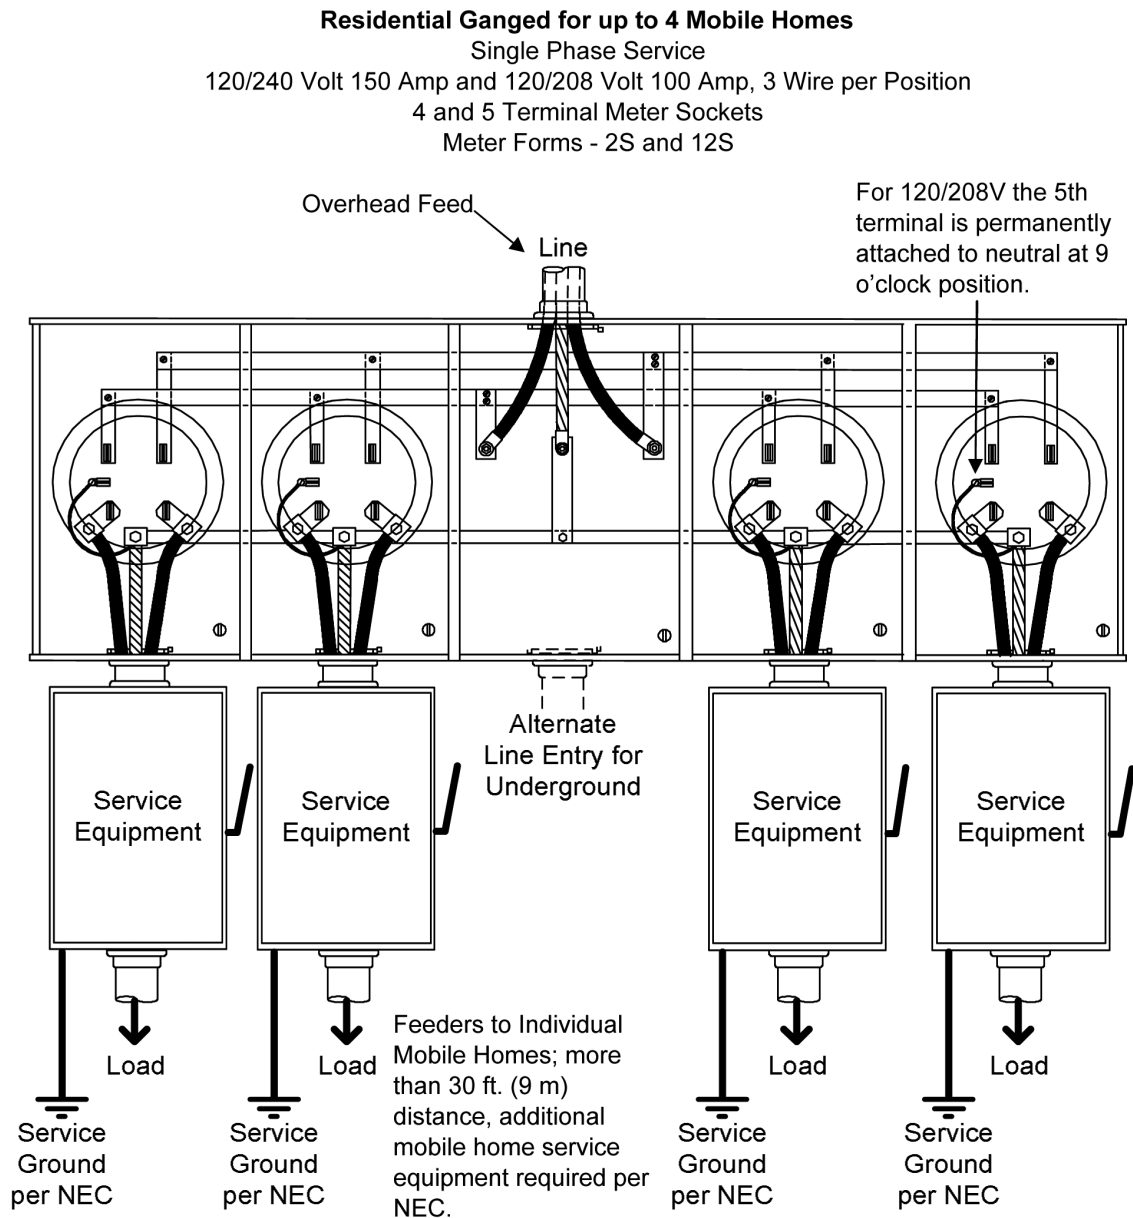

- ✓ Service arrangement to be used for existing overhead served mobile home parks or new groups of up to four mobile homes where URD rules do not apply and where single meter or grouped indoor meter installation is not practical.
- ✓ See Section 4 for service entrance conductors in approved conduit and sized according to the NEC. If metallic conduit, bond conduit in accordance with the N.E.C.
- ✓ Install service entrance ground in accordance with N.E.C.
- ✓ Outdoor meter support materials and construction according to Section 7.7 and securely mounted.
- ✓ Meter sockets are supplied by the Customer and the Company will supply meters.
- ✓ All meter sockets shall be permanently marked and labeled with individual mobile homes served.

See Tables 7.2-1 through 7.2-3 for further details on application, requirements, and responsibilities.


For metered service pedestal serving a mobile home underground, see Figure 7.3-8.

7.4 TRANSFORMER-RATED METERING 600 VOLTS AND LESS, 400 AMPS AND ABOVE

7.4.1 Instrument Transformers and Enclosures

The Company will specify and furnish the quantity and type of all current and voltage transformers for revenue metering. The Customer shall install all instrument transformers except those for pad-mounted metering. Enclosures shall be approved by the Company but furnished and installed by the Customer *[New requirement in NY.]*. All transformer enclosures must have facilities for Company locks. Instrument transformer cabinets shall not be used as junction boxes or for branch circuit wireways. The preferred entry and exit wiring method for metering transformer cabinets are from the side not the top or bottom. The Customer shall consult with the Company prior to transformer-rated meter cabinet installation when considering a meter installation using other than the preferred wiring configuration. In some cases, the Company may choose to supply the instrument transformers to be installed by the switchgear manufacturer. The following illustrations are typical transformer-rated metering arrangements required for the applications and requirements specified in Section 7.2.

Figure 7.4.1-1 Typical Commercial CT Cabinet Secondary Metering Installation

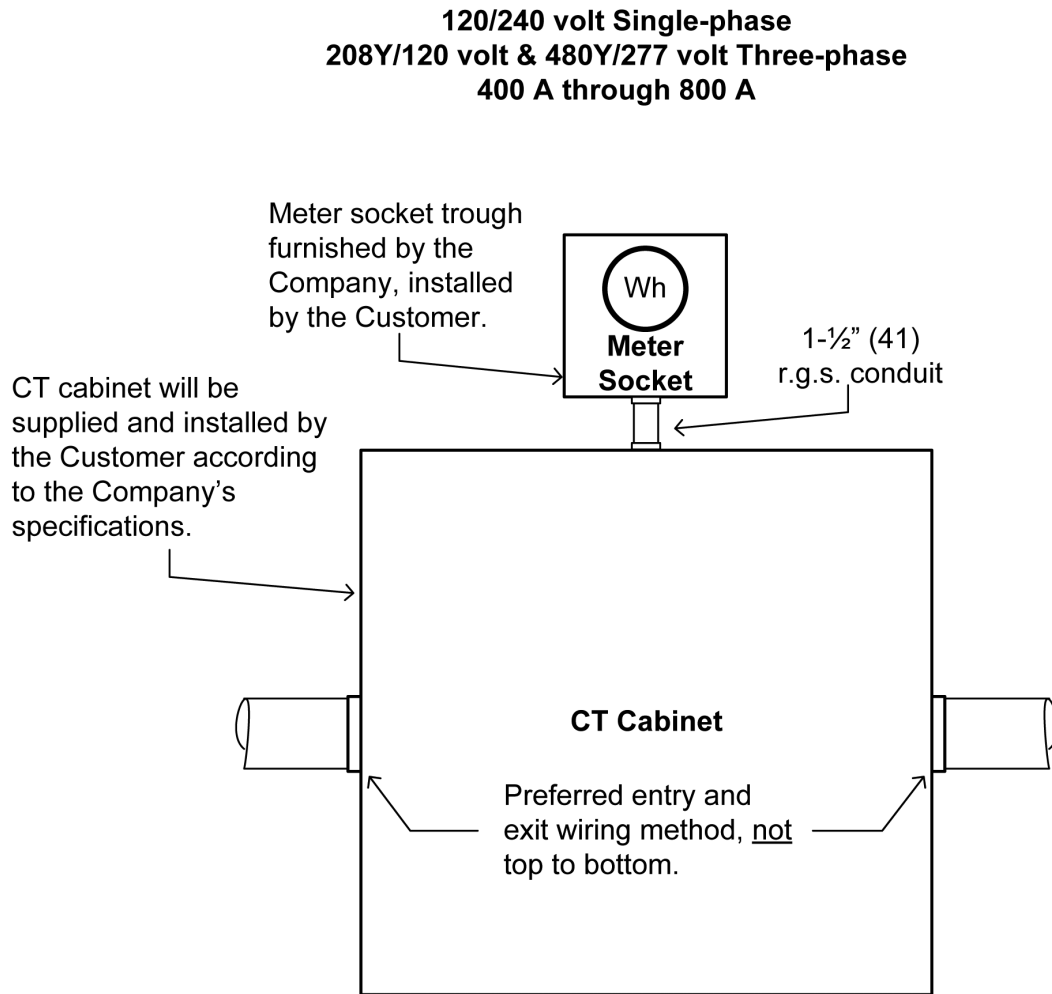


Customer-owned Metering CT Cabinet Requirements:

- ✓ Minimum Size - 36" (900 mm) wide x 36" (900 mm) height x 10" (250 mm) deep
- ✓ Rolled Lip Cover
- ✓ Permanently installed hinge pins, removable cover in open position
- ✓ Padlock and Sealing Provisions
- ✓ NEMA 3R Rainproof Enclosure Indoor/Outdoor Use
- ✓ Listed by Independent Recognized Testing Laboratory
- ✓ Mounting Provisions for Field-installed Instrument Current Transformers
- ✓ Preferred entry and exit wiring on sides; not top and bottom
- ✓ Grounding Stud

See Tables 7.2-1 through 7.2-3 for further details on application, requirements, and responsibilities.

**Figure 7.4.1-2 Typical Indoor Commercial Installation Two to Six Meter Service Entrance 800A
Maximum From Overhead Line**


**Typical Indoor Commercial Installation Two to Six Meter
Service Entrance 800A Maximum From Overhead Line**

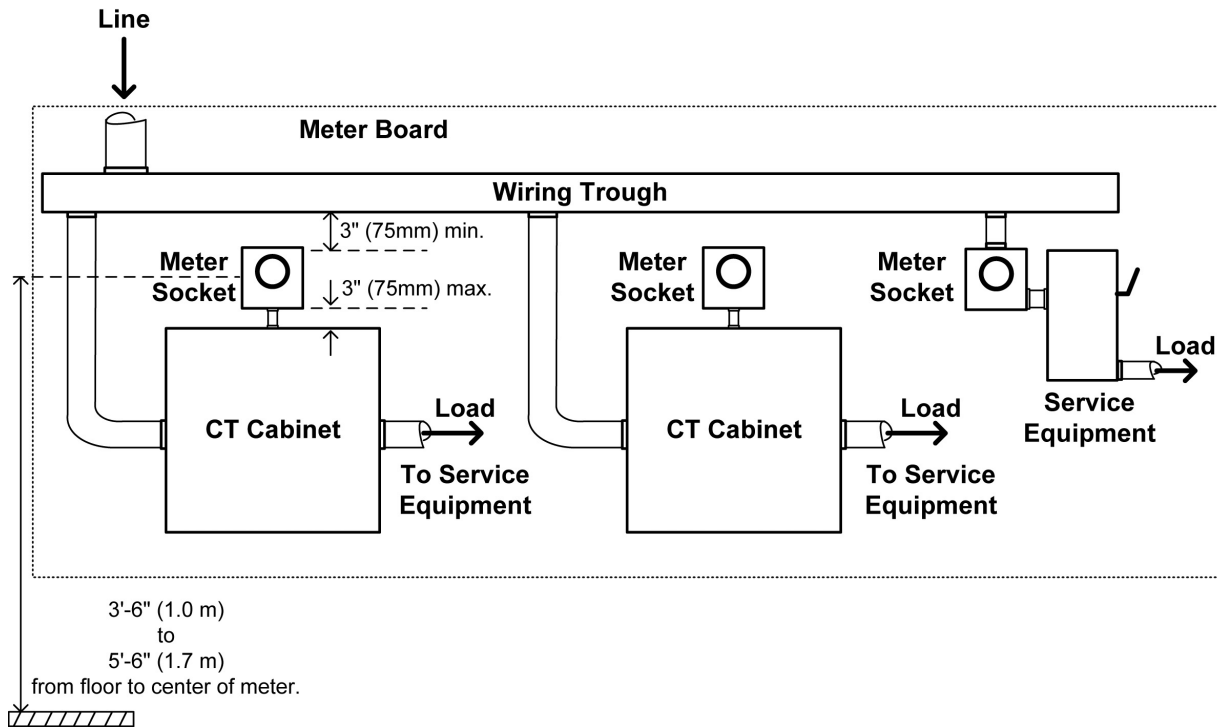

- ✓ See Section 7.4.1 and Figure 7.4.1-1 for metering CT cabinet requirements, 400A to 800A.
- ✓ 1-½" (41) rigid galvanized steel conduit required between CT cabinet and meter socket.
- ✓ See Sections 7.2 and 7.3 for appropriate self-contained meter socket installations below 400A. Cold sequence installation required for 480V class self-contained meter sockets.
- ✓ Wiring trough in accordance with NEC requirements and includes provisions for locking or sealing by the Company.
- ✓ See Section 7.7 for Meter Board requirements.

See Tables 7.2-1 through 7.2-3 for further details on application, requirements, and responsibilities.


Figure 7.4.1-3 Typical Indoor Commercial Installation One Meter Service Entrance from Network or Radial Underground Line Three-Phase, 4 Wire, 208Y/120V, 400A

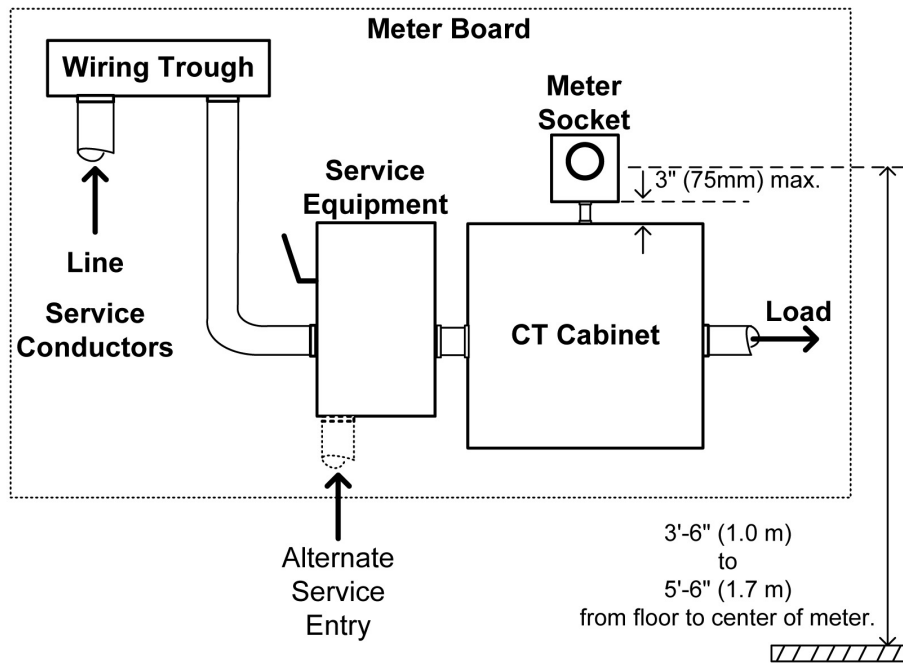

- ✓ See Section 7.4.1 and Figure 7.4.1-1 for 400A metering CT cabinet requirements.
- ✓ 1-½" (41) rigid galvanized steel conduit required between CT cabinet and meter socket.
- ✓ Wiring trough in accordance with NEC requirements and includes provisions for locking or sealing by the Company.
- ✓ See Sections 4 and 5 for underground service connection requirements (radial underground line and network services).
- ✓ See Section 7.7 for Meter Board requirements.

See Tables 7.2-1 through 7.2-3 for further details on application, requirements, and responsibilities.

Figure 7.4.1-4 Typical Outdoor Service Pole Installation Single-Phase, 3 Wire, 120/240V for Loads 72 to 100kVA Demand or Three-Phase up to 800A From Overhead Line

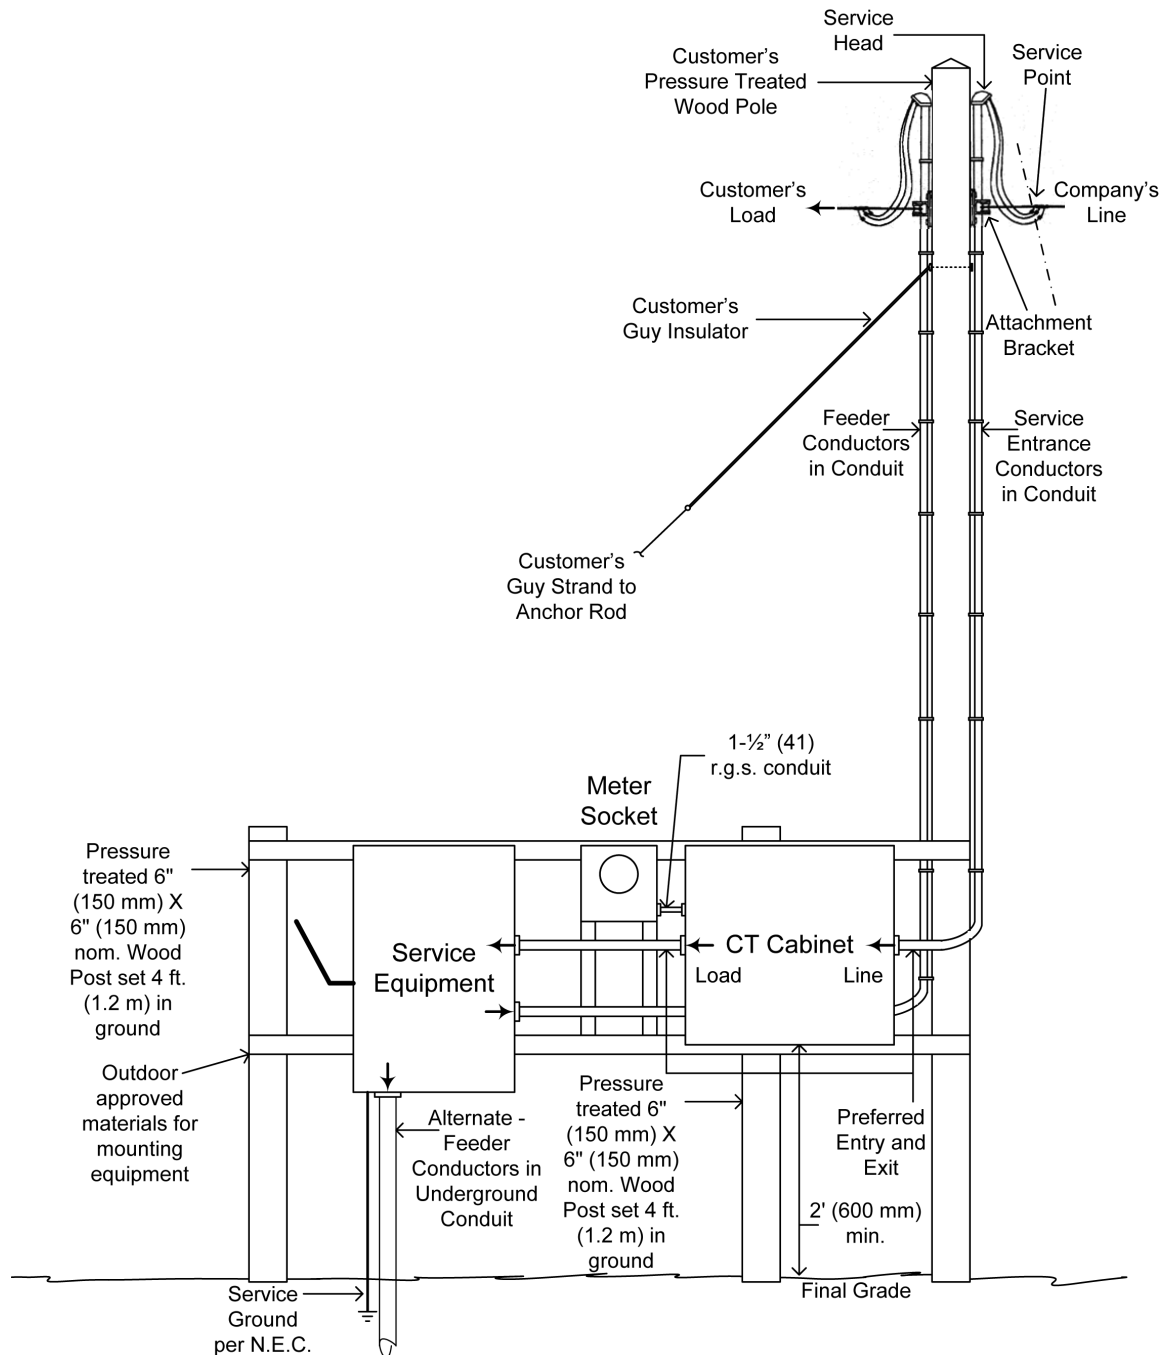

- ✓ See Section 7.4.1 and Figure 7.4.1-1 for metering CT cabinet requirements, 400A to 800A.
- ✓ See Section 7.7 for Meter Support requirements.

See Tables 7.2-1 through 7.2-3 for further details on application, requirements, and responsibilities and Section 4 for overhead service connection requirements.

7.4.2 Meter Sockets

The Company will furnish meter sockets for use with instrument transformers. Meter socket enclosures shall be installed by the Customer at the Company's specified location and wired by the Company. Where the metering is on a pad-mounted transformer, the Company will both install and wire the meter socket.

7.4.3 Metering Sequence

All metering equipment shall be installed on the line side of the service disconnecting means (Hot Sequence) with the exception of network services. Network services shall have metering equipment installed on the load side of the service disconnecting means (Cold Sequence).

7.4.4 Instrument Transformer Secondaries

The Customer will furnish and install a 1-1/2 inch (41) rigid galvanized steel conduit between the instrument transformer enclosure and the meter socket which shall be in the same location within sight. The use of conduit body fittings (condulets) with removable covers is not acceptable. The maximum distance between the instrument transformers and the meter shall be 50 feet (15 meters). Secondary wiring will be furnished and installed by the Company.

7.4.5 Pad-mounted Transformer Service Metering

At the Company's option where a single customer is supplied from a 300 kVA or larger pad-mounted transformer, bushing current transformers will be used. The meter socket will be mounted on the outside of the secondary voltage compartment of the pad-mounted transformer.

7.4.6 Metal-Enclosed Free-Standing Service Cubicles Rated 600 volts or Less (Secondary Voltage Installations)


7.4.6.1 General

The Customer shall provide the Company with equipment specifications prior to ordering any equipment. All components of equipment shall conform to the latest editions of all applicable IEC & ANSI standards, and the Company recommends that all equipment be certified and approved by a laboratory testing organization such as UL, ETL, CSA, etc.

7.4.6.2 Metering Sequence

Refer to Section 7.4.3 and see Figure 7.4.6.2-1.

Figure 7.4.6.2-1: Instrument Transformer Metering Sequence - Service Cubicles Rated 600 volts

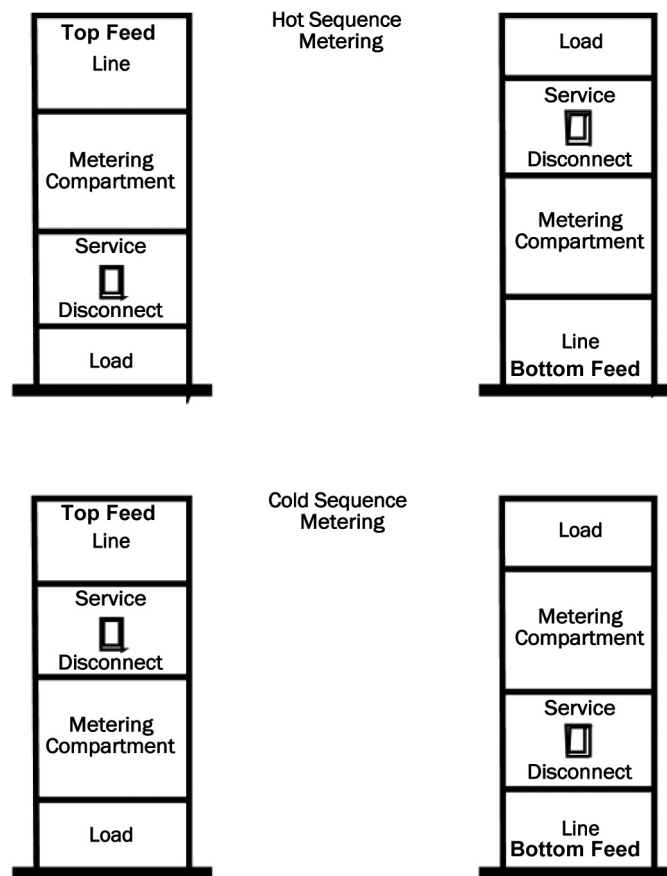

Note: Cold sequence metering is required on the network system.

7.4.6.3 Unmetered Supply Conductors

Compartments enclosing unmetered supply conductors shall be accessible through hinged doors or removable panels provided with hardware for the installation of locks as specified by the Company.

7.4.6.4 Meter Location

A meter location shall be provided that is large enough for mounting a meter socket supplied by the Company. The meter socket shall be installed at the location assigned by the Company, as near as practical to the instrument transformers. The maximum distance between meter and instrument transformers shall not exceed 50 feet (15 meters). A continuous run of rigid metal conduit shall be provided by the Customer between the meter socket and the instrument transformers.

7.4.6.5 Customer's Auxiliary Equipment

The connection of the Customer's auxiliary transformer for heat, light and receptacle(s) installed at the meter panel location and elsewhere within the Customer's switchgear, shall be on the load side of the Company's instrument transformers.

7.4.6.6 Metering Transformer Equipment Compartment


A separate properly barriered compartment, completely isolated within the equipment, shall be provided for the installation of current and voltage transformers of a type and rating as specified and furnished by the Company. This compartment shall be designed so that each of the transformers can be readily removed or changed without disturbing the others after installation and shall be solely accessible by the Company. (See Figure 7.4.6.7-1.) The Customer shall have provisions in the metering transformer compartment for the Company's connection of the metering potential neutral to the service equipment neutral bus.

Where the metering transformer compartment is located in an unheated area or building, provisions shall be made for heating the compartment to prevent condensation. The Customer shall maintain a minimum 10 feet (3 m) unobstructed clearance in front of the instrument transformer compartment door. The compartment shall be solely accessible by the Company, any section-to-section openings for through bus shall be as small as phase to ground clearance will allow. Phase buses shall be mechanically independent of the instrument transformers and the transformers shall be not part of the bus support system. Removable bus bar sections shall be provided by the Customer to permit installation and removal of current transformers. Silicon-bronze bolts and stainless steel nuts and washers shall be provided by the Customer for connection of the Company's current transformers.

Access to the metering compartment shall be through a full door hinged to permit horizontal swing of at least ninety degrees and provided with hardware for locking as specified by the Company.

No equipment other than Company owned metering equipment shall be installed in the compartment. Transformers shall be installed in each position so that the rating and polarity marks are readily and safely readable.

Figure 7.4.6.6-1: Metering Instrument Transformer Compartment in Service Cubicles Rated 600V
Hot Sequence Metering

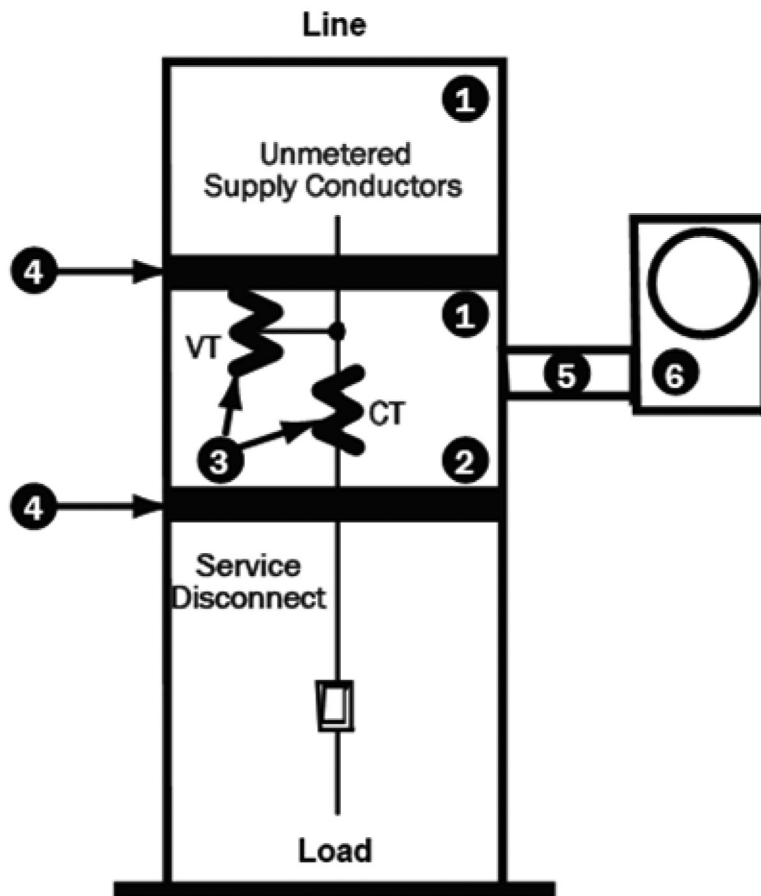

Notes:

1. Compartments lockable.
2. Instrument transformer compartment.
3. Metering transformer supplied by the Company.
4. Insulating barriers.
5. 1-1/2" (41) Rigid Galvanized Steel conduit.
6. Meter socket mounted adjacent to service cubicle.
7. A connector shall be provided in the metering transformer compartment for purposes of connecting the metering potential neutral to the incoming service neutral.

7.4.6.7 Voltage Transformers

In general only within MA, NH, and RI, voltage transformers will be supplied for metering services where the supply is 240 volts or greater. Primary connections for the voltage transformers shall be made on the supply side of the current transformers. Instrument transformer-rated metering 400 amperes and greater, below 600 volts applications in Upstate NY do not require voltage transformers.

7.5 METERING ABOVE 600 VOLTS

Where the service exceeds 600 volts, the Customer shall consult the Company. In such cases, the Company will furnish additional information about the metering requirements. See Electric System Bulletins 751 and 758 for primary metering transformer compartment requirements within medium voltage rated Customer-owned switchgear. In addition, see ESB 753 for typical primary meter pole and ESB 752 for typical outdoor substation metering requirements.

7.6 METERING PULSE SIGNALS

At the Customer's request, the Company will install at the Customer's expense at the point of metering a source of kWh pulses so that the Customer may monitor load/demand for the purpose of load control. Time pulses will not be provided. The Company is not responsible for customer equipment failure for the loss of pulse signals.

Analog signal provisions are subject to the Company's applicable tariff; consult the Company for application.

7.7 METER BOARDS AND SUPPORTS

7.7.1 Meter Mounting

All meters shall be durably and securely mounted in a true vertical position on a flat surface.

7.7.2 Approved Materials

The Customer shall provide and mount a meter support for each installation.

Materials acceptable for all installations are:

- ▶ 3/4 inch (19 mm) marine grade plywood.
- ▶ Galvanized steel slotted framing channel (Kindorf, Unistrut, Superstrut, or approved equal) 12 gauge zinc coated steel, with holes, 1-1/2-inch (38 mm) h X 3/4-inch (19 mm) w X (length = width of associated meter socket), two required, one for top, one for bottom. Zinc coated steel bolts 1/4-inch (6 mm) dia. X 3/4-inch (19 mm) long with nut and washer, total of four required, two for top, two for bottom of meter socket.
- ▶ 1-1/2-inch (38 mm) thick minimum pressure treated wood (approved outdoor ground contact rating minimum) with zinc coated lag bolts, two required, one for top, one for bottom of each board secured to structure.
- ▶ Masonry or solid brick wall of building with corrosion inhibiting protection applied to the meter enclosure.

Painted and/or treated 3/4-inch (19 mm) plywood board is acceptable in dry indoor locations. The support shall provide a clear space for mounting the Company's metering devices. Provision should be made for air circulation behind the meter board to inhibit "dry rot".

Where a meter support is required or used in an outdoor location, material used shall be protected from the effects of weather.

Irregular surfaces require provisions for flat support of meters. Meter boards are the preferred installation, alternatively, the building structure sub-surface may be used and the siding trimmed around the meter without interference of knockouts and meter cover.

Where service connection is made to the building, the meter shall be mounted on that building.

An outdoor manufactured meter pedestal as specified in Section 7.3 is also an approved meter support method.

8.0 MOTORS AND CONTROLLERS

8.1 GENERAL

It is important that the Company be consulted concerning the type of electric service available to insure correct application (phase and voltage) of the motor to be used. The correct application of motors is the Customer's responsibility. Motors should be sized to tolerate possible phase voltage unbalance, must be of a type that uses minimum starting current, and must conform to the Company's requirements and the applicable electrical code as to wiring, kind of equipment, and control devices. Starting current limitations are prescribed for conventional motorized equipment rated in horsepower and air conditioning or heat pump equipment rated in Btu/hr. Cases not covered in this section shall be referred to the Company.

8.2 SINGLE PHASE MOTORS

8.2.1 120 Volt Supply

Motors with ratings of one half ($\frac{1}{2}$) horsepower or less and window-type air conditioning units whose running-load current does not exceed $7\frac{1}{2}$ amperes, with not more than four (4) starts per hour and with a locked-rotor current not exceeding 50 amperes, may be connected to 120 Volt supply. Motors having a full load running current of more than $7\frac{1}{2}$ amperes but less than 12 amperes, and conforming to the above locked-rotor current limitations, may be connected to a 120 Volt branch circuit only if such branch circuit supplies the one unit and does not supply lighting units or other appliances. It is strongly recommended that units drawing more than $7\frac{1}{2}$ amperes full-load running current be connected to 240 or 208 Volt circuits. Generally, motors larger than 5 HP should be three phase but the Company may require that single-phase motors be used where three-phase service is not readily available.

8.2.2 208 or 240 Volt Supply

Motors with ratings larger than one half ($\frac{1}{2}$) but less than six and one-half ($6\frac{1}{2}$) horsepower will be regularly supplied at 208 or 240 volts, provided the locked-rotor current does not exceed the values given in Table No. 8.6-1. In predominantly residential areas, and for small commercial installations, the Company should be consulted before installing motors with ratings of three (3) horsepower or larger.

8.2.3 Maximum Locked-Rotor Currents

Single-phase motors supplied from combined light and power secondary systems shall not have locked-rotor current values in excess of those shown in Table No. 8.6-1. Motors having locked-rotor current values in excess of those shown in the table shall be equipped with starters that will limit the current to the values specified. Domestic laundry equipment with operating cycles and electrical characteristics as currently available are considered acceptable.

Motors that start more than four (4) times per hour are an exception to the above and may cause interference to other customers. Automatically (frequently) started motors for general use, such as motors for refrigerators, oil burners, and similar devices, shall not have a locked-rotor current exceeding 23 amperes at 120 volts or 19 amperes at 240 volts. For multi-motored devices arranged for starting of motors one at a time, the locked-rotor current limits shall apply to the individual motors.

8.2.4 Single-Phase Motors on Three-Phase Service

Where single-phase motors are supplied from a 3-phase service, they shall be properly balanced across the three (3) phases.

8.3 THREE-PHASE MOTORS

8.3.1 Size of Motors

In order that the proper capacity may be available to supply the load, the Company should be advised of the motors to be installed. In predominantly residential areas, the Company should be consulted before installing 3-phase motors with ratings over five (5) horsepower.

8.3.2 Maximum Locked-Rotor Currents

Three-phase motors supplied from a combined light and power secondary system shall not have locked-rotor current values in excess of those shown in Table No. 8.6-2. Starting compensators are ordinarily required for 3-phase motors seven and one-half (7½) horsepower and larger. Exceptions to this practice will be allowed to the extent local distribution facilities permit. Motors having current values in excess of those shown in the table shall be equipped with starters, which will limit the current to the values specified. Increment start motors must have not less than a one-half-second interval between steps. The Company should be consulted concerning the installation of three-phase motors ten (10) horsepower or larger and must be consulted on motors larger than 15 horsepower.

8.4 MOTOR PROTECTION

Protective devices shall be installed on the load side of the meter.

8.4.1 Overload Protection

All motors should be properly protected against overload, including overloads caused by low voltage conditions.

8.4.2 Protection Against Single-Phase Operation

Three-phase motors shall be protected against the possibility of the failure of any one phase of the supply circuit. Three overcurrent (overload) units shall be used, one in each phase, unless the motor is protected against single-phase operation by other approved means. It is the Customer's responsibility to protect three phase motors against the possibility of single-phase operation.

8.4.3 Reverse Phase Protection

On motors for passenger and freight elevators, cranes and hoists, and other equipment where reversal or direction of rotation might cause property damage or injury, approved reverse phase relays together with circuit breakers, or equivalent devices, should be used on all three phase installations so that the motor circuit will be opened in the event of loss of any phase or phase reversal. The operation of this relay and associated circuit breaker should be instantaneous and should be such that the circuit cannot be re-energized until the normal phase relations are restored.

8.4.4 Undervoltage Protection

Motors that cannot be safely subjected to full voltage at starting, or would start on return of normal voltage after an interruption and endanger life or property, shall be provided with automatic undervoltage protection. Such protective device shall ensure that with either no voltage or undervoltage, the motor will be disconnected from the line and the starter will be returned to the "off" position. Where continuous operation of motorized equipment is essential, motor controllers should be arranged to allow motors to operate through a transient no voltage condition lasting for 1/2 second. The Company shall be consulted where problems of this nature may be encountered.

8.5 MOTOR-STARTING REQUIREMENTS

8.5.1 Objectionable Voltage Variation

Momentary fluctuation of the circuit voltage occurs each time a motor is started on the circuit. Where this effect is pronounced, a visual disturbance or lighting flicker may be observed by the Customer or other Customers served from the same system. In extreme cases, the motor itself may have difficulty starting.

8.5.2 Current Inrush Limitation

To suppress objectionable voltage variations and maintain proper service to the Customer and its neighbors, it is necessary to set maximum permissible limits to the current drawn from the service during each step of a motor-starting operation, based upon the frequency of starts. These limits are designed to cover typical cases and the Company gives no warranty that particular conditions may not later require a change. The specific motor-starting current limitations stated in Section 8.6 or furnished by the Company indicate the maximum allowable increases in current on the line side of the motor-starting device at any instant during the starting operation.

These limitations do not restrict the total current that can be taken by the motor, but may require that this total be built up gradually, or in steps during starting. Where a step-type starter is used, an appreciable time must be allowed on each step and the current increase of each step shall not exceed the imposed limitation. Closed transition between starting steps is required.

When motors are started in a group instead of individually, the starting current limitations apply to the group and not the individual motors.

8.5.3 Favorable Locations

There are locations on the Company's system where starting currents larger than specified above can be permitted. These locations are on services from network systems, which supply large loads or where special conditions exist. The Company shall be consulted to determine whether larger starting currents per step will be permitted for a specified installation.

8.5.4 Company Notification of 3 HP Single Phase and 10 HP Three Phase Applications

The Company shall be advised before any single phase motor 3 HP (equivalent 25,000 Btu/Hr.) or larger, or any three phase motor rated 10 HP (equivalent 75,000 Btu/Hr.) or larger is purchased and/or installed by a Customer. The information to be given the Company shall include:

- | | |
|--|--|
| ▶ Largest HP | ▶ Motor application (i.e. sawmill, stone crusher, elevator, air conditioner, etc.) |
| ▶ Rated Voltage | ▶ Single phase or three phase |
| ▶ Rated PF | ▶ Locked Rotor indicating Code Letter |
| ▶ Is Motor started under load? | ▶ Frequency of motor starting and inrush current surges. |
| ▶ Type and characteristics of starter employed, if any | ▶ Type and characteristics of starter employed, if any |

8.6 MAXIMUM PERMITTED STARTING CURRENT

These tables are based on not more than four (4) starts per hour with long periods of continuous operation under maximum load conditions. Consult the Company if these conditions cannot be met.

The maximum starting currents permitted for a single phase and three-phase conventional motorized equipment rated in horsepower and for air conditioning or heat pump equipment rated in Btu/Hr. are:

Table 8.6-1 - Single Phase Motor Starting Current

Service Voltage	Max. Starting Current Per Step Max. Four Starts Per Hour	Max. Equiv. Rating of Air Conditioner or Heat Pump Btu/Hr.
120 volts	50 amperes	10,000
208 or 240 volts	60 amperes for 2 HP motor	20,000
208 or 240 volts	80 amperes for 3 HP motor	25,000
208 or 240 volts	Residential use - Consult Company. Commercial use - 120 amperes for 5 HP to 6.5 HP.	40,000

Table 8.6-2 - Three Phase Motor Starting Current

Service Voltage	Max. Starting Current Per Step Max. Four Starts Per Hour	Max. Equiv. Rating of Air Conditioner or Heat Pump Btu/Hr.
208 volts	100 amperes up to 5 HP motor	40,000
208 volts	130 amperes for 7-1/2 HP motor	50,000
208 volts	160 amperes to 10 HP motor	75,000
208 volts	230 amperes for 15 HP motor	150,000
480 volts	50 amperes up to 5 HP motor	40,000
480 volts	65 amperes for 7-1/2 HP motor	50,000
480 volts	80 amperes for 10 HP motor	75,000
480 volts	115 amperes for 15 HP motor	150,000

9.0 TRANSFORMER INSTALLATIONS ON CUSTOMER PREMISES

9.1 GENERAL

The Company may require installation of its transformers and other line equipment on the Customer's property. Customer shall provide suitable space, vaults, foundations or pads, conduit and enclosures as required by the Company. Customer shall provide satisfactory access at all times to the space, enclosures, or vaults for the Company to install, or remove, operate and maintain its equipment. Consult the Company for transformer installations in network, UCD, and URD areas.

9.2 INSTALLATIONS

One of the following general transformer installations may be used for services rated below 600 volts:

9.2.1 Cluster Mounted Overhead Transformers

9.2.1.1 Recommended

Where:

- ▶ the Company's system is a primary supply voltage,
- ▶ the required transformation does not exceed 3-100 kVA transformers for 208Y/120 volts, or 3-167 kVA transformers for 480Y/277 volts, and
- ▶ aesthetics are not of prime concern.

Note: *At the Company's sole discretion, request for overhead service above 200A at 480Y/277 volts or above 400A at 208Y/120 volts may be served by the Company's overhead secondary service conductors. However, demand of 150kVA or more is generally preferred to be supplied by a pad mounted transformer service. The Company shall discuss service arrangements with the Customer or Applicant accordingly.*

9.2.1.2 Company Furnishes

The Company will furnish, install, own and maintain:

- ▶ the primary service lateral including transformer pole, equipment, transformers, and
- ▶ one overhead service drop.

See Section 4 for service limitations, allocation of service line cost, and service drop requirements.

9.2.1.3 Customer Furnishes

The Customer shall provide:

- ▶ property on which to erect the terminal pole for the cluster mounted transformers, and
- ▶ the necessary right-of-way for the overhead primary circuit including guying.

9.2.2 Outdoor Single Phase Pad Mounted Transformer

9.2.2.1 Recommended

Where the length of the underground service lateral would be excessive.

9.2.2.2 Provisions:

The installation provisions and costs shall be in accordance with the Company's filed tariffs in the applicable state. See Section 4 and ESB's 751 and 754 for the underground primary service lateral and secondary service conductor connection provisions to single-phase pad mounted transformer installations.

Table 9.2.2.2-1 Company and Customer Outdoor Single Phase Pad Mounted Transformer Provisions

State	Company furnishes, installs, owns and provides maintenance for:	Customer furnishes, installs, owns and provides maintenance for:
MA & RI	<ul style="list-style-type: none"> ▶ an outdoor pad mounted transformer 	<ul style="list-style-type: none"> ▶ property on which to construct the transformer foundation ▶ transformer box pad foundation ▶ ground grid ▶ outdoor pad mounted transformer foundation excavation ▶ bollards, if required by the Company
NH	<ul style="list-style-type: none"> ▶ transformer box pad foundation ▶ an outdoor pad mounted transformer ▶ ground grid 	<ul style="list-style-type: none"> ▶ property on which to construct the transformer foundation ▶ outdoor pad mounted transformer foundation excavation ▶ bollards, if required by the Company
NY	<ul style="list-style-type: none"> ▶ transformer box pad foundation ▶ ground grid ▶ an outdoor pad mounted transformer 	<ul style="list-style-type: none"> ▶ property on which to construct the transformer foundation ▶ outdoor pad mounted transformer foundation ex ▶ bollards, if required by the Company

9.2.2.3 Installation Method

- ▶ For pad mounted transformer location considerations and requirements, refer to the Company's ESB 754.
- ▶ The Customer's underground service conductors approved for direct burial installed according to the NEC shall extend at least 10 feet (3.0 m) and be coiled within one foot (300 mm) of transformer for connection by Company.
- ▶ All connections, permanent or temporary, at the Company's transformer shall be made by the Company. The Company will not permit this connection to be made by others.
- ▶ Refer to the following figures for typical outdoor Single-Phase Pad Mounted Transformer installation requirements.

See Section 4 and ESB 751 for service limitations, allocation of service lateral cost, and service lateral cable installation requirements.

9.2.3 Outdoor Three Phase Pad Mounted Transformer

Refer to the Company's Electric System Bulletin Nos. 754 and 759B for outdoor three-phase pad mounted transformer installation requirements.

9.2.4 Transformer Vault in Non-Network Area

Refer to the Company's Electric System Bulletin No. 754 for indoor three-phase vault type transformer installation requirements.

9.3 AVAILABLE FAULT CURRENT

For equipment rating purposes, the following tables list the maximum fault currents available at the Company's transformer secondary terminals. These fault currents are based on the lowest impedance of transformers the Company procures and on infinite supply impedance on the primary side. Customer motor or parallel generator contributions and customer service conductor impedances are not included in figures given. Consideration for future load growth and subsequent transformer change-out may require initial installation of service equipment to have a larger fault current interrupting rating to ensure its suitability according to the NEC. Any costs associated with changes to Customer-owned equipment shall be borne by the Customer.

9.3.1 Network Services

Small network services have 100,000 amperes RMS symmetrical available fault current. However, available fault current in some network locations, particularly for services supplied from network transformer vaults, may exceed 100,000 amperes. The Customer must consult the Company for requirements particular to the area from which the network service will be provided.

9.3.2 Single Phase Transformers

Table 9.3.2-1 Single Phase Transformers Available Fault Current

kVA 1Φ Unit Transformer Rating	amperes RMS Symmetrical 240 Volt
25 & below	10,500
50	13,900
75	20,900
100	27,800
167	46,400

9.3.3 Three Phase Overhead Transformers

Table 9.3.3-1 Three Phase Overhead Transformer Available Fault Current

kVA		amperes Symmetrical Fault Current	
3 - 1Φ Units	Total 3 Bank	208Y/120 volts	480Y/277 volts
3-10	30	10,000	----
3-25	75	20,900	10,000
3-50	150	27,800	12,100
3-75	225	41,700	18,100
3-100	300	55,600	24,100
3-167	500	92,600	40,100
3-250	750	138,800	60,200
3-333	1,000	----	80,200
3-500	1,500	----	120,300

9.3.4 Three Phase Pad Mounted Transformers

Table 9.3.4-1 Three Phase Pad Mounted Transformer Available Fault Current

kVA	amperes Symmetrical Fault Current	
3Φ Units Pad Mounted	208Y/120 volts	480Y/277 volts
75	20,900	10,000
150	34,700	15,100
300	69,400	30,100
500	92,600	40,100
750	41,700 *	18,100 *
1,000	55,600 *	24,100 *
1,500	----	36,100 *
2,000	----	48,200
2,500	----	60,200

* Size interrupting rating for largest fault current the service could expect.

10.0 DISTURBANCES AND POWER QUALITY

10.1 GENERAL

Customers with equipment that cause interference on the Company's system affecting other customers; shall, upon notice from the Company, take immediate remedial measures to avoid such interference. Customers shall provide any facilities necessary to secure their own equipment against disturbances including but not limited to loss of phase, transients, voltage pulses or harmonic or carrier frequencies whether originating with their own equipment or elsewhere. These facilities shall be installed on the load side of the Customer's service equipment.

The Company is not responsible for disturbances resulting from weather conditions, acts of God, operations on the Company's system that are within good utility practice, or that may be generated by the operation of other Customer-owned equipment. The Company's goal is to provide a high quality service, and it will make every effort to work with its Customers to identify and to minimize the effects of these disturbances. If disturbances do occur, the Customer is advised to call the Company's Customer Service Center.

10.2 MOTORS

All motors connected to the Company's lines shall be of a type that shall have inrush current and other operating characteristics deemed acceptable by the Company. (See Section 8 for recommendations and guides on motors and controllers.)

10.3 DEVICES WITH INTERMITTENT HIGH CURRENT

The operation of large flashing signs over 10 kVA, arc welders, resistance welding machines, arc furnaces, dielectric and induction heaters, electric furnaces and boilers, heat pumps, X-ray equipment, motors connected to variable load machinery, reciprocating compressors, pumps, molding machines, rock crushers and similar apparatus having intermittent flow of large currents sometimes interferes with other users of the electric service and may require special facilities for satisfactory service. The Customer shall consult the Company in each case so that the type of electric service that will be supplied, the corrective equipment needed and other special precautions that must be taken will be mutually known factors before planning to use such apparatus. The Company in accordance with its applicable tariff may withhold connection to such loads which are considered detrimental to the service of other customers.

10.4 AUTOMATIC RECLOSING

Where the Company has installed on its facilities equipment for automatic reclosing after an interruption of power supply, it shall be the obligation of the Customer to provide at its expense:

- ▶ adequate protective equipment for all electrical apparatus of the Customer that might be adversely affected by the Company's reclosing equipment, and
- ▶ such equipment as may be required for the prompt disconnection of any apparatus of the Customer that might affect proper functioning of the Company's reclosing equipment.

10.5 ELECTRICAL INTERFERENCE

If at any time devices (i.e. carrier frequency systems, SCR controllers, etc.) installed by the Customer are causing interference on the electrical system of the Company, Customer, or to any other person, then upon notice from the Company, it shall be the responsibility of the Customer to install remedial equipment or take such other measures as may be necessary to reduce such interference to a tolerable level. Table 10.5-1 can generally be used as a guide for what are tolerable levels for current distortion. The Company, at its own discretion, may relax these limitations provided no interference is experienced. Table 10.5-2 for voltage distortion shall be adhered to. In certain cases a more stringent limitation may apply.

Table 10.5-1 Harmonic Current Limits for Non-Linear Loads at the Point-of-Common-Coupling (PCC) with Other Loads, at Voltages of 120V to 69kV

MAXIMUM HARMONIC CURRENT DISTORTION IN % OF FUNDAMENTAL						
	HARMONIC ORDER (ODD HARMONICS)					
I_{sc} / I_L	< 11	$11 \leq h < 17$	$17 \leq h < 23$	$23 \leq h < 35$	$35 \leq h$	THD
$< 20^*$	4.0	2.0	1.5	0.6	0.3	5.0
20-50	7.0	3.5	2.5	1.0	0.5	8.0
50-100	10.0	4.5	4.0	1.5	0.7	12.0
100-1000	12.0	5.5	5.0	2.0	1.0	15.0
> 1000	15.0	7.0	6.0	2.5	1.4	20.0

Notes:

1. Even harmonics are limited to 25% of the odd harmonic limits above.
2. *All power generation equipment is limited to these values of current distortion, regardless of actual I_{sc}/I_L .
3. Where I_{sc} = Maximum short circuit current at PCC.
4. And I_L = Maximum load current (fundamental frequency) at PCC.
5. For PCC's from 69 to 138 kV, the limits are 50 percent of the limits above. A case-by-case evaluation is required for PCC's of 138 kV and above.

Table 10.5-2 Harmonic voltage limits for power producers (Public Utilities or Non-Utility Generators)

HARMONIC VOLTAGE DISTORTION IN % AT PCC FOR SYSTEM NORMAL CONDITIONS*			
Maximum for:	$\leq 69\text{kV}$	69-138kV	$> 138\text{kV}$
Individual Harmonic	3.0	1.5	1.0
Total Harmonic Distortion (THD)	5.0	2.5	1.5

*For start-up, inrush conditions, limits can be exceeded by 50%.

10.6 POWER SUPPLY TO VOLTAGE SENSITIVE EQUIPMENT COMPUTERS AND SENSITIVE EQUIPMENT

Customers who use computers, microprocessor controlled equipment, solid state devices, x-ray equipment, or other voltage sensitive electronic equipment should consider the installation of auxiliary devices designed to protect this equipment from power disturbances. These power disturbances may be in the form of voltage sags or surges, spikes, temporary loss of power, or any other deviation from normal. The Customer may have to safeguard this equipment by the application of line filters, solid state line-voltage regulators, transient suppressors, isolating transformers, uninterruptible power supply (UPS) systems or motor generators. Utility distribution systems normally operate between certain voltage limits as established by National Standards and state rules. The Company should be contacted for further guidance.

10.7 ISOLATION TRANSFORMER

Where lighting or other reduced-voltage equipment is permitted from existing 3-phase, 3-wire, delta non-standard services, isolation transformers are required. The secondaries of these isolation transformers shall be properly grounded. The minimum number of single-phase transformers that may be used to serve the reduced-voltage load on a 3-phase, 3-wire service is shown in the following table:

Table 10.7-1 – Minimum Number of Single-phase Transformers to Serve Reduced-voltage Load on a 3-phase, 3-wire Service

Reduced-Voltage Load in Kilowatts or % of Total Demand on Service (whichever is larger)	Number of Transformers
Less than 5	1
5 to 10 inclusive	2
Over 10	3

The Company should be consulted prior to buying isolation transformers for this type of installation. Since auto-transformers do not provide isolation between primary and secondary windings, they shall not be used on 3-phase, 3-wire, ungrounded-delta service except to supply reduced voltage for motor starting. Auto-transformers used to supply other branch circuits shall be supplied only by a grounded system as outlined in the National Electrical Code or of any other applicable code.

11.0 CUSTOMER-OWNED ELECTRIC SOURCES – INCLUDING STANDBY GENERATORS

11.1 GENERAL

Installations of Customer-owned generating equipment (or other electric sources) require adherence to fundamental rules for the safeguard of all personnel and the Company's equipment. Any generating equipment that is or can be connected to any circuit which is, or can be supplied from the Company's distribution system shall meet the requirements of this section. This is to prevent any unanticipated backfeed of electricity into the Company's system as required by the Company's applicable tariffs.

With the exception of emergency or standby generators, permitted by the Company for sole use during utility outages, all generating sources shall be metered at the generator(s) output.

Any non-residential Customer generation on its premise requires submittal of documentation to the Company in accordance with the Company's applicable tariff prior to installation. Consult the Company for the prescribed forms.

11.2 EMERGENCY AND STANDBY ELECTRIC SOURCES

11.2.1 Compliance Criteria

The Customer shall notify the Company prior to installing non-parallel, standby generating equipment and obtain approval for the method of connection. Where the Customer installs a standby generator for the purpose of supplying all or a part of the load in the event of an interruption in the supply of Company service, the Customer's wiring shall be arranged so that no electrical connection can occur between the Company's service and the Customer's other source of supply. This will require the installation of a double-throw, "break-before-make" type switch. This transfer scheme must meet these requirements established by the Company; see illustrations below. Unless required in Section 11.2.3, residential standby generator installations will not need prior Company approval since the Customer's electrical inspection approval certificate will ensure compliance with these Company specifications and the NEC.

Figure 11.2.1-1 Standby Generator Non-parallel Operation with Company Connection Supplying Customer's Entire Load


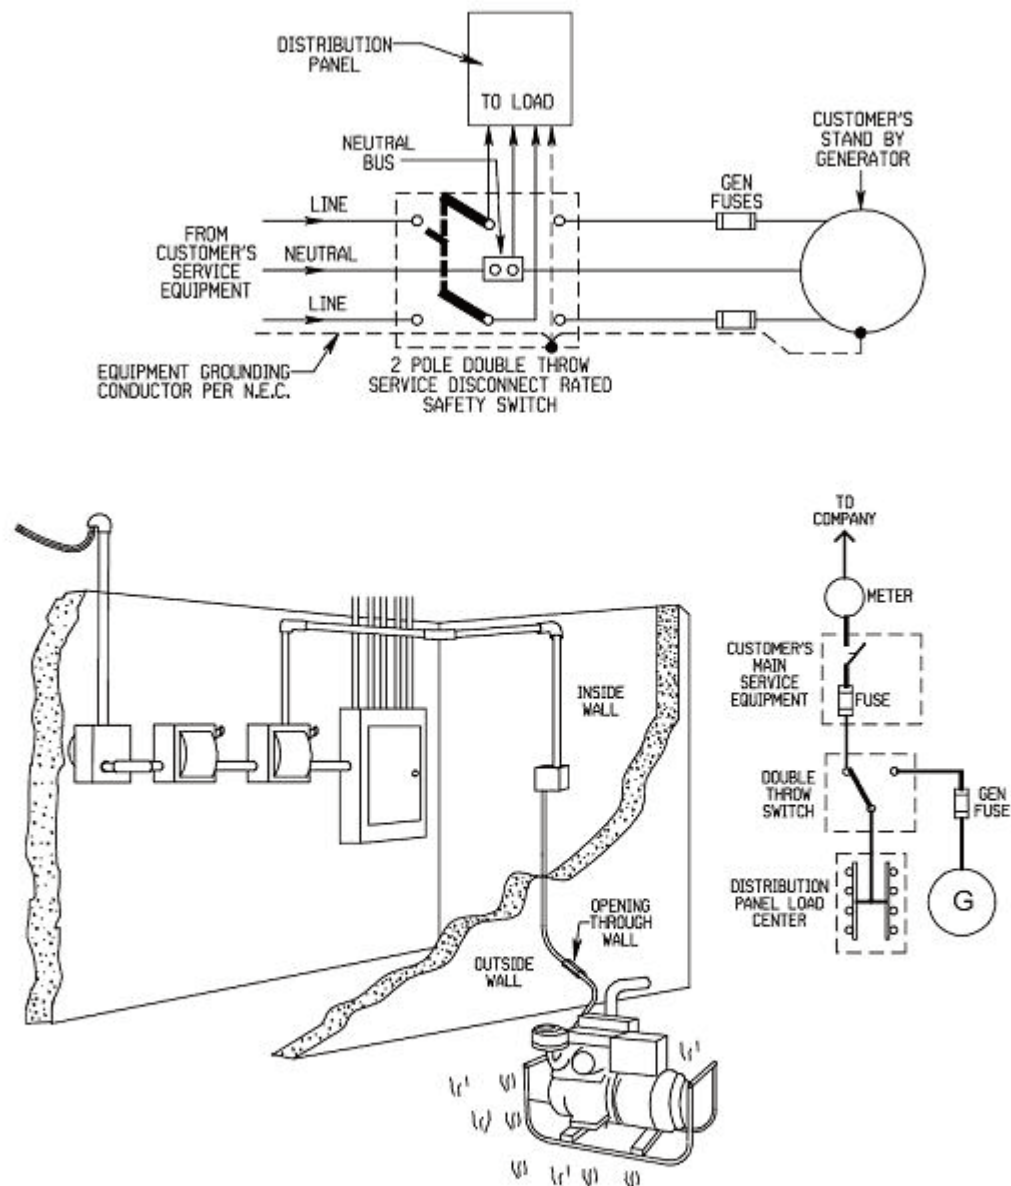


Figure 11.2.1-2 Connection of Standby Generator Supplying One 120 volt Branch Circuit

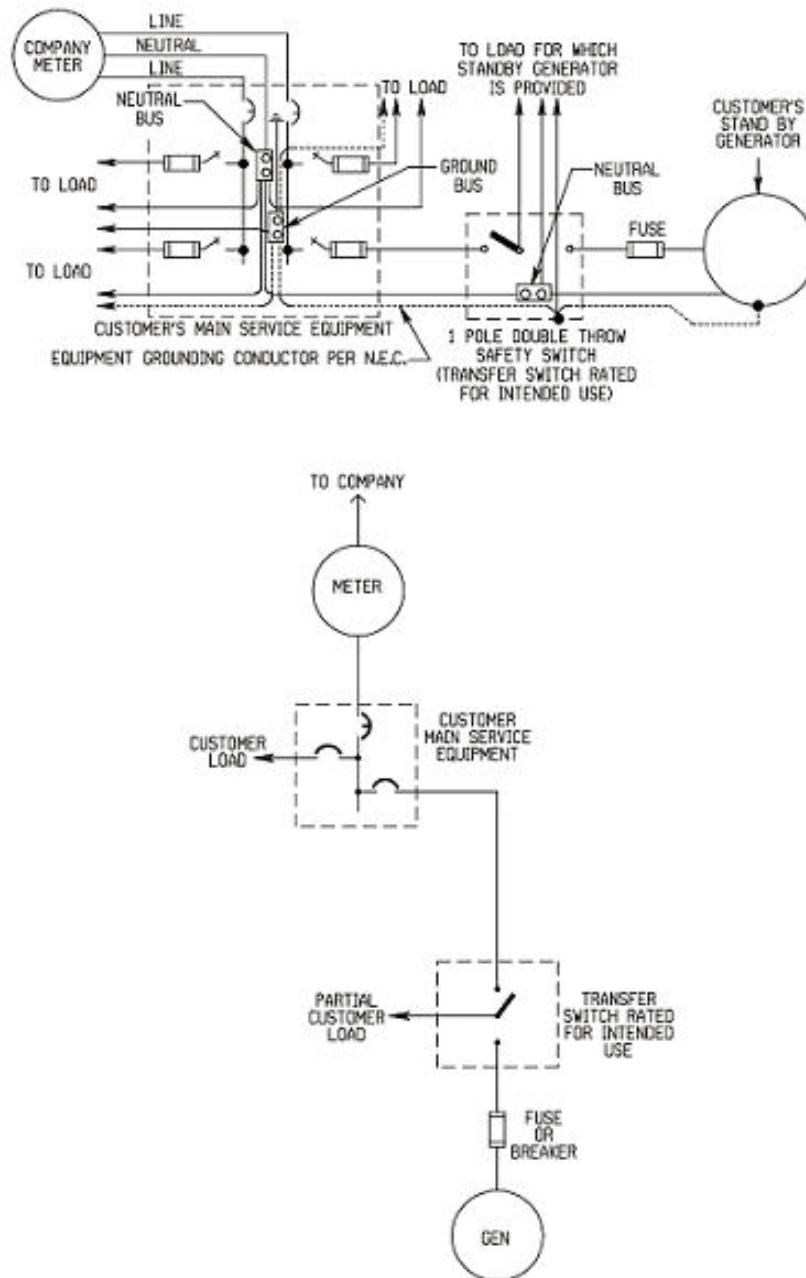

The figure contains two diagrams, (a) and (b), illustrating generator connection methods.

Diagram (a) - Correct Method: Shows a generator (GEN) connected to a customer's service equipment. The connection path includes a FUSE, a TRANSFER SWITCH RATED FOR INTENDED USE (which can switch between the generator and the utility line), a CUSTOMER POLE (a central point for connections to the HOUSE, BARN #1, and BARN #2), and the CUSTOMER'S MAIN SERVICE EQUIPMENT (containing a switch and a METER). The entire setup is labeled as the correct method.

Diagram (b) - Incorrect Method: Shows a generator connected to a customer's service equipment in an unsafe manner. The generator is connected to a 2 POLE DOUBLE THROW SAFETY SWITCH RATED FOR INTENDED USE. This switch is connected to a NEUTRAL BUS, which then feeds into the customer's service equipment. This setup is labeled as incorrect.

For the latest authorized version, please refer to the company's website at <http://www.nationalgridus.com/electricalspecifications>. 107

A non-residential Customer utilizing generation shall meet the following requirements if it proposes the installation under the Company's definitions of emergency or standby power system:

- ▶ Accepted documentation on file with the Company.
- ▶ Stated conditions when the Customer's emergency or standby generator may serve load on its premise for periods of time required by regulation or statute. Otherwise, test periods shall not exceed 10 hours per month.
- ▶ Maintain a written operating log indicating date, time, hours, and purpose of operation available to the Company upon request.
- ▶ Non-compliance will result in billing and installation of generator meter(s) in accordance with the Company's tariff.

11.2.2 Electric Source Type & Installation Method

11.2.2.1 AC or DC

The stand-by generator should be 60 Hertz alternating current. If a direct current generator is used, the installation must be arranged so that all motors, radios and other equipment that will not operate on direct current are disconnected from circuits before the circuits are energized from the stand-by generator.

11.2.2.2 Separately Derived Systems

When an AC generator is installed as a separately derived system, grounding of the neutral conductor shall be in accordance with the National Electrical Code. Separately derived systems require a switched neutral conductor in the transfer switch. Figures in this bulletin do not show this system configuration. The Customer is required to maintain safe step and touch voltages when installing a separately derived system in conjunction with the Company's electric service connection (this may require the services of a design professional).

11.2.2.3 Temporary Emergency Connections

To avoid serious risks to utility workers and the general public, Customers without permanently connected transfer systems may temporarily install emergency generators under the following conditions:

- ▶ Generator connection is made on the load side of the main disconnect device (i.e. circuit breaker, switch, or fuse block).
- ▶ The main disconnect device is tagged in the "open" position after ensuring disconnect is electrically open. The tag shall clearly state "do not operate".
- ▶ The Company's meter shall not be accessed.
- ▶ Notify the Company when electrical separation cannot be made by the Customer's equipment.

11.2.3 Transfer Systems


11.2.3.1 Service Equipment Rated Transfer

Transfer switches listed and labeled "suitable for use as service equipment" are permitted for use as main service equipment upon prior approval by the Company. See service equipment definition for necessary equipment arrangement. All other transfer switches shall be connected on the load side of the main service equipment.

11.2.3.2 Open-Transition Transfer

A double throw switch or contactor using a "break-before-make" sequence shall normally be provided to transfer all ungrounded conductors of an emergency lighting or power load to either the stand-by generator (or other electric source) or the normal supply.

Figure 11.2.3.2-1 Double Throw Safety Transfer Switch
(Not Service Equipment Rated)

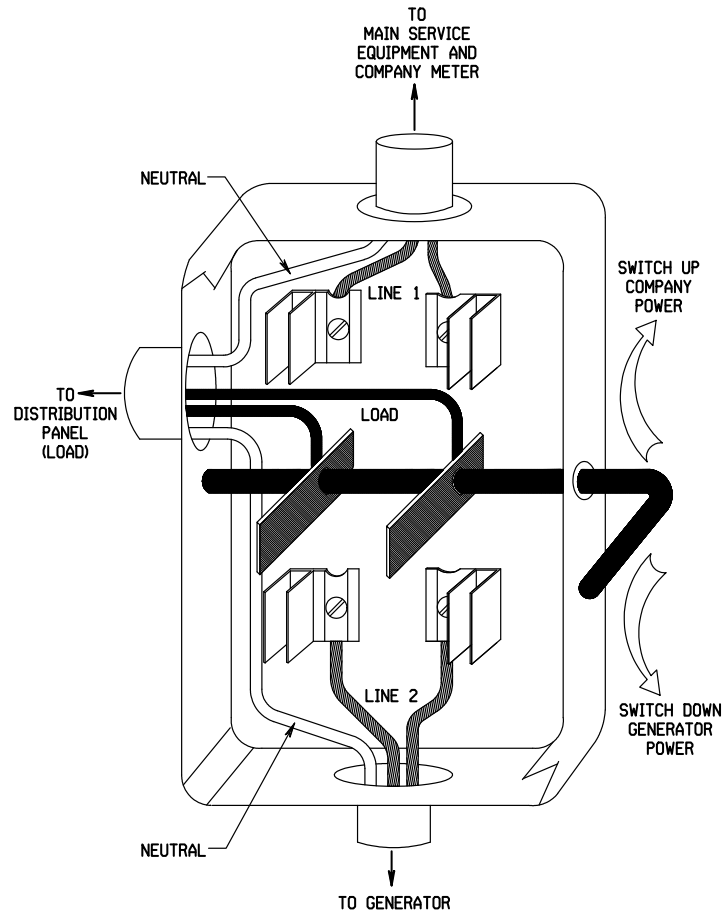

Where automatic throw-over switching is installed, the Customer shall provide an isolation switch in combination with each automatic transfer switch. The isolation switch shall provide a lockable means for manually isolating the emergency generator. The Company will tag the isolation switch in a locked open position during maintenance or repair of Company supply lines. Arrangements utilizing interlocking of single-throw devices are not acceptable.

11.2.3.3 Closed Transition & Auto Transfer

These requirements apply to closed transition schemes associated with standby or emergency generators where the generator will momentarily operate in parallel with the Company's system. This can be accomplished utilizing breakers or an Automatic Transfer Switch (ATS).

- ▶ The Customer shall submit for acceptance by the Company three copies of the single line, specifications, complete vendor prints, relay settings and a description of operation of the system.
- ▶ Requirements for Closed Transition Switching back to the Company's system:
 1. Closed transition switching shall occur within 15 cycles.
 2. Once the parallel is made, a transfer failure relay shall monitor the utility and generator breaker to ensure the transfer operation has been completed. If the transfer has not been completed

within 30 cycles, the transfer failure relay shall trip the generator breaker. For ATS installations, the transfer failure relay shall monitor the switch contacts.

3. The settings for paralleling the generator to the Company's system shall not exceed the values listed in Table 11.2.3.3-1. All devices that perform paralleling shall be utility grade, that is, they must meet the requirements of IEEE C37.90.1, 2, and 3.

Table 11.2.3.3-1 Relay settings to parallel standby or emergency generators with the Company system

Generator Size (kW)	Max. Frequency Difference (Δf , Hz)	Max. Voltage Difference (ΔV , %)	Max. Phase Angle Difference ($\Delta \Phi$, degrees)
0-500	0.3	10	20
>500 – 1,500	0.2	5	15
>1,500 – 10,000	0.1	3	10

4. The system shall be designed such that loss of the utility source will automatically open the utility breaker prior to closing the generator breaker (open transition).
5. The system shall allow functional testing of the various operating and failure modes outlined in the description of operation.
6. The Company reserves the right to witness functional testing of the transfer scheme, including failure modes. In these cases, it shall be the responsibility of the Customer to demonstrate proper operation and functional testing.

► Exercising Generator:

1. If there is no load bank, and it is the intention of the customer to exercise the generator in parallel with the Company for an extended period of time (> 30 cycles), the generator shall meet the requirements of ESB 756.
2. The Customer can exercise the generator with building load under requirements Items one through six above and the Company's filed Tariff.

11.2.4 Identification and Clearances

11.2.4.1 In accordance with the NEC, a sign shall be placed at the service-entrance equipment that indicates the type and location of on-site standby power sources.

11.2.4.2 Customer's on-site generator and fuel storage are often located adjacent to Company pad-mounted transformers for ease in using the same trench to the electrical room. The Company requires protection between the transformer and the generator fuel storage unit, by either a twenty (20) foot (6 m) separation or a masonry wall. This wall should be erected parallel to and located three (3) feet (900 mm) from one side of the pad-mounted transformer foundation. The wall should be six (6) feet high and extend approximately three (3) feet (900 mm) beyond each end of the transformer foundation. Refer to ESB 754 for further details for such application which shall be supplied to the Company for approval.

11.3 PARALLEL ELECTRIC POWER PRODUCTION

No Customer or Independent Power Producer (IPP) shall install or operate electric generation (or other electric sources) in parallel with the Company's system without prior notification to and approval by the Company. Customers considering the installation of parallel electric power production equipment to supply all or a portion of their electrical energy requirements and who wish to arrange for, or continue to receive, service from the Company's system for their remaining electrical energy requirements and/or for stand-by service, must consult with the Company regarding the design, installation and operation of such equipment. (See Company's Electric System Bulletin No. 756 and its applicable appendix for additional details.) Precautions must be taken to maintain adequate safety and quality of service to other customers. Customers wishing to sell electric energy

shall call the Company's Customer Service Center or those having managed accounts shall consult with their Account Manager for the Company's purchase policy.

11.3.1 Inverters

Direct current electric sources may be operated in parallel with the Company's system through a synchronous inverter where its installation will be designed such that a Company system interruption will result in the removal of the inverter from the Company's system. The Customer shall submit specifications for approval by the Company prior to procurement or installation of the inverter. (See Company's Electric System Bulletin No. 756 and its applicable appendix for additional details.)

12.0 UTILIZATION and SPECIAL EQUIPMENT

12.1 ELECTRIC FENCES

The Company urges extreme care in the selection of an electric fence system. A direct electrical connection to a fence or a connection through resistance, reactance, or lamp bulb, is not permitted without an approved controller. For guidance in safety methods, materials, and equipment to construct electric fences, those interested are referred to U.S. Department of Agriculture, Farmers Bulletin No. 1832 or to qualified experts such as the Department of Agricultural Engineering, Cornell University, Ithaca, New York.

12.2 SIGNS AND AUTOMATICALLY CONTROLLED LIGHTING

The Company shall be consulted in advance when signs or automatically controlled lighting are to be installed. Flashing signs shall be properly balanced throughout each portion of the flashing cycle.

12.3 LIGHTNING AND SURGE PROTECTION

When a Customer desires to install its own lightning or surge arrester it shall be connected on the load side of the main service disconnect by and at the expense of the Customer. For protection to be effective, such devices should be connected in conjunction with any applicable codes and approved by the AHJ. The Customer shall be responsible for providing, installing, operating, maintaining, and inspecting any such installations. The Company will not be responsible for damage to a Customer's equipment resulting from voltage surges that may occur on the Customer's wiring.

For services above 600 volts, lightning or surge arrester installations should be made in accordance with recommendations of the Company's Engineering Department and the applicable supplements to these specifications.

12.4 POWER FACTOR CORRECTION, CAPACITORS

Maintenance of high power factor is of the utmost importance to both Customer and Company in the operation of each of their distribution systems. Company rates are based, in general, on a minimum average power factor. The minimum average power factor value shall be that specified in the Company's applicable rate tariff that the billing is partly based on the reactive demand (RkVA) under which the Customer takes service. The Company should be consulted in advance regarding all installations likely to develop low power factors so that such conditions may be rectified by measures adapted to each proposed installation.

Customers are encouraged to maintain a power factor near 95 percent. The use of synchronous motors is desirable since these contribute to good power factor. Where possible, induction motors should be applied so as to operate at, or near, full rating.

12.4.1 Capacitor Installation

A Customer, installing capacitors to improve the power factor of its load, should obtain from the Company the characteristics of the supply system so that the capacitors can be properly applied. Consult the Company prior to procuring and installing power factor correction equipment for Company review and acceptance to assure that service to other customers will not be adversely affected by the manner in which such equipment is installed and operated.

12.4.2 Static VAR Compensators (SVC)

A Customer, installing static VAR compensators (SVC) to improve its power operating efficiency of its electric system, should obtain from the Company the characteristics of the supply system so that the SVC's can be properly applied. Consult the Company prior to procuring and installing SVC equipment for Company review and acceptance.

12.5 RADIO AND TELEVISION

12.5.1 Transmitting Station, Repeater, or High Frequency Equipment

Before a Customer installs and operates radio or television transmitters, repeater, or other high frequency equipment at a specific location, the Company shall be consulted for information on the type of electric service that will be supplied and the special precautions that must be observed so that the operation of this apparatus will not interfere with electric service to other Customers.

12.5.2 Antennas

Outdoor antennas for radio or television sets shall not be erected over, under or in close proximity to the Company's wires or any other wires carrying electric current, and shall not be attached to the Company's poles or Customer riser masts. To do so may result in serious accident or damage to equipment. Where practical, antenna conductors shall be installed so as not to cross under open electric conductors. Where proximity to electric conductors of less than 250 volts cannot be avoided, the clearance shall be at least two (2) feet (600 mm). In all cases, the National Electrical Safety Code conditions shall be met.

12.5.3 Eliminator or Trap

Installation of an eliminator or trap where necessary shall be suitable and shall be installed by the Customer in such manner as to prevent radio, telephone, television, and other interference feeding back into the supply circuit.

12.6 CARRIER CURRENT SYSTEMS

If a Customer uses building wiring for a carrier current system for remote control of power, communication, signaling, or other purposes, the Customer shall install suitable filter equipment or make other provisions approved by the Company to keep the Company's distribution facilities free from any high-frequency components or carrier currents produced by the Customer's equipment. Consult the Company prior to procuring and installing carrier current system equipment for Company review and acceptance. The Customer is also responsible for correction of any interference caused to other customers.

13.0 REVISION HISTORY

Version	Date	Description of Revision
1.0	04/20/10	Initial version of new document superseding all previous revisions of ESB 750 and the Electrical Service Information and Requirements (Green Book)

Part C – “APPENDICES”

Appendix 1 - Overhead Attachment Methods

Overhead service attachment brackets shall be of Company approved materials.

Table App1-1 – Company-accepted Attachment Materials

Item No.	Description	Vendor ID	Vendor Cat. No.
B53A	Bracket, insulated service. Reinforced porcelain wire holder for attachment of multiplex services to 1-1/4” through 2-1/2” metal mast.	Joslyn Cooper	J0588 DW2C3
B53B	Bracket, insulated service. Reinforced porcelain wire holder for attachment of multiplex services to 3”to 4” metal mast.	Chance Cooper PPC Insul.	P1226 DW3C1 6913
B54	Bracket, insulated service. “House Knob.” Reinforced porcelain or nylon wire holder with 3” #22 hot dip galvanized wood screw. EEI TD 24 Style 5. (1)	Chance Joslyn Cooper PPC Insul.	3-11-45 JO893 DW2R4 1987
B17	Bolt, “J”. 3/8” x 11” galv. steel special for attaching service bracket to house. (2)	Joslyn Cooper DR6E1	BT3917
I-10	Insulator Clevis. Insulated galv. assembled with dry process porcelain insul. for #2 AWG & #4 AWG triplex services. (1)	Joslyn Cooper	J1945 DC7F11
I-11	Clevis, insulated spool type sec. dead-end EEI-TD20-Item 2 clevis with ANSI C29.3 Class 53-3 insulator.	Joslyn Cooper PPC Insul.	J0342W/J97 DC3F66 4113
I-12	Clevis, secondary insulator clevis galv. steel for use with I-25 insulator (Not included) 3000# ult. For use on #1/0 AWG & 336 kcmil triplex services. 5/8” cotter bolt & s.s. cotter key. (2)	Chance Joslyn Cooper PPC Insul.	T207-0105 23491 DC13C4 4112
I-25	Insulator, sec. rack spec. ANSI C29.3-class 53-2, 0-600V.	Chance Joslyn Cooper PPC Insul. Victor Ins. Lapp	C909-0032 J151 WD684 5101 2012 8442-70
B7A2	2½” Expansion Shield Lag Screw, cast of zinc-base alloy. Long style for use with 3/8” lag screws on masonry construction. (1)	Diamond Rawl Star	001106 1155 1825-00200


Table App1-1 (cont'd)

Item No.	Description	Vendor ID	Vendor Cat. No.
B11A	3/8" x 3" Galv. Steel Lag Screw, with square head shoulder shank and gimlet point. (1)	Cooper Joslyn	DF3L3 J8773
B11B	3/8" x 4" Galv. Steel Lag Screw, with square head shoulder shank and gimlet point. (2)	Cooper	DF3L4
B13	Machine Bolt, 5/8" x 12" square head steel bolt (with nut). Galv. Steel with 6" min. thread length. (2)	Chance Hughes Cooper	8812 B612-4 DF3B12
W1	Flat Washer, 2-1/4" square x 3/16" Galv. Steel	Chance Joslyn Cooper Flagg (MIF) PPC Insul.	6813 J1075 DF2W4 P56A 6330

Notes: (1) For up to 600 lbs. service drop tension only.
(2) For up to 1100 lbs. service drop tension only.


Refer to the following illustrations for Company-accepted attachment methods.

Figure App1-1 – Illustrated Details of Overhead Service Attachment Methods: Details

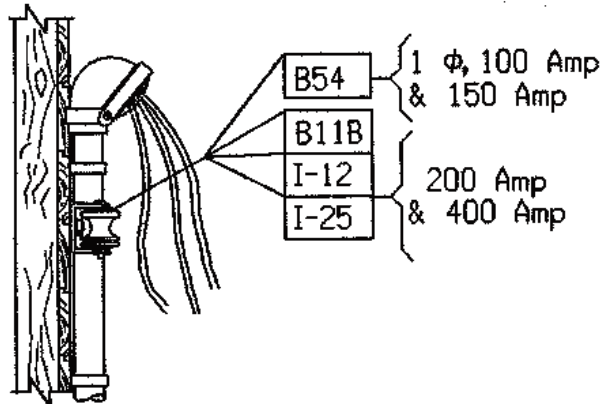


Detail 1

Insulated Service Attachment Bracket Assembly for Small Wood Frame Residence or Commercial Buildings

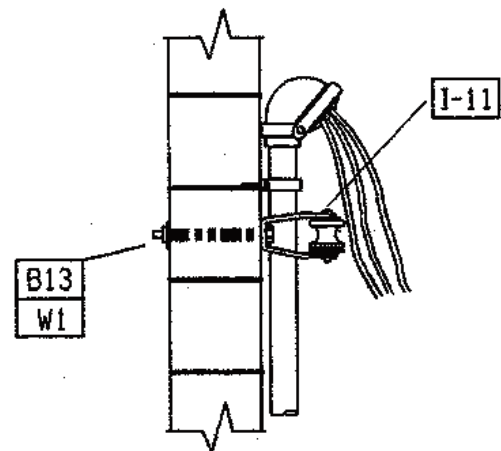

Detail 3

1 ϕ or 3 ϕ Attachment Bracket Assembly for Masonry Buildings or Steel Structural Support Member.

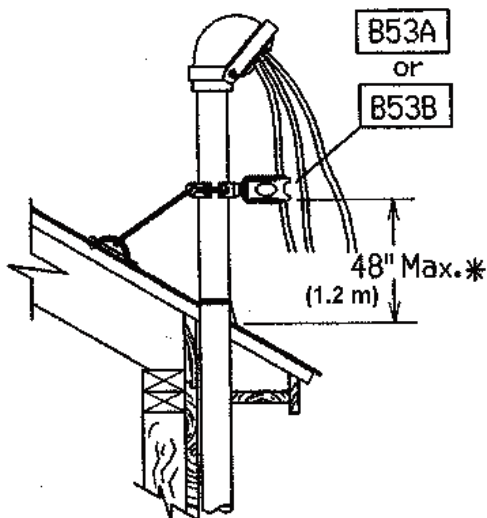


Detail 2

1 ϕ or 3 ϕ Attachment Bracket Assembly for Low Profile Buildings.

*** Note:**


Minimum Attachment Height shall be such that the Service drop's drip loop is not less than 18" (450 mm) above the roof.

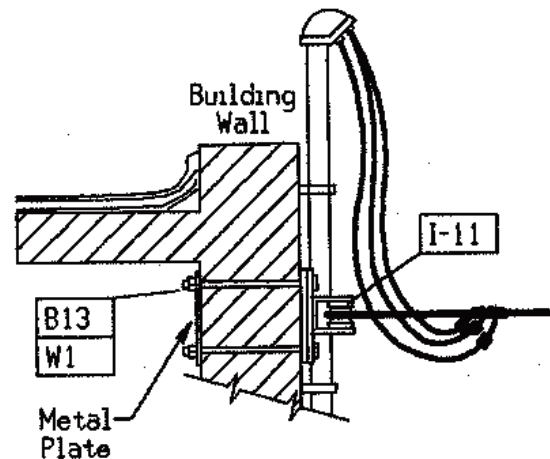

Detail 4

Attachment Bracket Assembly for 800 Amp Services

Figure APP1-2 – Illustrated Details of Overhead Service Attachment Methods: Anchoring

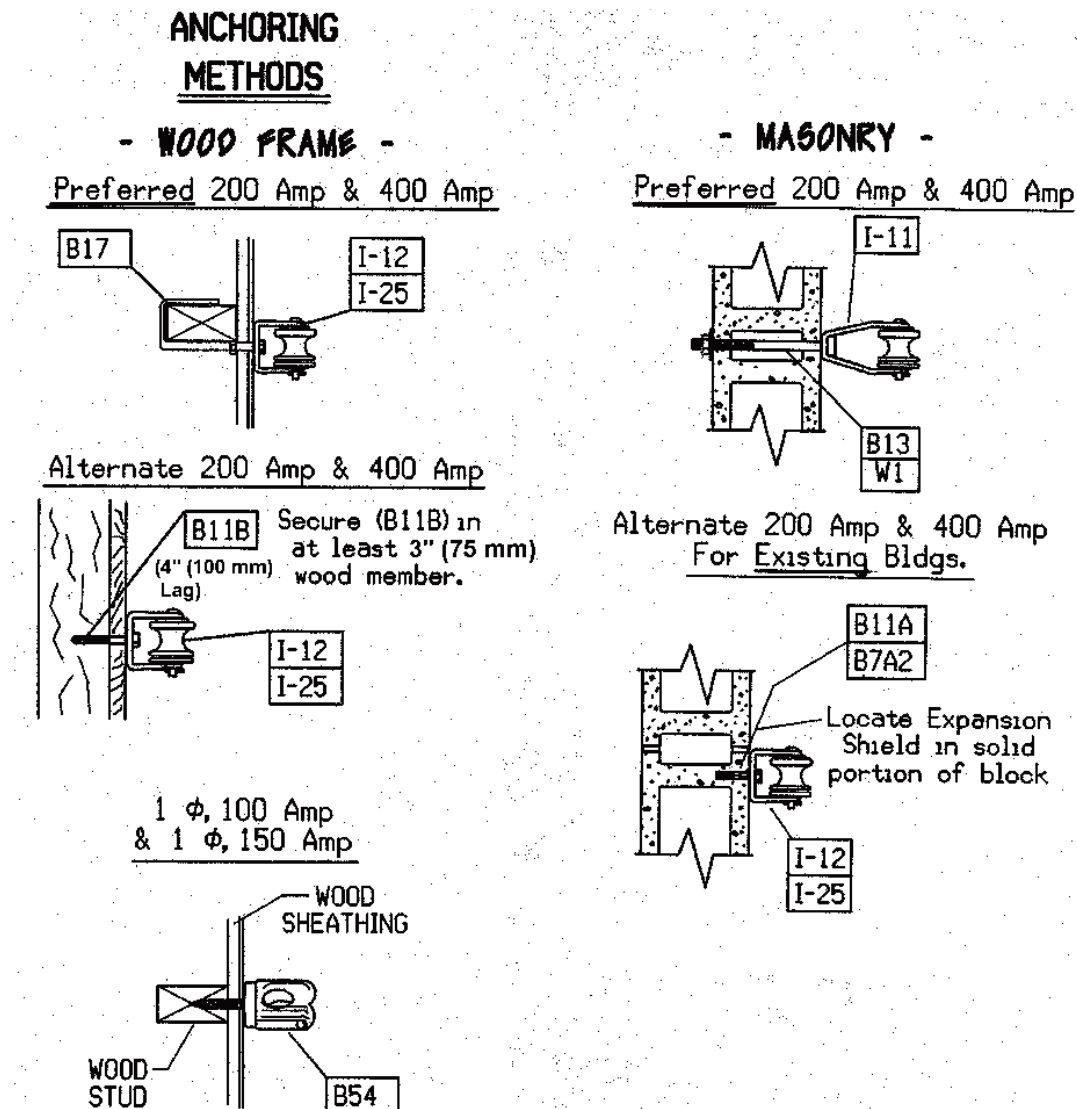

MATERIAL LIST			
ITEM	DESCRIPTION	ITEM	DESCRIPTION
B53A	600V Insulated Service Bracket (1-1/4" (35) to 2-1/2" (63) pipe)	I-25	3", 600V Insulator 2-1/2" (65 mm) Expansion Shield
B53B	600V Insulated Service Bracket (3" (78) to 4" (103) pipe)	B7A2	Lag Screw (Zinc Alloy) 3/8" (10 mm) X 3" (75 mm) Lag Screw
B54	600V Insulated Service Bracket "House Knob" (3" (75 mm) Lag Screw)	B11A	3/8" (10 mm) X 4" (100 mm) Lag Screw
B17	3/8" (10 mm) X 11" (280 mm) "J" Bolt	B11B	5/8" (16 mm) Machine Bolt
I-10	600 V Insulator Clevis	B13	2-1/4" (57 mm) Square Flat
I-11	600V Insulated Spool	W1	Washer
I-12	3" (75 mm) Clevis		

Appendix 2 - Traffic Control Metered Service Requirements


(For D.O.T., Municipal, and individual customers as designated in the Company's applicable tariff.)

Notes for Figure App2-1

(The figure is typical in nature; however, variations may be permitted with prior consultation with the Company and approval granted in writing.)

- | | |
|----------|---|
| NOTE #1 | Raintight service head. |
| NOTE #2 | Service bracket furnished and installed by Customer below weatherhead. |
| NOTE #3 | Company service drop for overhead service. For underground service, Customer's cable-in-conduit (continuous) to Company's line. |
| NOTE #4 | Service entrance cable or service entrance conductors in approved conduit. PVC Schedule 80 recommended, see Section 4. Bond metallic conduit in accordance with N.E.C. Article 250. |
| NOTE #5 | Leave 24" (600 mm) of service entrance conductors for service drop connection by Company. |
| NOTE #6 | Straps at not more than 30" (750 mm) intervals. |
| NOTE #7 | Watertight fitting. |
| NOTE #8 | Commercial meter socket trough furnished and installed by Customer in a true vertical position, see Section 7. Locate on structure away from traffic flow and such that the bottom of the meter socket trough is more than 8 feet (2.5 m) above grade. Or, the top of the meter socket trough must be below 6 feet (1.8 m) and there must be 8 feet (2.5 m) clear space without handholds or footholds starting at no higher than 6 feet (1.8 m) above grade. For service supplied from a network, a main disconnect is required and metering shall be cold-sequence. |
| NOTE #9 | 1/4" (6 mm) dia. X 3/4" (19 mm) long bolts with nut and washer, all zinc coated steel. A total of four required, two for top, two for bottom. |
| NOTE #10 | Slotted framing channel (Kindorf, Unistrut, Superstrut, or Company accepted equal), 12 gauge zinc coated steel, with holes, 1-1/2" (38 mm) h X 3/4" (19 mm) w X (length = width of associated meter socket). Two required, one for top, one for bottom. |
| NOTE #11 | Meter support attached to Customer's structure with materials approved for the purpose. |
| NOTE #12 | Outdoor service equipment, see Section 5. For transfer switch applications, refer to Section 12. Where in the public way and the Customer's structure is connected to the Company's overhead service drop, traffic controller equipment and service equipment shall be located such that the bottom of the equipment is more than 8 feet (2.5 m) above grade. Or, the top of the traffic control box must be below 6 feet (1.8 m) and there must be 8 feet (2.5 m) clear space without handholds or footholds starting at no higher than 6 feet (1.8 m) above grade. |
| NOTE #13 | Install service entrance ground in accordance with N.E.C. |
| NOTE #14 | 10 ft. (3.0 m) minimum distance from service pole to Company's line, see Section 4 regarding clearances. |

Figure App2-1 – Typical Traffic Control Metered Service Installation

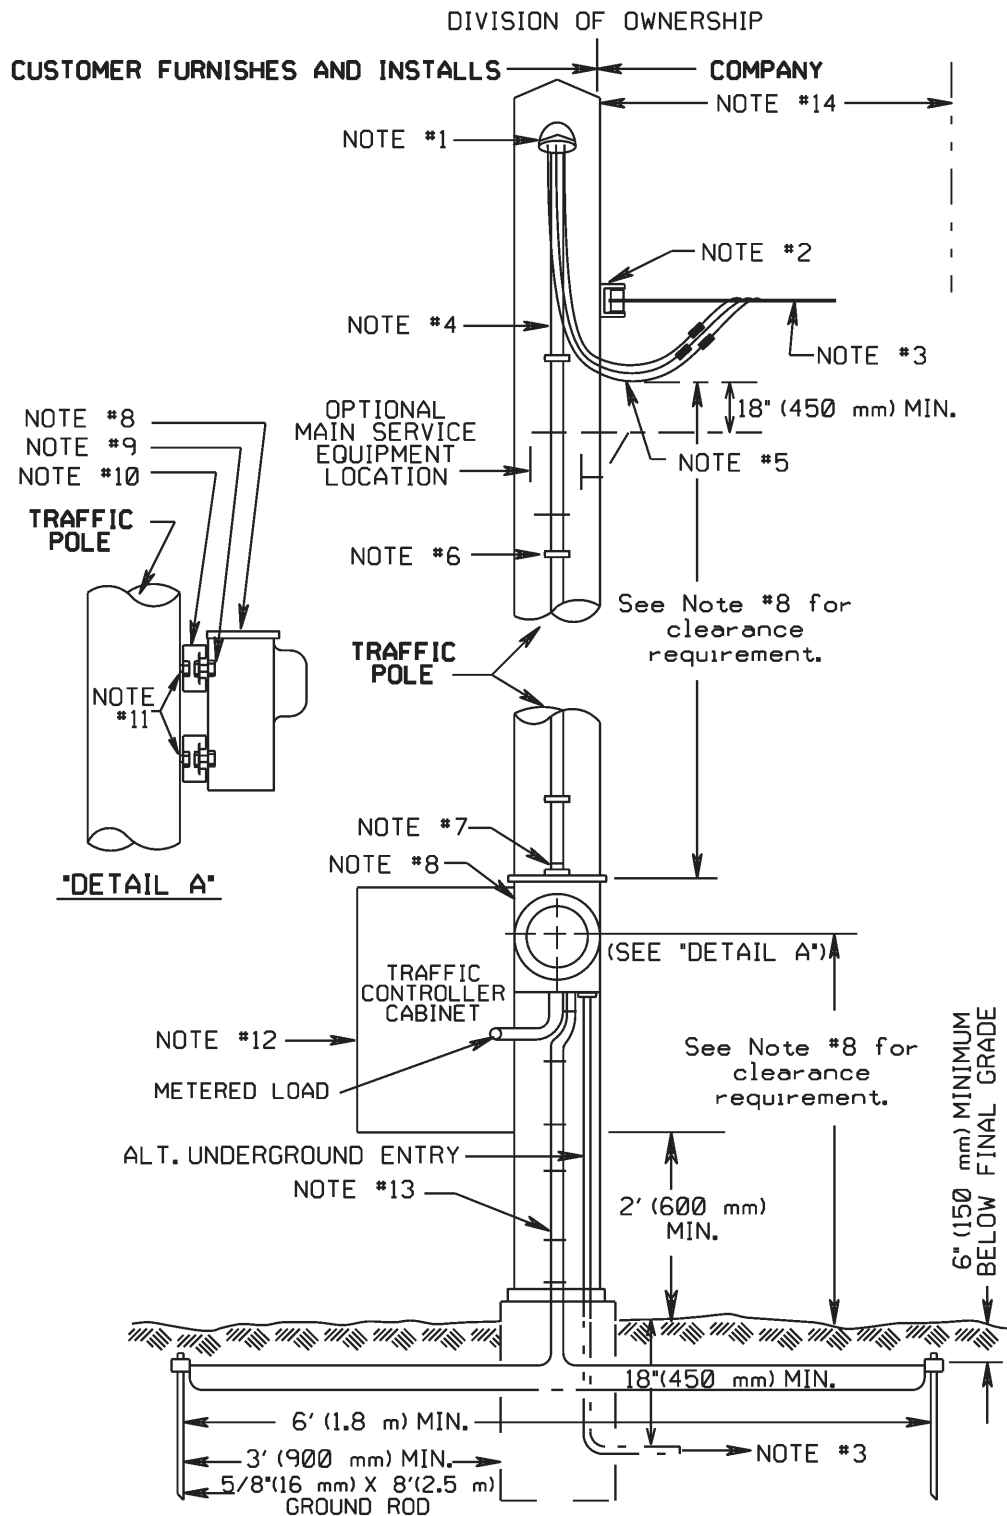

CHANGE PROPOSAL FOR NATIONAL GRID “SPECIFICATIONS FOR ELECTRICAL INSTALLATIONS”

INSTRUCTIONS — PLEASE READ CAREFULLY

Electronic media submittal of proposals is preferred. Type or print legibly in black ink. Use a separate copy for each proposal. Limit each proposal to a SINGLE section. All proposals must be received by National Grid’s SEIC to be considered for the next revision of ESB 750. Proposals received that are not in the prescribed format will be returned to the submitter. If supplementary material (photographs, diagrams, reports, etc.) is included, please submit one (1) printed copy and the electronic file copies in Adobe Acrobat (pdf) for the National Grid Specifications for Electrical Installations Committee (SEIC).

SUBMITTED BY: <i>(Include all appropriate information for contact purposes.)</i>		DATE:
Name	Street Address/City/State/Zip/Email Address (Or Internal Company Location)	Telephone

CHANGE PROPOSED FOR:

ESB Document No.	Section/Part/Paragraph/Article reference
750 (2010)	

PROPOSED CHANGE: *(Include proposed new wording, or identification of wording to be deleted.)*

SUBSTANTIATION: *(Note: State the problem that will be resolved by your recommendation; give the specific reason for your proposal including copies of tests, research papers, fire or safety or operation experience, etc.)*

☐ I understand that I acquire no rights in any publication of National Grid in which this change proposal in this or another similar or analogous form is used.

SIGNATURE:

Mail suggestions to:

National Grid, Distribution Asset Management, Customer Facilities Engineer, 300 Erie Boulevard
West Syracuse, New York 13202-4250
Or, Email to seic@us.ngrid.com (electronic submittals are preferred)

For the latest authorized version, please refer to the company’s website at <http://www.nationalgridus.com/electricalspecifications>. 121

Electrical Inspections are a Vital Public Safety Function

Inspections Can Save Lives and Property: Inspections by qualified inspectors reduce the potential for fire and shock hazards due to incorrectly installed electrical products and systems covered by the National Electrical Code®, save lives, and reduce property damage that may result from unsafe electrical installations.

Inspections Mean Compliance with Laws: Most states and localities require electrical installations to comply with the National Electrical Code®, to protect public safety. Electrical inspections help confirm that electrical wiring and systems are installed “according to Code.”

Inspections Check for Safety Products: Most states and localities require electrical products to be “listed” by recognized product safety certification organizations. Electrical inspections help confirm that properly certified products meeting U.S. safety standards are installed.

Inspections Confirm that Qualified Installers are on the Job: Electrical inspections protect against untrained or careless installers. Too often, unqualified installers perform unsafe electrical installations, and may also use products that don’t meet national safety requirements or local laws and codes.

No Public Funding: Government funding isn’t needed to pay for proper and thorough electrical inspections. The cost of inspections is usually covered by fees paid directly by builders and contractors. This vital public safety function doesn’t have to cost taxpayers or cash-strapped governments a dime.

Inspections Can Help Lower Insurance Premiums: Property insurance premiums are generally lower in areas with strong building codes enforced by professional inspectors. That’s because qualified electrical inspections help protect lives and property.

Signed by: The Inspection Initiative: An Industry Coalition Supporting Qualified Electrical Inspections (first issued 1997)

National Grid is an international energy delivery company. In the U.S., National Grid delivers electricity to approximately 3.3 million customers in Massachusetts, New Hampshire, New York and Rhode Island, and manages the electricity network on Long Island under an agreement with the Long Island Power Authority (LIPA). It is the largest distributor of natural gas in the northeastern U.S., serving approximately 3.4 million customers in Massachusetts, New Hampshire, New York and Rhode Island. National Grid also owns over 4,000 megawatts of contracted electricity generation that provides power to over one million LIPA customers.

National Grid
40 Sylvan Road
Waltham, MA 02451-1120
1-800-322-3223 New England
1-800-642-4272 New York
www.nationalgridus.com

nationalgrid

The power of action.™